
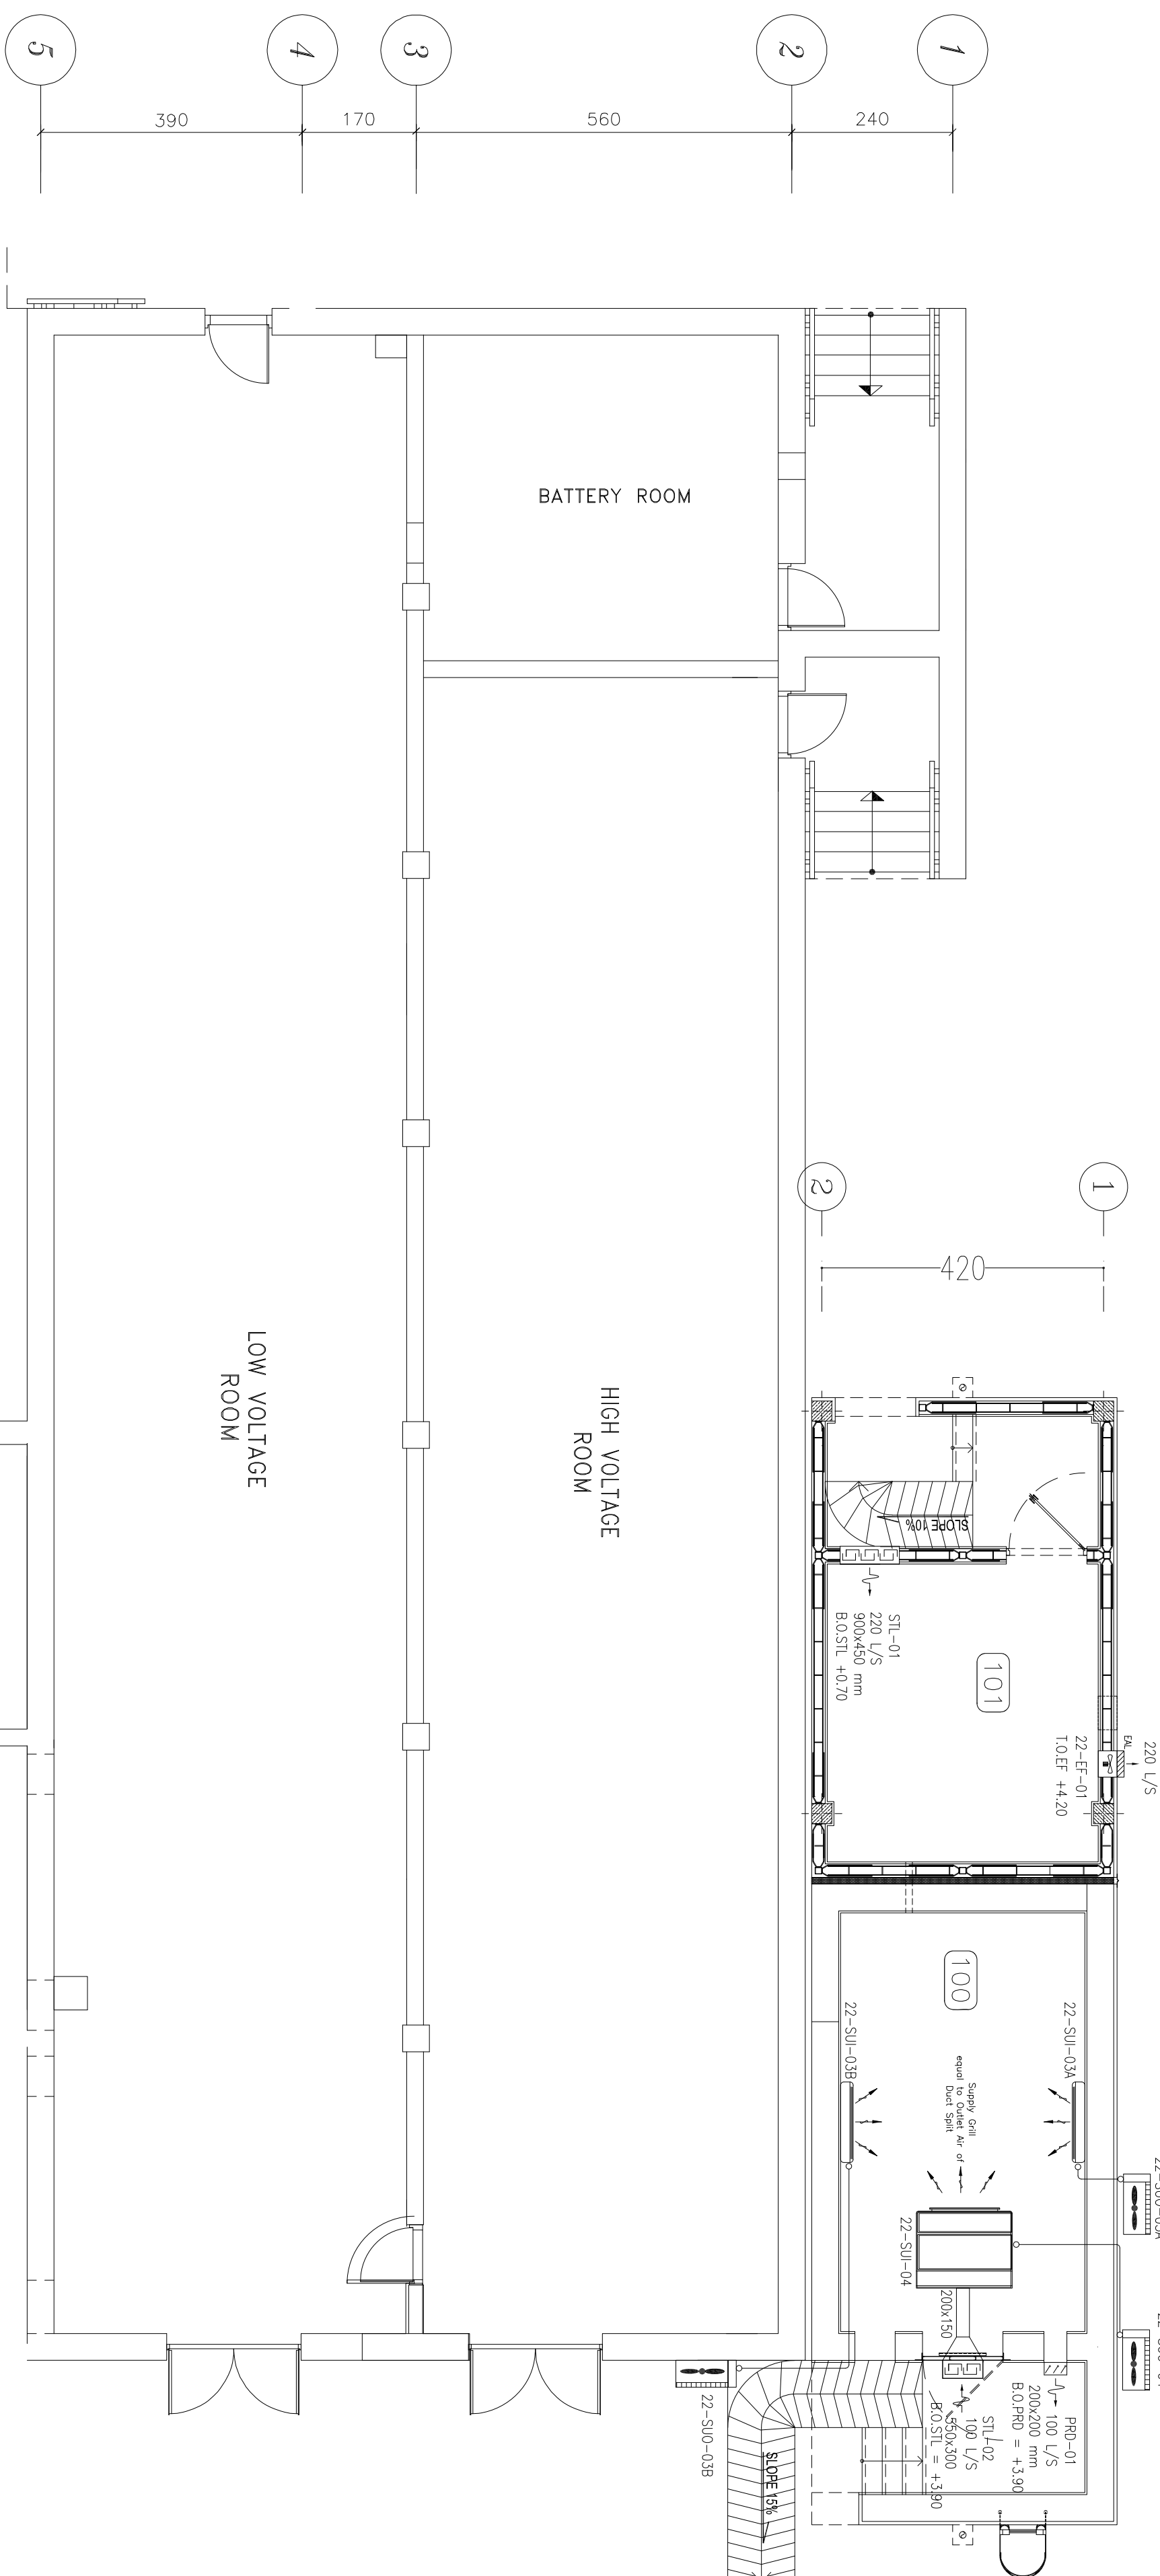
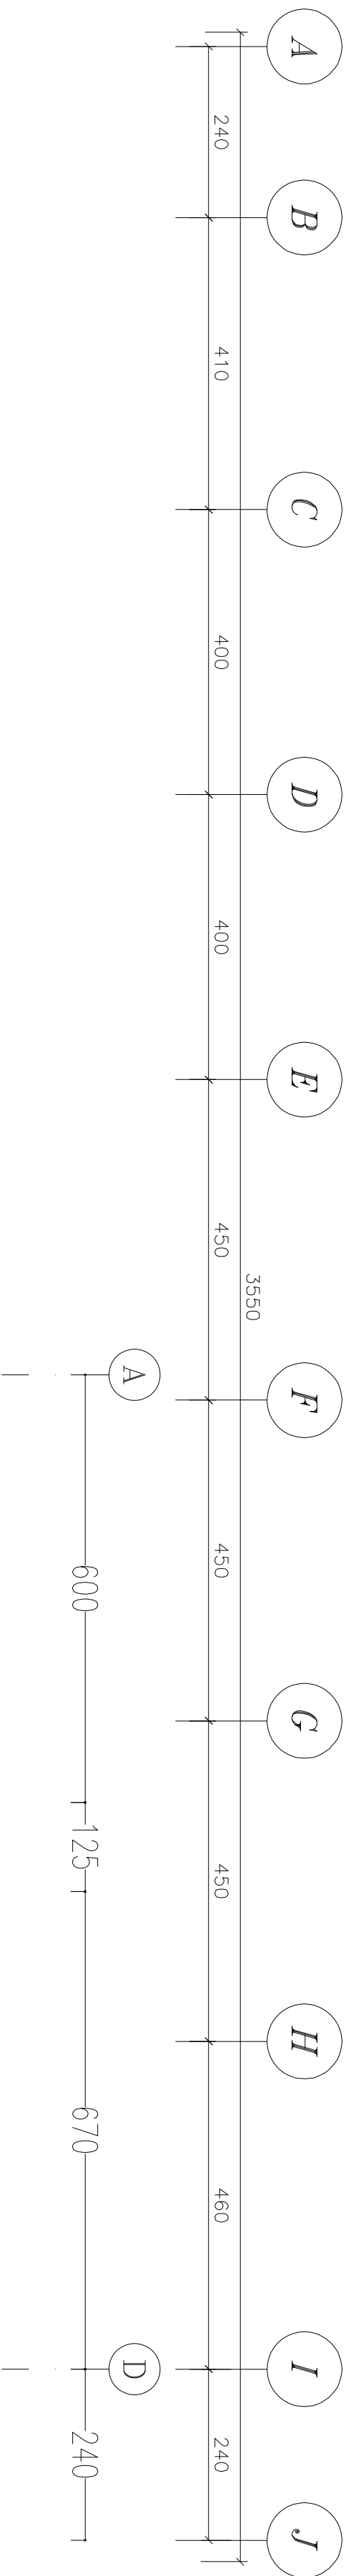


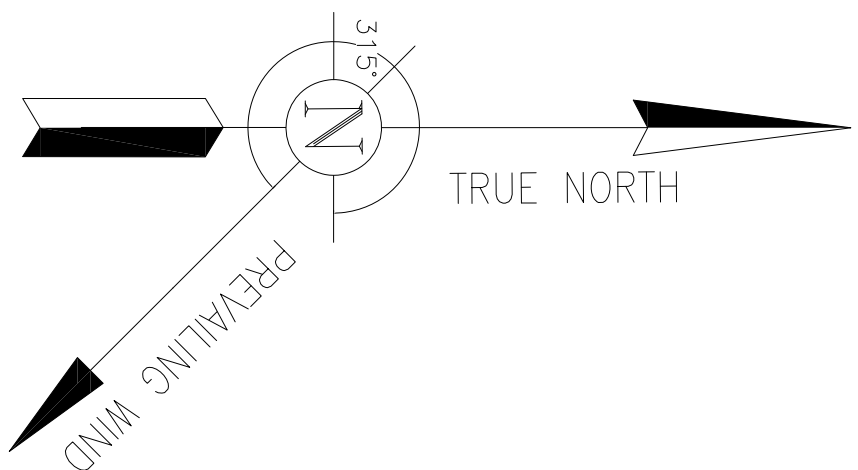

ROOM	TYPE	TAG NUMBER	NECK SIZE (MM)	QTY.	FLOW (L/S)
CO2 ROOM	SAND TRAP LOUVER	STI-01	900x450	1	220
CAPACTOR BANK	SAND TRAP LOUVER	STI-02	550x300	1	100
CAPACTOR BANK	PRESSURE RELIEF DAMPER	PRD-01	200x200	1	100

EXHAUST FAN


EQUIPMENT NO.	QTY.	TYPE	FLOW (L/S)	STATIC PRESSURE (PA.)	SERVICE AREA	REMARK
22-EF-01	1	AXIAL(WALL MOUNTED)	220	100	CO2 ROOM	EQUIPPED WITH EXHAUST AIR LOUVER

DX-SPLIT AIR CONDITIONER UNITS

EQUIPMENT NO.	QTY.	TYPE	SENSIBLE/TOTAL LOAD (BTU/HR)	NOMINAL CAPACITY (BTU/HR)**	INDOOR DESIGN TEMP (DB°C)/°H(°F)	AIR INLET TEMP. FOR OUTDOOR UNIT (°C)	ELECTRIC POWER (V/PH/Hz)	SERVICE AREA
22-SU1-04 22-SU0-04	1	DUCTED SPLIT	27287 / 38879	48000	30/(30% TO 60%)	50	230/1/50 400/3/50	CAPACITOR BANK
22-SU1-03A/B 22-SU0-03A/B	2	WALL MOUNTED	13643 / 19439	24000	30/(30% TO 60%)	50	230/1/50 400/3/50	CAPACITOR BANK

** NOMINAL CAPACITY SHOULD BE RECHECKED AND SPECIFIED BY VENDOR.

1 HVAC SYSTEM LAYOUT

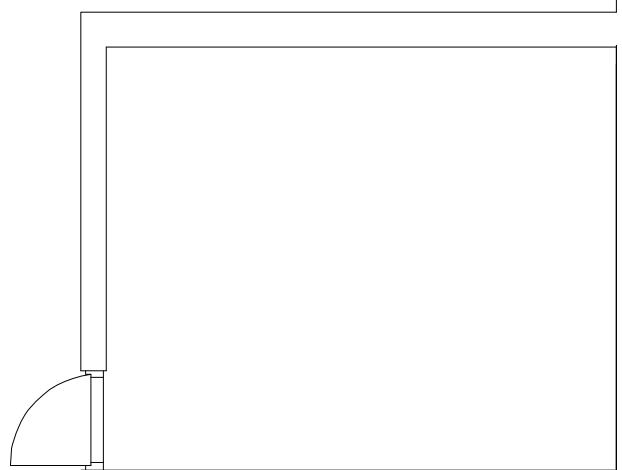

SPACE TAG NUMBER

- 100 CAPACITOR BANK
- 101 CO2 ROOM
- 102 TRANSFORMER ROOM
- 103 FIRE-FIGHTING PUMP TRANSFORMER ROOM

[illegible]