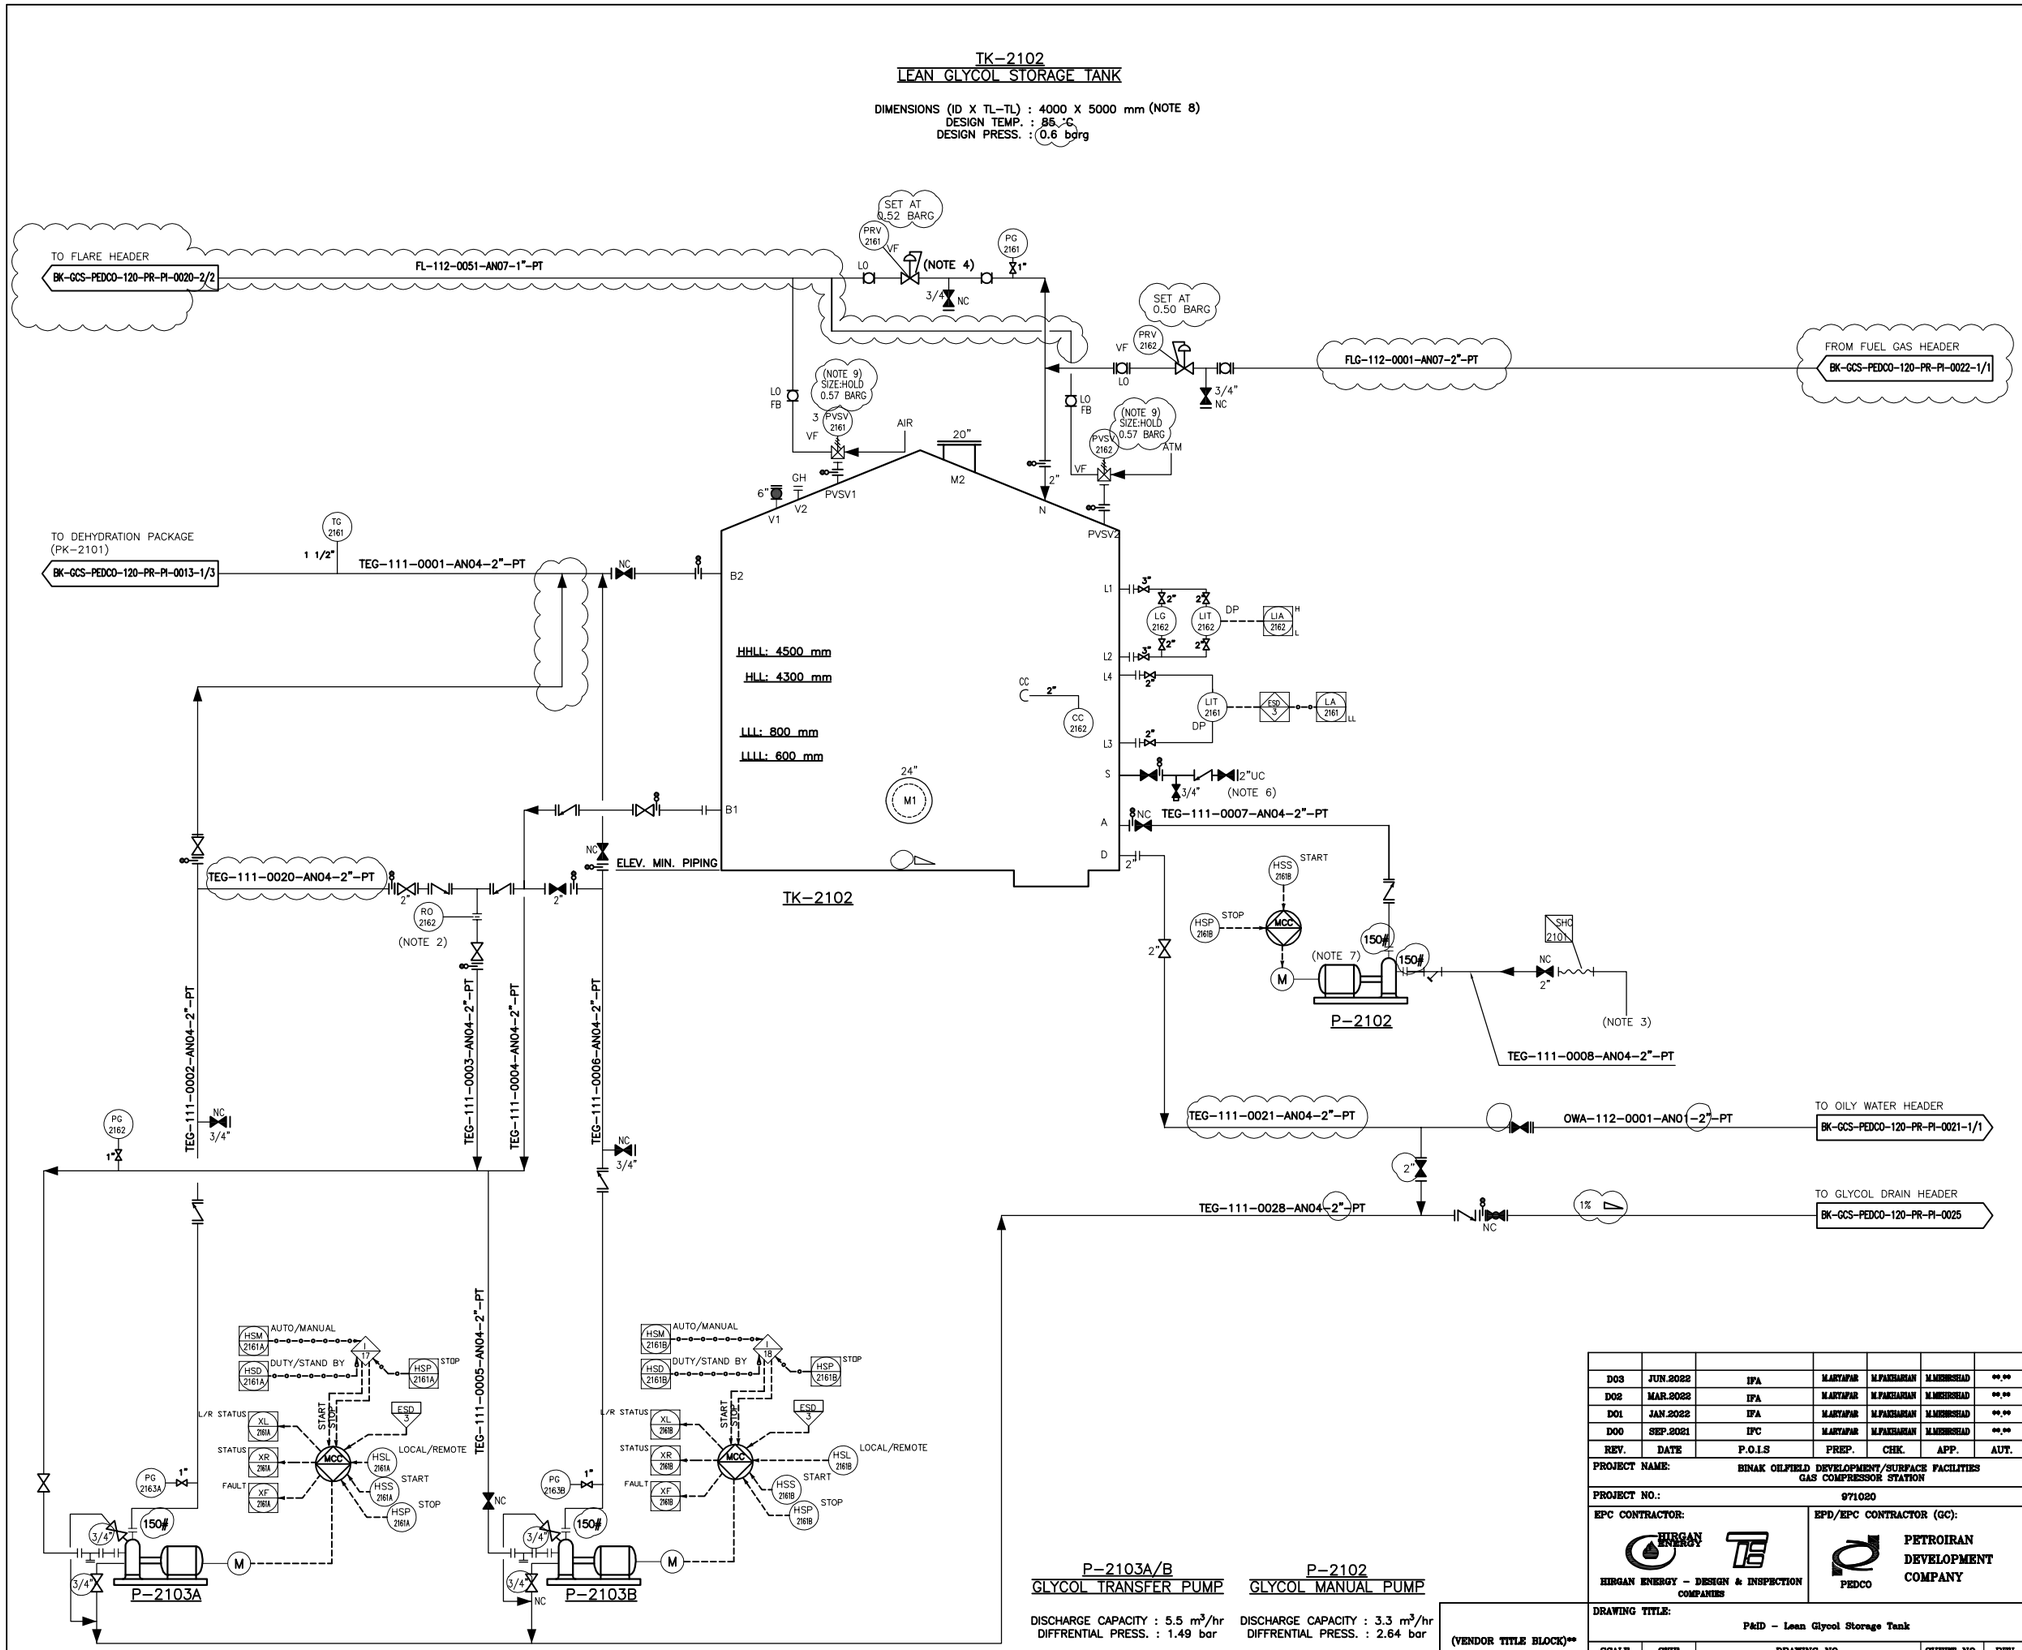

NOTES

1- DELETED.
2- MIN. FLOW RECYCLE.
3- BARREL DIP PIPE FOR LOADING OF FRESH GLYCOL.
4- GAS-BLANKETING SYSTEM WAS SIZED FOR WORST CASE OF PUMPING IN/OUT OF TANK.
5- DRAIN DURING TANK MAINTENANCE.
6- PURGE CONNECTION.
7- TEG MANUAL PUMP FOR GLYCOL LOADING.
8- TANK DIMENSION WILL BE FINALIZED AFTER RECEIVING DEHYDRATION PACKAGE VENDOR DATA.
9- NUMBERING AND SIZE ARE HOLD FOR PVSV VENDOR INFORMATION.

LEGEND

REFERENCE DRAWING	DRG. No.
Process Flow Diagram	BK-GCS-PEDCO-120-PR-PF-0001
Symbol & Legend For PFD and P&ID	BK-GCS-PEDCO-120-PR-PI-0001

KEY PLAN

REV.	DATE	P.O.I.S	PREP.	CHK.	APP.	AUT.
D03	JUN.2022	IFA	M.ARYAFAR	M.PAKSHAHAN	M.MEHRSHAD	**.**
D02	MAR.2022	IFA	M.ARYAFAR	M.PAKSHAHAN	M.MEHRSHAD	**.**
D01	JAN.2022	IFA	M.ARYAFAR	M.PAKSHAHAN	M.MEHRSHAD	**.**
D00	SEP.2021	IFC	M.ARYAFAR	M.PAKSHAHAN	M.MEHRSHAD	**.**

REV.	DESCRIPTION	CHECKED BY	CHECKED DATE	REV. APPR. BY	REV. APPR. DATE
***	**********	**.**	***.****	**.**	***.****

PROJECT NAME: BINAK OILFIELD DEVELOPMENT/SURFACE FACILITIES GAS COMPRESSOR STATION

PROJECT NO.: 971020

EPC CONTRACTOR: HIRGAN ENERGY – DESIGN & INSPECTION COMPANIES

EPD/EPC CONTRACTOR (GC): PETROIRAN DEVELOPMENT COMPANY (PEDCO)

اصل و کلیه نسخ این نقشه و حق اقتباس متعلق به شرکت ملی مناطق نفت خیز جنوب میباشد
THE ORIGINAL AND ALL COPIES OF THIS DRAWING TOGETHER WITH THE COPYRIGHT THEREIN ARE THE SOLE PROPERTY OF N.I.S.O.C./ FIELDS

BINAK OILFIELD DEVELOPMENT
SURFACE FACILITIES
GAS COMPRESSOR STATION

DATE	SCALE	DRAWING BY	CHECKED BY	PROJECT ENG.

NO CONSTRUCTION PERMITTED UNLESS DRAWING APPROVED

APPROVED FOR CONSTRUCTION BY: DATE:

(VENDOR TITLE BLOCK)**

DRAWING TITLE: P&ID – Lean Glycol Storage Tank

SCALE	SIZE	DRAWING NO.	SHEET NO.	REV.
NS	A3	BK-GCS-PEDCO-120-PR-PI-0014	1 OF 1	D03

BUDGET REF.	LOCATION	SIZE	CLASS	SERIAL NO.	SHEET	REVISION
053-073-9184	F	2	A	708792	1 OF 1	D03