



PROCESS CCTV EQUIPMENT LAYOUT

FOR GCS AREA



NOTES

LEGEND

REFERENCE DRAWING

DRG. No.

								***	*****	** **	*** ****	** **	*** ****						
D01	JUNE.2022	IFA	H.SHAKIBA	M.PAKHARIAN	M.MEHRSHAD	** **	REV.	DESCRIPTION	BY	DATE	BY	DATE							
D00	APR.2022	IPC	H.SHAKIBA	M.PAKHARIAN	M.MEHRSHAD	** **				CHECKED		REV.	APPR.						
REV.	DATE	P.O.I.S	PREP.	CHK.	APP.	AUT.													
PROJECT NAME:						BINAK OILFIELD DEVELOPMENT/SURFACE FACILITIES GAS COMPRESSOR STATION													
PROJECT NO.:						971020													
EPC CONTRACTOR:			EPD/EPC CONTRACTOR (GC):			 THE ORIGINAL AND ALL COPIES OF THIS DRAWING TOGETHER WITH THE COPYRIGHT THEREIN ARE THE SOLE PROPERTY OF N.I.S.O.C./ FIELDS													
 HIRGAN ENERGY - DESIGN & INSPECTION COMPANIES			 PETROIRAN DEVELOPMENT COMPANY																
DATE		SCALE		DRAWING BY												CHECKED BY		PROJECT ENG.	
DRAWING TITLE:						NO CONSTRUCTION PERMITTED UNLESS DRAWING APPROVED													
PROCESS CCTV EQUIPMENT LAYOUT FOR GCS AREA						APPROVED FOR CONSTRUCTION				BY:		DATE:							
SCALE	SIZE	DRAWING NO.			SHEET NO.	REV.	BUDGET REF.	LOCATION	SIZE	CLASS	SERIAL NO.	SHEET	REVISION						
1:100	A0	BK-GCS-PEDCO-120-IN-PY-0007			01 OF 02	D01	053-073-9184	F	2	J	708964	1 OF 2	D01						

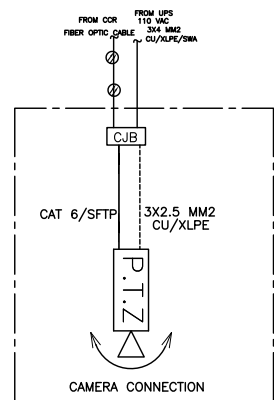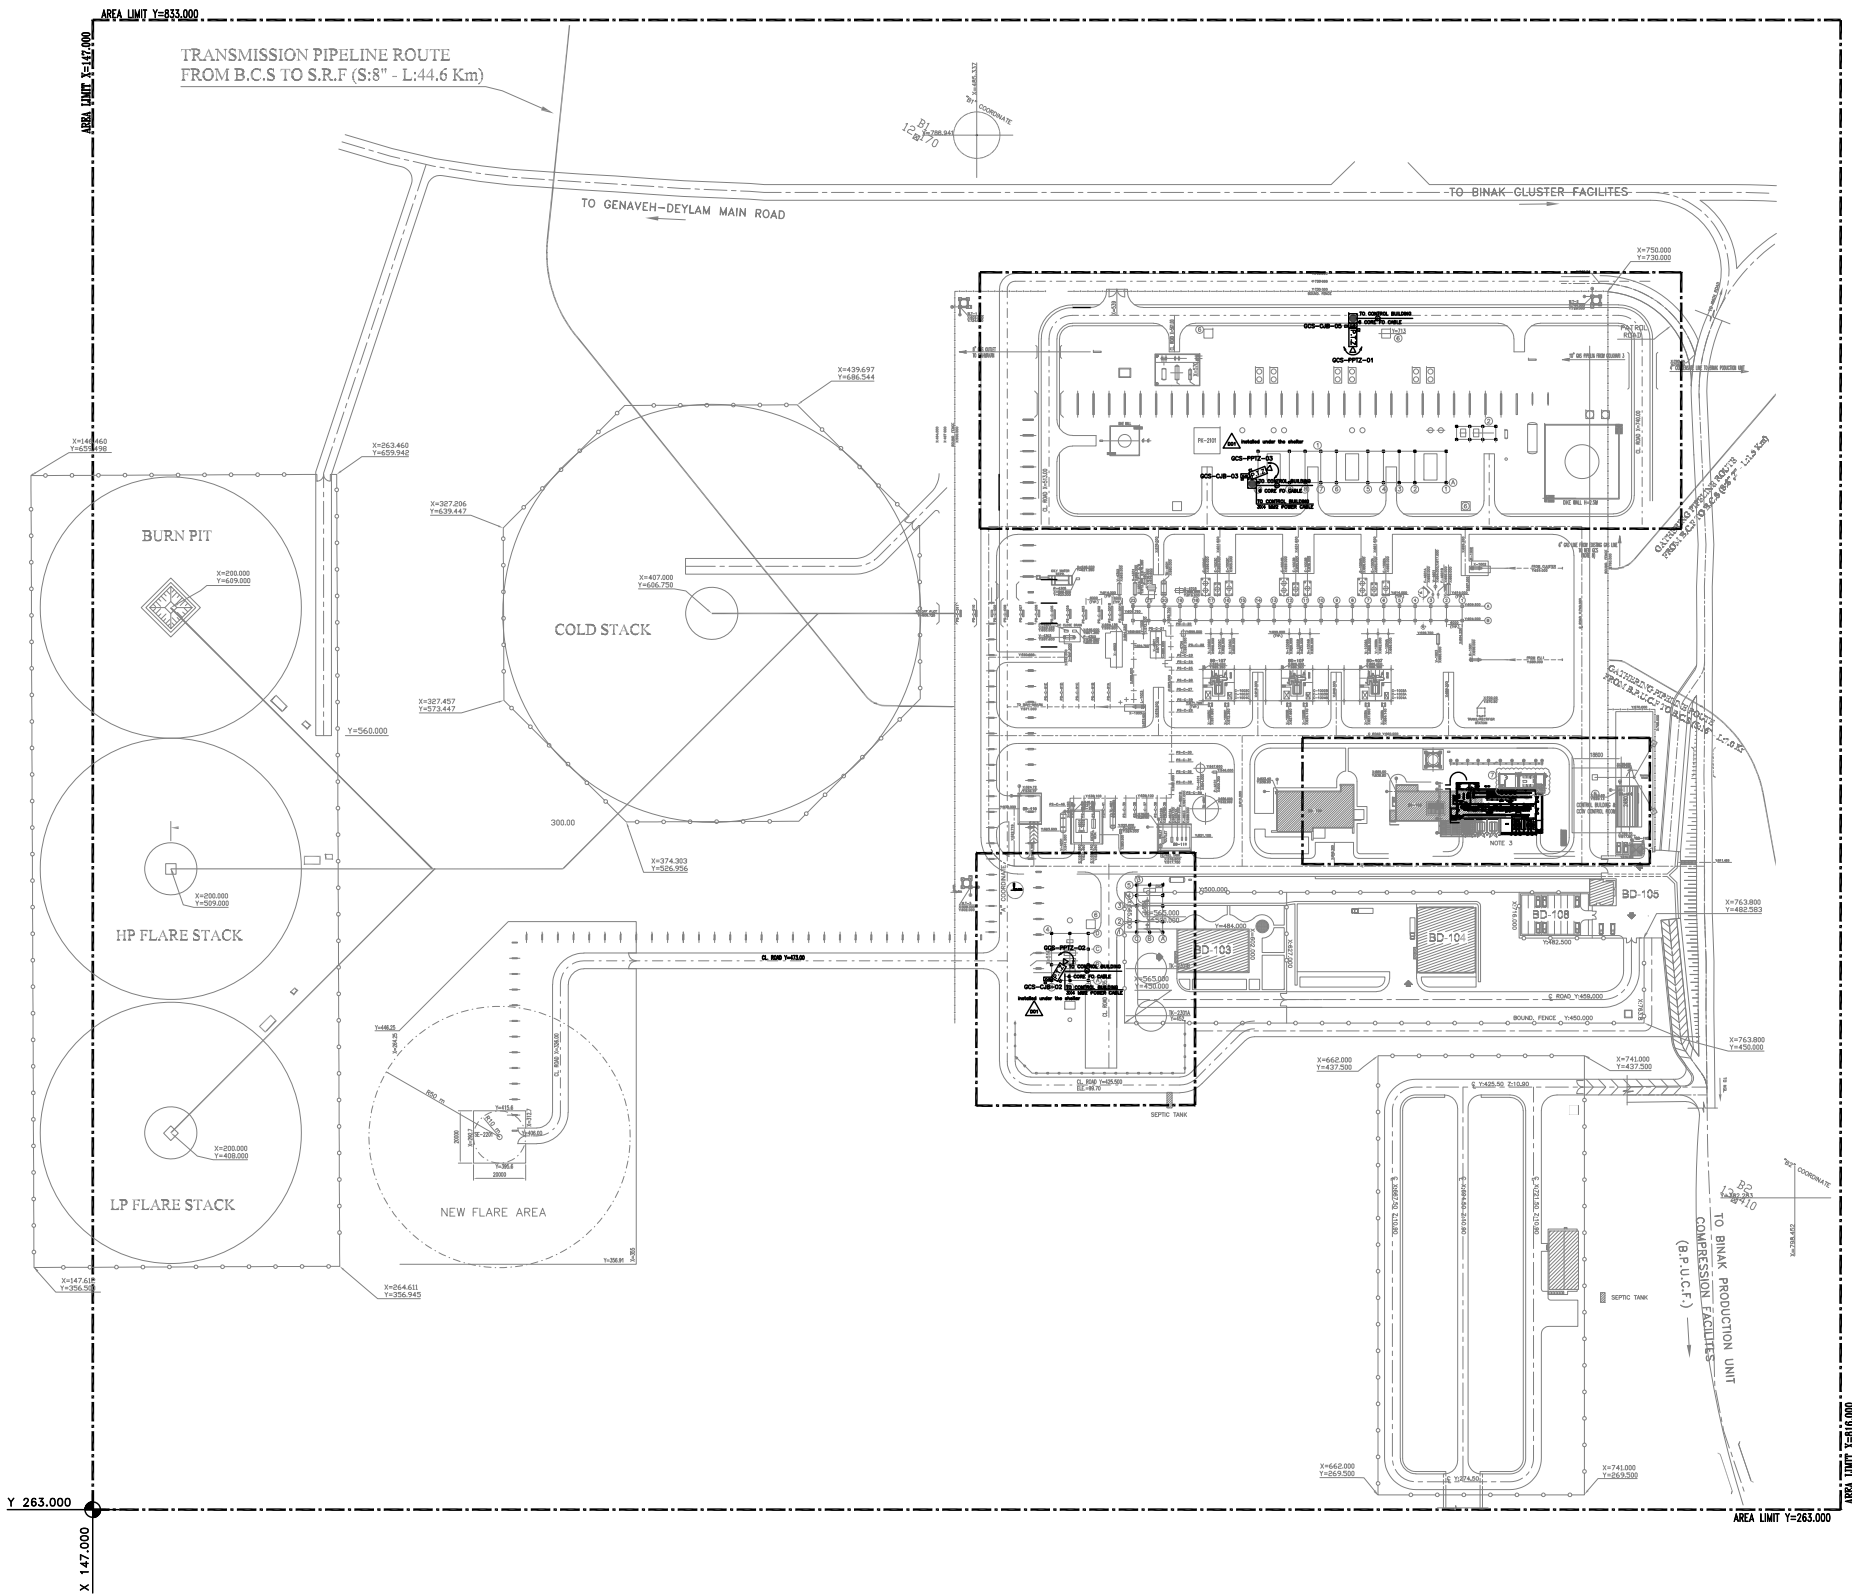

			
MATERIAL TAKE OFF			
NO.	UNIT	Q'TY	DESCRIPTION
 EX	EA	3	OUTDOOR EX 4 P P.T.Z CAMERA BRACKET MOUNTING ON POLE WITH NETWORK CONNECTION, IP65 WASHER/PIPER, HEATER / FAN AND IN-BUILT
 EX	EA	3	OUTDOOR EX CCTV JUNCTION BOX WITH 1FIBER CASSITE, IP65 AND 10X2.5 MMS-12V TERMINALS AND 300X4 10X25 METAL GROUND, INDUSTRIAL 240V 200MMT PSU 1 KVA ARRESTER, 1K POWER ARRESTER, 1K PCE 2 PORES ETH SWICH WITH 12 SFP 1G PORT

[illegible]