
	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان: 053 - 073 - 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 1 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

## طرح نگهداشت و افزایش تولید 27 مخزن

### PROCESS BASIS OF DESIGN


D07	AUG. 2022	IFA	M.Aryafar	M.Fakharian	M.Mehrshad	
D06	JUL. 2022	IFA	M.Aryafar	M.Fakharian	M.Mehrshad	
D05	MAY. 2022	IFA	M.Aryafar	M.Fakharian	M.Mehrshad	
D04	MAR. 2022	IFA	M.Aryafar	M.Fakharian	M.Mehrshad	
D03	JAN. 2022	IFA	M.Aryafar	M.Fakharian	M.Mehrshad	
D02	NOV. 2021	IFA	M.Aryafar	M.Fakharian	M.Mehrshad	
D01	OCT. 2021	IFA	M.Aryafar	M.Fakharian	Sh.Ghalikar	
D00	JUL. 2021	IFC	M.Asgharnejad	M.Fakharian	Sh.Ghalikar	
Rev.	Date	Purpose of Issue/Status	Prepared by:	Checked by:	Approved by:	CLIENT Approval

Class: 2

CLIENT Doc. Number: F0Z-707119

#### Status:



IDC: Inter-Discipline Check  
 IFC: Issued For Comment  
 IFA: Issued For Approval  
 AFD: Approved For Design  
 AFC: Approved For Construction  
 AFP: Approved For Purchase  
 AFQ: Approved For Quotation  
 IFI: Issued For Information  
 AB-R: As-Built for CLIENT Review  
 AB-A: As-Built –Approved

 <b>NISOC</b>	<p>نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان: 053 - 073 - 9184	<b>PROCESS BASIS OF DESIGN</b>								شماره صفحه : 2 از 24
	پروژه BK	بسته کاری GNRAL	صادر کننده PEDCO	تسهیلات 000	رشته PR	نوع مدرک DB	سریال 0001	نسخه D07	

### REVISION RECORD SHEET





PAGE	D00	D01	D02	D03	D04	D05	D06	D07
1	X	X	X	X	X	X	X	X
2	X	X	X	X	X	X	X	X
3	X							
4	X	X	X					
5	X	X	X	X				
6	X	X	X					X
7	X		X					
8	X	X	X	X	X	X	X	
9	X	X	X	X				
10	X	X	X	X	X	X	X	
11	X	X	X				X	
12	X	X	X	X	X			X
13	X	X	X					
14	X	X	X					
15	X	X	X	X	X			
16	X	X	X	X				
17	X	X	X	X	X			
18	X	X	X		X			
19	X	X	X	X				
20	X			X				
21	X			X				
22	X			X				
23	X							
24	X							
25	X							
26	X							
27								
28								
29								
30								
31								
32								
33								
34								
35								
36								
37								
38								
39								
40								
41								
42								
43								
44								
45								
46								
47								
48								
49								
50								
51								
52								
53								
54								
55								
56								
57								
58								
59								
60								
61								
62								
63								
64								
65								

PAGE	D00	D01	D02	D03	D04	D05	D06	D07
66								
67								
68								
69								
70								
71								
72								
73								
74								
75								
76								
77								
78								
79								
80								
81								
82								
83								
84								
85								
86								
87								
88								
89								
90								
91								
92								
93								
94								
95								
96								
97								
98								
99								
100								
101								
102								
103								
104								
105								
106								
107								
108								
109								
110								
111								
112								
113								
114								
115								
116								
117								
118								
119								
120								
121								
122								
123								
124								
125								
126								
127								
128								
129								
130								

	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان:  053 – 073 – 9184	PROCESS BASIS OF DESIGN							شماره صفحه : 3 از 24	
	پروژه	بسته کاری	صادرکننده	تسهیلات	رشته	نوع مدرک	سریال		نسخه
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

## CONTENTS

<b>1.0</b>	<b>INTRODUCTION .....</b>	<b>4</b>
<b>2.0</b>	<b>SCOPE .....</b>	<b>5</b>
<b>3.0</b>	<b>NORMATIVE REFERENCES.....</b>	<b>6</b>
3.1	LOCAL CODES AND STANDARDS.....	6
3.2	INTERNATIONAL CODES AND STANDARDS .....	7
3.3	THE PROJECT DOCUMENTS.....	7
3.4	ENVIRONMENTAL DATA .....	7
3.5	ABBREVIATIONS .....	7
<b>4.0</b>	<b>PROCESS DESIGN BASIS .....</b>	<b>8</b>
<b>5.0</b>	<b>FEED CHARACTERISTICS.....</b>	<b>9</b>
5.1	COMPRESSOR STATION FEED CHARACTERISTICS .....	9
5.2	GAS & CONDENSATE PIPELINE STUDY .....	9
5.3	FLOWLINES AND WELLHEAD FACILITIES .....	10
5.4	WELLHEAD OPERATING CONDITION .....	11
6.1	COMPRESSORS .....	12
6.2	COMPRESSED AND INSTRUMENT AIR .....	12
6.3	NITROGEN .....	13
6.4	FUEL OIL.....	14
6.5	FUEL GAS.....	15
6.6	ELECTRIC POWER .....	15
6.7	WATER .....	15
6.8	FLARE NETWORK.....	16
6.9	WATER.....	17
6.10	FUEL OIL.....	17
<b>7.0</b>	<b>SITE CONDITION.....</b>	<b>17</b>
7.1	SITE LOCATION.....	17
7.2	GEOTECHNICAL DATA.....	19
7.3	BAROMETRIC PRESSURE.....	19
7.4	ELEVATION .....	19
7.5	SOILS CONDITIONS.....	19
7.6	SOLAR RADIATION .....	20
7.7	AMBIENT CONDITIONS .....	20
7.8	RELATIVE HUMIDITY.....	20
7.9	RAINFALL .....	21
7.10	WIND CONDITIONS.....	21
7.11	LIGHTNING STORMS .....	22
7.12	AVERAGE LIGHTNING FLASH DENSITY .....	22
<b>8.0</b>	<b>GENERAL MATTERS.....</b>	<b>23</b>
8.1	UNITS OF MEASUREMENT .....	23
8.2	SERVICE LIFE.....	23
8.3	TURNDOWN AND OVERDESIGN .....	24
<b>9.0</b>	<b>LIST OF ENGINEERING SOFTWARES .....</b>	<b>24</b>

 NISOC	<p>نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض و ابنیه تحت الارض عمومی و مشترک</p>								 شرکت توسعه و پارس  
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 4 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

## 1.0 INTRODUCTION


Binak oilfield in Bushehr province is a part of the southern oilfields of Iran, is located 25 km northwest of Genaveh city.

With the aim of increasing production of oil from Binak oilfield, an EPC/EPD Project has been defined by NIOC/NISOC and awarded to Petro Iran Development Company (PEDCO). Also PEDCO (as General Contractor) has assigned the EPC-packages of the Project to "Hirgan Energy - Design and Inspection" JV.

### GENERAL DEFINITION

The following terms shall be used in this document.

CLIENT:	National Iranian South Oilfields Company (NISOC)
PROJECT:	Binak Oilfield Development – General Facilities
EPD/EPC CONTRACTOR (GC):	Petro Iran Development Company (PEDCO)
EPC CONTRACTOR:	Joint Venture of : Hirgan Energy – Design & Inspection(D&I) Companies
VENDOR:	The firm or person who will fabricate the equipment or material.
EXECUTOR:	Executor is the party which carries out all or part of construction and/or commissioning for the project.
THIRD PARTY INSPECTOR (TPI):	The firm appointed by EPD/EPC CONTRACTOR (GC) and approved by CLIENT (in writing) for the inspection of goods.
SHALL:	Is used where a provision is mandatory.
SHOULD:	Is used where a provision is advisory only.
WILL:	Is normally used in connection with the action by CLIENT rather than by an EPC/EPD CONTRACTOR, supplier or VENDOR.
MAY:	Is used where a provision is completely discretionary.

	نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض و ابنیه تحت الارض عمومی و مشترک								
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 5 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

## 2.0 SCOPE

### Sub-Surface

#### ➤ New Wells & Manifold Extension:

With the aim of increasing the oil production rate from BINAK field, the construction of flow lines and wellhead facilities has been on the agenda. Therefore, National Iranian South Oil Company has intends to establish the project of "Construction of flow lines and wellhead Facilities for BINAK Oil Field."

The most important activities and facilities needed for the project are as follows:

- Construction of 6 wells with 6 wellhead facilities series (class 5000 for wellhead facilities & class 3000 for flow lines)
- Construction of 6 flow lines with construction and installation of supports with all necessary facilities for pipelines and connecting lines to the manifold in BINAK Cluster unit.
- Design, Construction & Extension of existing manifold for connecting new 8 flow lines (which 2 connections will be considered for future) .As mentioned flow line of the six new wells connected to the header A/B on existing manifold(expands if needed) whit new connection and oil from existing oil sump send to header A/B of manifold via oil sump pump (P-1701),also considered two new flow line connection for new.

#### ➤ Workover wells (with electric power supply):

Electrification for Wells in Binak Oil fields including 2 parts:

- Construction of 5 outdoor substations 11/0.42 KV & 1 outdoor substation 33/0.42 KV.

In this regard, engineering, procurement & installation of power transformers, diesel generators, LV switchgear, UPS, lighting & ... are in contractor scope of work.

- Routing, detail design, procurement & construction of electrical transmission lines.

### Surface

#### ➤ New Compressor Station:

This document defines process design basis for Binak Compressor Station to process sour gas from Golkhari booster/cluster and Binak production unit with cumulative rate of 15 MMSCFD. The new compressors will be added "new" section of existing Binak compressor station plant. Excluding electrical power, which is supplied from existing facilities, all required utilities should be designed as part of project.

	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان:  053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 6 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

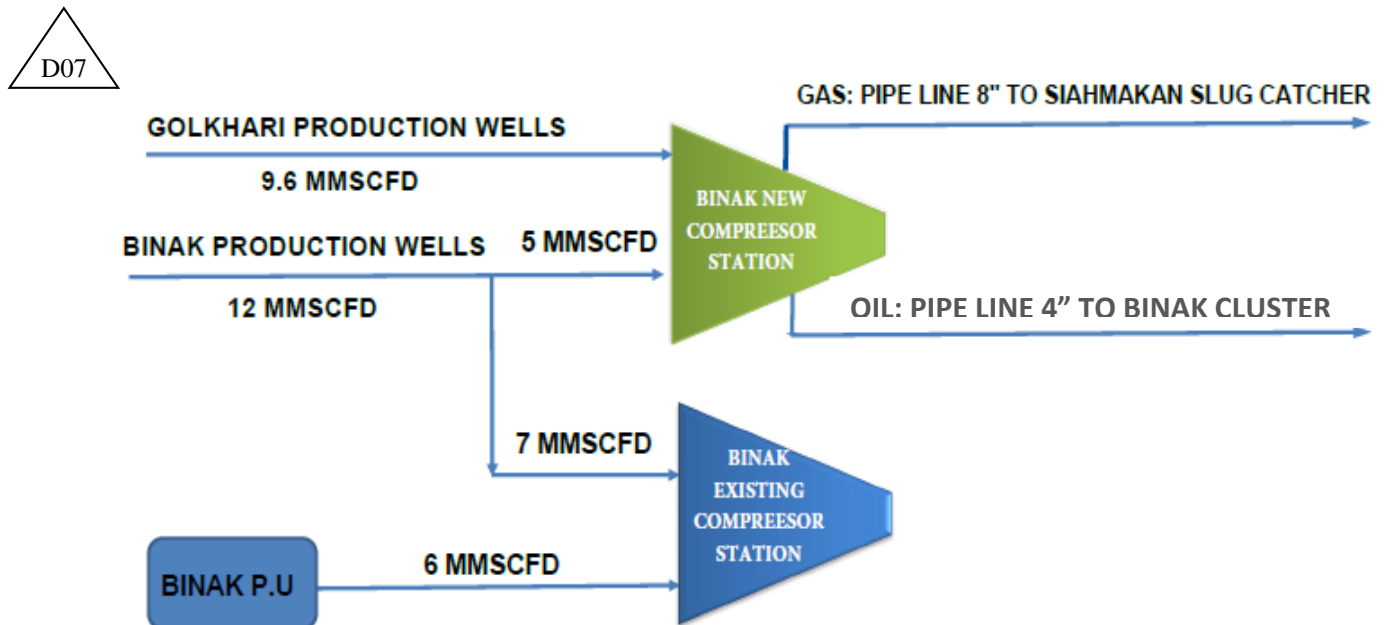


Figure No.1: Overall Block Diagram in Binak Compressor Station Area

#### ➤ Pipeline 8" & 4":



With the aim of increasing the oil production rate from BINAK field, the construction of 8 inch gas transmission pipeline from new BINAK Compressor Station to SIAHMAKAN Gas Injection Station and 4 inch gas condensate transmission pipeline from new BINAK Compressor Station to BINAK Cluster, has been on the agenda.

### 3.0 NORMATIVE REFERENCES

#### 3.1 LOCAL CODES AND STANDARDS

In design of this plant all of the IPS standard relevant to process must be considered, some of them which are more compatible to this project are listed below.

- |   |                |
|---|----------------|
| • Engineering Standard for Process Flow Diagram                               | IPS-E- PM-100  |
| • Engineering Standard for General Design Requirements of Process Machineries | IPS-E- PR- 170 |
| • Basic Design Package and Recommended Practice for Feasibility Studies       | IPS-E- PR-150  |
| • Engineering Standard for Basic Engineering Design Data                      | IPS-E-PR- 200  |

	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 7 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

- Engineering Standard for Piping & Instrumentation Diagrams IPS-E-PR- 230
- Engineering Standard for Process Design of Liquid & Gas Transfer & Storage IPS-E-PR- 360
- Engineering Standard for Process Design of Piping Systems (Process Piping and Pipeline Sizing) IPS-E-PR- 440
- Engineering Standard for Process Design of Pressure Relieving Systems Inclusive Safety Relief Valves IPS-E-PR- 450
- General Standard For Towers, Reactors, Pressure Vessels And Internals IPS-G-ME- 150

### 3.2 INTERNATIONAL CODES AND STANDARDS

11	ANSI	American National Standards Institute
12	API	American Petroleum Institute
13	ASME	American Society of Mechanical Engineers
14	ISA	Instrument Society of America
15	ISO	International Standards Organization
16	NACE	National Association of Corrosion Engineers
17	NFPA	National Fire Protection Association
18	OSHA	Occupational Safety and Health Act

### 3.3 THE PROJECT DOCUMENTS

The provided data of this document, such as summer and winter feed composition of GCS and 6 wellhead facilities series, Extension of existing manifold and Construction of two new pipelines are based on unit specifications which are given by client.

### 3.4 ENVIRONMENTAL DATA

Refer to "Process Basis of Design; section 7".

### 3.5 ABBREVIATIONS

NISOC:	National Iranian South Oil Company
PEDCO	Petro Iran Development Company
PFD	Process Flow Diagram
P&ID	Piping and Instrumentation Diagram
KOM	Kick off Meeting

 NISOC	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان:  053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 8 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

MMSCFD      Million Standard Cubic Feet per Day  
BBL            Barrel  
SBLPD        Standard Barrel per Day  
DP             Differential Pressure

#### 4.0 PROCESS DESIGN BASIS

A new Binak compressor station with working (design) capacity of 15 MMSCFD with TEG dehydration package should be added into existing Binak compressor station facilities to increase feed gas pressure from 5.5 Barg to 54.8 Barg .In order to maximize flexibility of new compressor station, 2 +1 arrangement (2 in operation and 1 as standby) is considered for the system. Moreover:

- Flare system with smokeless facilities
- Instrument air and plant air facilities to cover demand of process

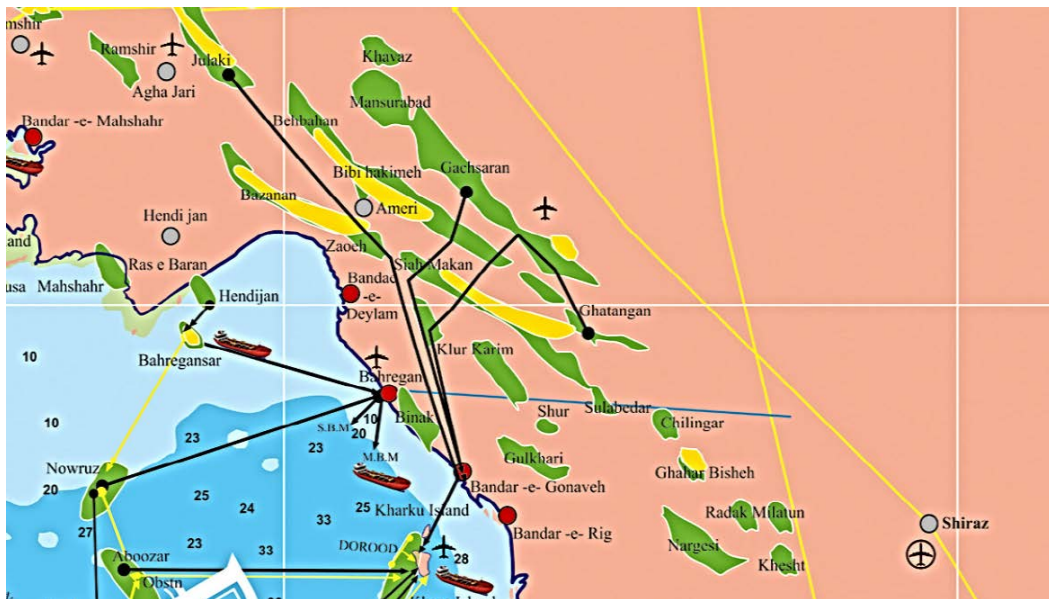



Figure No.2: Relative Location of Binak Oil Reservoir in South West of Iran

- Fire water system should be considered within design package.
- Nitrogen for tank blanketing, compressors sealing.
- Corrosion inhibitor package
- Fuel gas system
- Diesel Fuel Storage and pumping system
- Open & Closed Drain System
- Service Water System
- Oil water sump



	<p>نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض و ابنیه تحت الارض عمومی و مشترک</p>								
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 9 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

- Waste Water collection pit
  - Electrical Power System
- and all required utility and off-site should be considered for safe operation of new compressor station.

## 5.0 FEED CHARACTERISTICS

### 5.1 COMPRESSOR STATION FEED CHARACTERISTICS

Table No.5-1.1 indicates feed Properties for use in design of compressor station:


**Table No.5-1.1: Binak Compressor Station Feed Composition (dry basis)**

Components	GOLKHARI		Binak	
	(Mol. %) in Summer	(Mol. %) in Winter	(Mol. %) in Summer	(Mol. %) in Winter
CO <sub>2</sub>	3.030	2.970	3.510	3.630
H <sub>2</sub> S	6.821	6.201	2.850	3.140
Methane	67.757	71.887	58.364	62.046
Ethane	11.951	11.231	17.658	17.592
Propane	6.311	5.021	10.719	9.181
i-Butane	0.620	0.430	1.290	0.940
n-Butane	1.310	0.870	2.980	2.030
i-Pentane	0.670	0.400	0.770	0.460
n-Pentane	0.320	0.180	0.500	0.280
n-Hexane	0.580	0.290	0.820	0.400
n-Heptane	0.150	0.070	0.290	0.120
n-Octane	0.050	0.020	0.080	0.030
n-Nonane	0.030	0.010	0.030	0.010
n-Decane	0.010	0.000	0.010	0.000
Nitrogen	0.390	0.420	0.130	0.140
<b>Total</b>	<b>100</b>	<b>100</b>	<b>100</b>	<b>100</b>
<b>Feed Pressure, Barg</b>	<b>5.5</b>	<b>5.5</b>	<b>5.5</b>	<b>5.5</b>
<b>Feed Temperature, °C</b>	<b>32.00</b>	<b>15.5</b>	<b>46.11</b>	<b>26.67</b>

### 5.2 GAS & CONDENSATE PIPELINE STUDY

There are two gas and condensate pipelines to be studied in this document which is described as below table:

**Table No.5-2.1: Gas/Condensate Pipeline Properties**

	<p>نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض و ابنیه تحت الارض عمومی و مشترک</p>								
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 10 از 24
	پروژه BK	بسته کاری GNRAL	صادر کننده PEDCO	تسهیلات 000	رشته PR	نوع مدرک DB	سریال 0001	نسخه D07	

Item	Pipeline	Estimated Diameter (in)	Length (km)	From	To	Destination pressure (Barg)
1	Gas to SIAHMAKAN Gas Injection Station	8"	~44	BINAK Compressor Station	SIAHMAKAN Gas Injection Station	40
2	Gas condensate to BINAK Cluster	4"	~ 1.4	BINAK Compressor Station	BINAK BINAK Cluster	12.8

### 5.3 FLOWLINES AND WELLHEAD FACILITIES

Dry basis composition of the incoming fluid is given in following tables:

**Table No.5-3.1: Asmari and Bangestan Crude Oil Composition**

Reservoir Oil Component	Bangestan (%MOLE )	ASMARI (%MOLE )
H2S	0.32	0.17
Nitrogen	0.06	0.13
CO2	1.77	0.88
Methane	28.14	14.14
Ethane	9.74	5.3
Propane	7.78	6.37
i-Butane	1.47	1.4
n-Butane	4.16	4.51
i-Pentane	1.36	1.26
n-Pentane	1.36	1.19
n-Hexane	5.44	6.77
n-Heptane	6.24	6.13
n-Octane	3.81	3.98
n-Nonane	3.29	5.2
n-Decane	3.07	3.74
n-C11	2.58	3.11
C12+*BANGESTAN	19.31	-
C12+*ASMARI	-	35.72
C12+ of BANGESTAN: Sp.Gr = 0.9312 & Molecular weight = 454		
C12+ of ASMARI: Sp.Gr = 0.9532 & Molecular weight = 418		

The volume percentage of water formed in crude oil is as following table:



	<p>نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض و ابنیه تحت الارض عمومی و مشترک</p>								
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 11 از 24
	پروژه	بسته کاری	صادرکننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

Table No.5-3.2: Water Cut

Crude Oil	Volume Percent (%)
Asmari	0 ~ 15
Bangestan	3 ~ 40

The maximum and minimum amount of oil produced from the Bangestan & Asmari wells is provided in the following table:

Table No.5-3.3: Fluid Properties


WELL NO.	Minimum flow rate for well (bbl/day)	Maximum flow rate for well (bbl/day)
W018S (AS)	500	1500
W008N (AS)	500	1500
W028	1500	2500
W035	1500	2500
W046S	1000	1500
W007S	500	1000
BINK 5	500	1000
BINK 12	500	1000
BINK 14	500	1000
BINK 15	500	1000

## 5.4 WELLHEAD OPERATING CONDITION

Preliminary wellhead information for new oil production wells and flowlines from wellhead to production unit are reported in following table:

Table No.5-4.1: Asmari and Bangestan Wellhead Condition

RESERVOIR	Asmari	Bangestan
Wellhead Pressure (before Choke valve) (Barg)	43.81	43.81
Wellhead Shut-in Pressure (Barg)	193.79	310.34
Wellhead Temperature (before Choke valve) (°C)	75	80

 NISOC	<p>نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 12 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

Note: Pressure at the flow line destination is considered 12.78 Barg

## 6.0 EQUIPMENT DESIGN BASIS

### 6.1 COMPRESSORS

Three reciprocating compressor are considered to increase pressure of 15 MMSCMD of natural gas.

Table No.6-1.1: Binak Compressor Station Condition

BINAK New GCS	
Design Data	BINAK STATION
Gas transport Capacity (MMSCMD)	15.00
No. Of Duty / Stand By Gas Compressor Trains	2+1
Gas Product Outlet Temperature From GCS (°C)	~ 60
Product Dew Point (°C)	5



## UTILITY CONDITIONS OF BINAK NEW GCS

### 6.2 COMPRESSED AND INSTRUMENT AIR



Table No.6-2.1: Operating Conditions at Producer's Battery limit

System	Temperature (°C)			Pressure (bar g)		
	Min	Norm.	Max	Min	Norm.	Max

	<p>نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض و ابنیه تحت الارض عمومی و مشترک</p>								
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 13 از 24
	پروژه BK	بسته کاری GNRAL	صادر کننده PEDCO	تسهیلات 000	رشته PR	نوع مدرک DB	سریال 0001	نسخه D07	

Instrument Air	-	60	65	-	9	-
Plant Air	-	60	65	-	4.5	-

D07

**Table No.6-2.2: Operating Conditions at User's Battery limit**

System	Temperature (°C)			Pressure (bar g)		
	Min	Norm.	Max	Min	Norm.	Max
Instrument Air	-	60	65	4.5	-	8.0
Plant Air	-	60	65	4.5	-	9.0

**Table No.6-2.3: Mechanical Design Conditions**

System	Temperature (°C)	Pressure (bar g)
Instrument Air	85	12.5
Plant Air	85	12.5

### Other Characteristics

Plant air

- Oil and dust free
- Saturated Air



Instrument air

- Dew point at operating pressure: -40°C maximum at 8 barg.
- Oil content : nil
- Max. Particle size : 3μ

### **6.3 NITROGEN**

**Table No.6-3.1: Operating Conditions at Producer's Battery limit**

System	Temperature (°C)			Pressure (bar g)		
	Min	Norm.	Max	Min	Norm.	Max

 NISOC	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان:  053 – 073 – 9184	PROCESS BASIS OF DESIGN							شماره صفحه : 14 از 24	
	پروژه	بسته کاری	صادرکننده	تسهیلات	رشته	نوع مدرک	سریال		نسخه
	BK	GNRAL	PEDCO	000	PR	DB	0001		D07

Nitrogen	-	60	-	-	8	-
----------	---	----	---	---	---	---

**Table No.6-3.2: Operating Conditions at User's Battery limit**

System	Temperature (°C)			Pressure (bar g)		
	Min	Norm.	Max	Min	Norm.	Max
Nitrogen	-	60	-	-	7.5	-

**Table No.6-3.3: Mechanical Design Conditions**

System	Temperature (°C)	Pressure (bar g)
Nitrogen	85	12.5


## 6.4 FUEL OIL

**Table No.6-4.1: Characteristics**

Specification	Unit	Value	Test Method
Specific gravity at 60/60°F	-	0.820-0.860	ASTM D1298
FBP	°C	385 max	ASTM D86
Flash point	°F	130 min	ASTM D93
Sulphur total	%wt	1.0 max	ASTM D129
Viscosity kinematics at 100°F	cS	2.0-5.5	ASTM D445
Cloud point	°F	35 max	ASTM D2500
Pour point	°F	25 max	ASTM D97
Carbon residue (on 10% bottoms)	%wt	0.10 max	ASTM D189
Ash	%wt	0.01 max	ASTM D482
Water & sediment	%vol	0.05 max	ASTM D2709
Diesel index		55 min	ASTM IP21
Cetane index		50 min	ASTM D,976

**Table No.6-4.2: Operating Conditions at User's Battery limit**

System	Temperature (°C)	Pressure (Barg)
--------	------------------	-----------------

	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان:  053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 15 از 24
	پروژه	بسته کاری	صادرکننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

	Min	Norm.	Max	Min	Norm.	Max
Fuel Oil	-	Amb.	-	-	1.5	-

**Table No.6-4.3: Mechanical Design Conditions**

System	Temperature (°C)	Pressure (Barg)
Fuel Oil (V-2206)	85	ATM +FULL OF WATER

## 6.5 FUEL GAS

**Table No.6-5.1: Operating Conditions at Producer's Battery limit**

System	Temperature (°C)			Pressure (bar g)		
	Min	Norm.	Max	Min	Norm.	Max
Fuel Gas	-	48	-	-	4.9	-

**Table No.6-5.2: Operating Conditions at User's Battery limit**

System	Temperature (°C)			Pressure (bar g)		
	Min	Norm.	Max	Min	Norm.	Max
Fuel Gas	-	33~36	-	-	0.5~4.7	-

**Table No.6-5.3: Mechanical Design Conditions**

System	Temperature (°C)	Pressure (Barg)
Fuel Gas (V-2205)	85	9

### Fuel Gas Physical Properties



Fuel gas is supplied from flashed gas in gas separator located in process area. Refer to Process Flow Diagram (PFDs) for Separation (BK-GCS-PEDCO-120-PR-PF-0001-PFD) for more detail for composition and specification of fuel gas.

## 6.6 ELECTRIC POWER

For plant electricity supply and also frequency and voltages levels, refer to Job specification "Electrical Design Criteria".

## 6.7 WATER

**Table No.6-7.1: Operating conditions at producer's battery limit**

	<p>نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض و ابنیه تحت الارض عمومی و مشترک</p>								
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 16 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

System	Temperature (°C)			Pressure (bar g)		
	Min	Norm	Max	Min	Norm.	Max
Plant (Utility)/Potable Water(NOTE)	-	Amb	-	-	0.7	-
Fire water	-	Amb	-	-	11	-

Note: Elevated Tank

Table No.6-7.2: Operating conditions at user's battery limit

System	Temperature(°C)			Pressure (bar g)		
	Min	Norm.	Max	Min	Norm.	Max
Plant (Utility)/Potable Water	-	Amb	-	-	0.5	-
Fire water	-	Amb	-	-	10	-

Table No.6-7.3: Mechanical Design Conditions

System	Temperature (°C)	Pressure (bar g)
Plant (Utility)/Potable Water (TK-2209)	85	Atm+Full Of Water
Fire water (TK-2301 A/B)	85	Atm+Full Of Water

## 6.8 FLARE NETWORK

Table No.6-8.1: Operating Conditions

System	Maximum Back Pressure (barg)
LP Flare Network	*NOTE

Table No.6-8.2: Mechanical Design Conditions



System	Temperature (°C)	Pressure (bar g)
LP Flare Network	150*NOTE	*NOTE

\*NOTE: Maximum back pressure will be finalized after flare network calculation.

\*\*NOTE: Mechanical design temperature will be finalized after flare network calculation.

UTILITY CONDITIONS OF W007S; W046S, BK-05; BK-12; BK-14, BK15



	<p>نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض و ابنیه تحت الارض عمومی و مشترک</p>								
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 17 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

## 6.9 WATER

Table No.6-9.1: Operating conditions

System	Temperature (°C)			Pressure (bar g)		
	Min	Norm	Max	Min	Norm.	Max
Plant (Utility)/Potable Water(NOTE)	-	Amb	-	-	0.4	-

Note: Elevated Tank

Table No.6-9.2: Mechanical Design Conditions

System	Temperature (°C)	Pressure (bar g)
Plant (Utility)/Potable Water	85	Atm+Full Of Water

## 6.10 FUEL OIL

Table No.6-10.1: Operating Conditions

System	Temperature (°C)			Pressure (Barg)		
	Min	Norm.	Max	Min	Norm.	Max
Fuel Oil	-	Amb.	-	-	0.25	-

Table No.6-10.2: Mechanical Design Conditions

System	Temperature (°C)	Pressure (Barg)
Fuel Oil	85	Atm+Full Of Water

## 7.0 SITE CONDITION



### 7.1 SITE LOCATION

Binak oilfield in Bushehr province is a part of the southern oilfields of Iran, is located 25 km northwest of Genaveh city.

Longitude: 50°, 35'

Latitude: 29°, 73'

- GCS UTM COORDINATES:

	<p>نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض و ابنیه تحت الارض عمومی و مشترک</p>								
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 18 از 24
	پروژه	بسته کاری	صادرکننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

**Table No.7-1.1: GCS UTM COORDINATION**

NORTHING	EASTING
3289991.269	437245.830
3289761.280	437704.660

H.P.G and H.P.P. elevation +100.00 correspond to +11.20 M.S.L.

- SIAHMAKAN UTM COORDINATES:

**Table No.7-1.2: SIAHMAKAN UTM COORDINATION**

NORTHING	EASTING
3331743.89	438033.74

- BINAK CLUSTER UTM COORDINATES:



**Table No.7-1.3: BINAK CLUSTER UTM COORDINATES**

NORTHING	EASTING
3290752.321	438636.645

- WELLS COORDINATES

**Table No.7-1.4: WELLS COORDINATES**

WELL NO.	RESERVOIR	UTM COORDINATION	
		NORTHING	EASTING
W-018S	ASMARI	3291914	437440
W-008N	ASMARI	3291837	438713
W-028	BANGESTAN	3293091	437126
W-035	BANGESTAN	3293648	436604
W-046S	BANGESTAN	3294379	435604
W-007S	BANGESTAN	3290543	437425
BK-5	-	3286512	41725
BK-12	-	3288580	440692
BK-14	-	3295176	437805
BK-15	-	3287973	442385

 NISOC	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان:  053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 19 از 24
	پروژه	بسته کاری	صادرکننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

## 7.2 GEOTECHNICAL DATA

According to general geological zoning of Iran, the proposed plant area is located in the coastal zone of Zagros Folded Belt in south-central Fars along the Persian Gulf.

From the lithological point of view the Zagros Folded Belt composed of a sequence of thick bedded sedimentary rocks mainly limestone, dolomite and marl of Paleozoic to Cenozoic age, folded during middle to Late Alpine Organic Stage in Tertiary.

## 7.3 BAROMETRIC PRESSURE

Table No.7-3.1: BAROMETRIC PRESSURE

Barometric pressure	BINAK New GCS	Flow Lines & Wellhead Facilities
Winter (Psia)	14.37	13.7
Summer (Psia)	13.26	13.2

## 7.4 ELEVATION



- Elevation from sea level for BINAK New GCS ~ 12.5 m
- Elevation from sea level for W-018S ~ 33.6 m
- Elevation from sea level for W-008N ~ 76.0 m
- Elevation from sea level for W-028 ~ 33.2 m
- Elevation from sea level for W-035 ~ 30.1 m
- Elevation from sea level for W-046S ~ 57.9 m
- Elevation from sea level for W-007S ~ 26.2 m
- Elevation from sea level for BK-5 ~ 50.0 m
- Elevation from sea level for BK-12 ~ 69.0 m
- Elevation from sea level for BK-14 ~ 190.0 m
- Elevation from sea level for BK-15 ~ 125.0 m

## 7.5 SOILS CONDITIONS

### BINAK New GCS:

The basic data required are as follows:

- Seismic Zone : 0.3 g
- Soil Temp. in Winter : 15.6°C
- Soil Temp. in Summer: 32.2°C

 NISOC	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان:  053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 20 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

#### Flow Lines & Wellhead Facilities:

- Seismic Zone : 0.3 g

### 7.6 SOLAR RADIATION

#### BINAK New GCS:

- Solar radiation (maximum): 1010 W /m2

#### Flow Lines & Wellhead Facilities:

- Solar radiation: 946 W /m2

### 7.7 AMBIENT CONDITIONS

Table No.7-7.1: Ambient Conditions

LOCATION	BINAK New GCS	Flow Lines & Wellhead Facilities
Maximum ambient temperature (°C)	50	50
Minimum ambient temperature (°C)	5	-5
Maximum steel surface exposed to sun (°C)	85	85
Maximum summer dry bulb (°C)	50	-
DB/RH for Summer HVAC Design	41 °C / 61 % (Note */ Note**)	
DB FOR Winter HVAC Design	6 °C Note *	



\* Refer to " HVAC Design Criteria; N.I.O.C. NO.: F-1-B-422001".

\* \*Refer to "NISOC Meteorological Studies Report".

### 7.8 RELATIVE HUMIDITY

#### BINAK New GCS & Flow Lines & Wellhead Facilities:

- Maximum Design relative humidity (%): 100
- Minimum Design relative humidity (%): 0

 NISOC	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان:  053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 21 از 24
	پروژه	بسته کاری	صادرکننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

## 7.9 RAINFALL

### BINAK New GCS:

- Maximum rainfall during one hour: 53 mm

**Table No.7-9.1: BINAK New GCS RAINFALL**

Month	Average Monthly (mm)
January	83.5
February	37.2
March	45.0
April	18.2
May	5.6
June	0.7
July	0.0
August	0.4
September	0.2
October	3.4
November	57.5
December	81.2
Annual	332.9

### Flow Lines & Wellhead Facilities:

- Maximum rainfall during one year: 487.5 mm
- Maximum rainfall during one day: 138 mm



## 7.10 WIND CONDITIONS

### BINAK New GCS:

Design velocity and direction of prevailing wind:

Wind velocity at 10m above ground level for:

- |  |          |
|--|----------|
| - Structure calculation:                 | 120 Km/h |
| - Wind velocity for thermal calculations | 5 m/s    |
| - Prevailing wind direction:             | NW to SE |
| - Flare thermal radiation                | 10 m/s   |

 NISOC	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان:  053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 22 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

#### Flow Lines & Wellhead Facilities:

- Structure calculation: 120 Km/h

### 7.11 LIGHTNING STORMS

#### BINAK New GCS:

Isoceraunic Level 15 storm-day/year. The EPC Contractor shall inquiry and verifies these data from the related authorities.

### 7.12 AVERAGE LIGHTNING FLASH DENSITY

#### Flow Lines & Wellhead Facilities:

According to below map, 10-15 thunderstorm days per year exist in BINAK field. Average lightning flash density ( $N_g$ ) may be estimated from following relationship:


$$N_g = 0.04(T_d)^{1.25}$$



$$T_d = 15$$

$$N_g = 0.04(15)^{1.25} = 1.18$$

$N_d$  = yearly lightning strike frequency to the structure or object

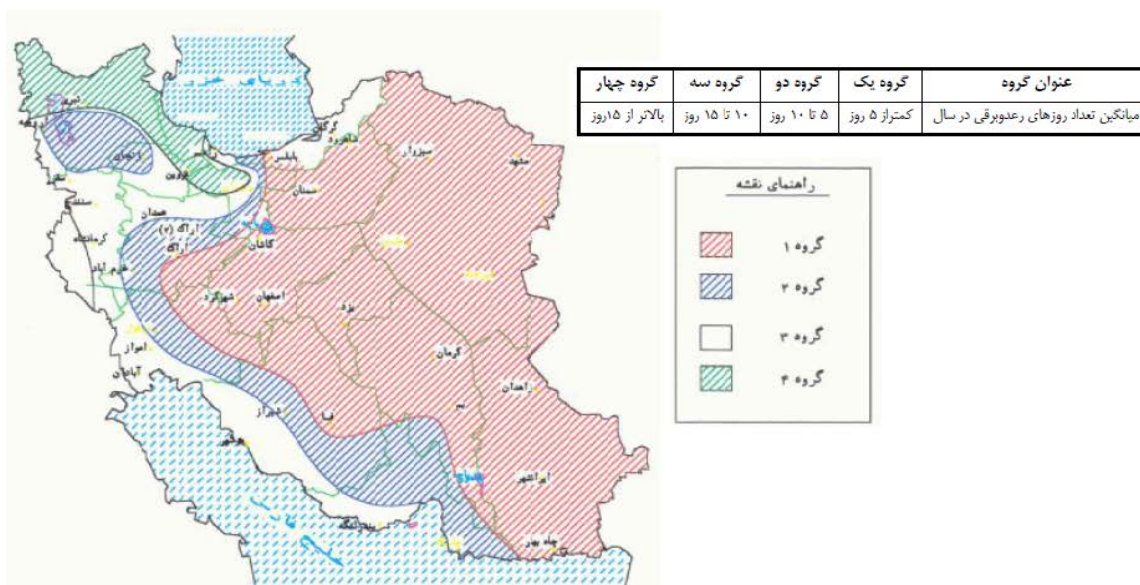$N_g$  = lightning ground flash density in flashes/km<sup>2</sup>/year



 NISOC	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنيه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان: 053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 23 از 24
	پروژه	بسته کاری	صادر کننده	تسهيلات	رشته	نوع مدرک	سريال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

## 8.0 GENERAL MATTERS



### 8.1 UNITS OF MEASUREMENT

As a general rule, the SI metric system of units shall be used and particularly:

- Pressure (gauge) Barg
- Pressure (absolute) Bara
- Mass kg
- Temperature °C
- Length m & mm except the pipes diameter for which "inches" are allowed
- Liquid relative density sp. gr. T °C /15°C
- Liquid absolute density kg/cm<sup>3</sup> at 15°C
- Vapour flowing density kg/cm<sup>3</sup>
- Mass kg/h
- Liquid m<sup>3</sup>/h, l/min for fire fighting
- Normal conditions :  
Vapour Nm<sup>3</sup> (m<sup>3</sup> at 0°C & 1.013 bar a) or Sm<sup>3</sup> vapour (at 15°C & 1.013 bar a)  
Liquid Std m<sup>3</sup> (m<sup>3</sup> at 15°C)
- Specific enthalpy kj/kg
- Heat rate MW
- Gross calorific value kj/kg
- Viscosity (Dynamic) cp
- In addition to the above units, the following units shall be used for material balance purposes:
- Vapour flow rate MMSCFD Million Standard cubic feet per day (at 15°C and 1.013 Bara).
- Liquid flow rate SBLPD or SBOPD Standard barrel of liquid, or Oil, per day (at 15°C & 1.013 bar a).
- Absolute press=gauge press + barometric pressure.
- Gas Volumetric flow rate (standard [m<sup>3</sup>/hr], MMSCFD)
- Liquid volumetric flow rate ([m<sup>3</sup>/hr], STB/D at 15.50 [°C] and 14.70 [psia])

### 8.2 SERVICE LIFE

The design service life of the onshore plant is 25 years. (For Gas Compressor Station) and for other facilities (Transmission Pipelines & Flow lines & Wellhead facilities) shall be designed for a service life of 20 years.

 NISOC	<p>نگهداشت و افزایش تولید میدان نفتی بینک</p> <p>سطح الارض و ابنیه تحت الارض</p> <p>عمومی و مشترک</p>								
شماره پیمان:  053 – 073 – 9184	PROCESS BASIS OF DESIGN								شماره صفحه : 24 از 24
	پروژه	بسته کاری	صادر کننده	تسهیلات	رشته	نوع مدرک	سریال	نسخه	
	BK	GNRAL	PEDCO	000	PR	DB	0001	D07	

### 8.3 TURNDOWN AND OVERDESIGN

Turndown refers to how flexible a compressor is at different operating conditions (flow and pressure). The greater the turndown capability of the compressor unit, the greater the flexibility the compressor unit has to operate under different flow and pressure conditions.

The turn down ratio and over design of compressor station plant is considered to be 40 % and 110% respectively.

## 9.0 LIST OF ENGINEERING SOFTWARES

Following computer programs approved and authorized for use during EPC stage:

Aspen HYSYS (Ver. 7.3 and higher): Plant Thermodynamic Simulation

Aspen Flare System Analyzer: Flare Network Calculation

Honeywell Predict 6.1: Corrosion prediction Tool

Flare sim: Flare Radiation Studies

Olga: Steady State Pipeline Hydraulic Calculation and Surge Analysis

AutoCAD P&ID: Process Drawing (PFD, P&IDs)

DNV Phast: Fire and Explosion Analysis (Consequence Analysis)

HTRI: Heat Exchanger Thermal Calculations