
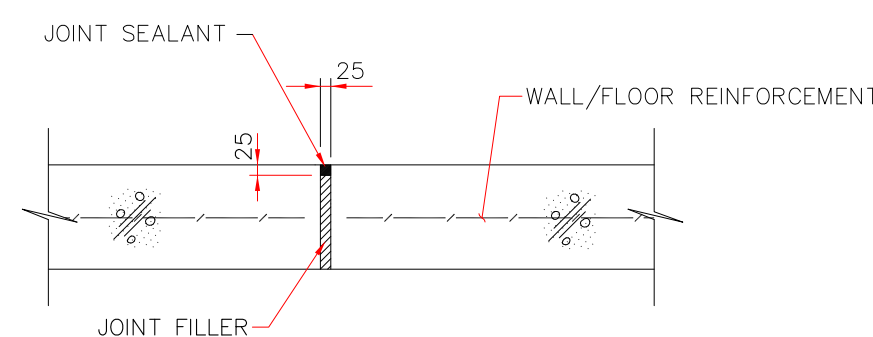
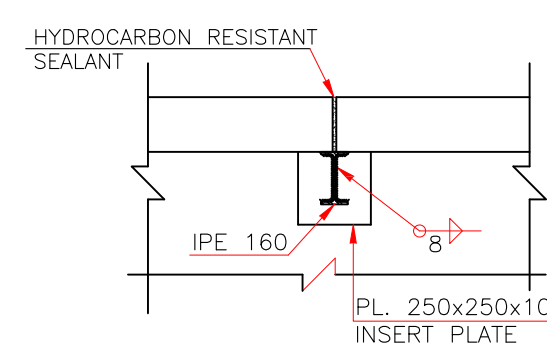
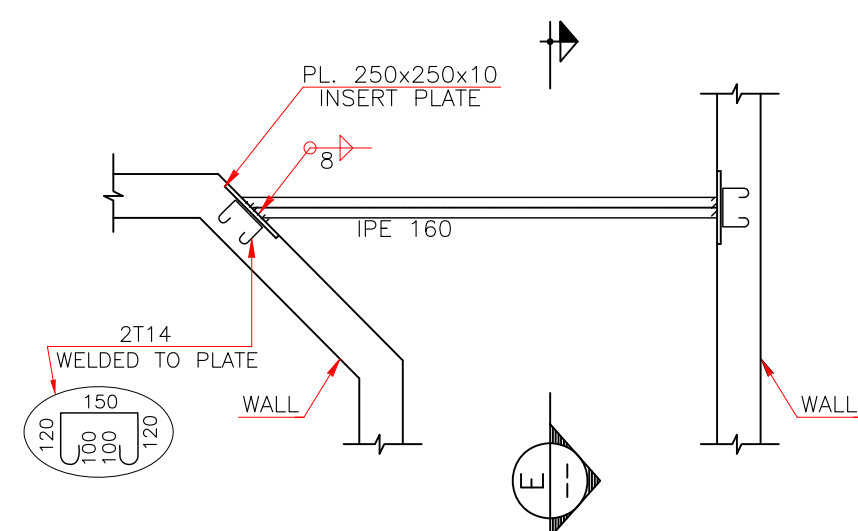
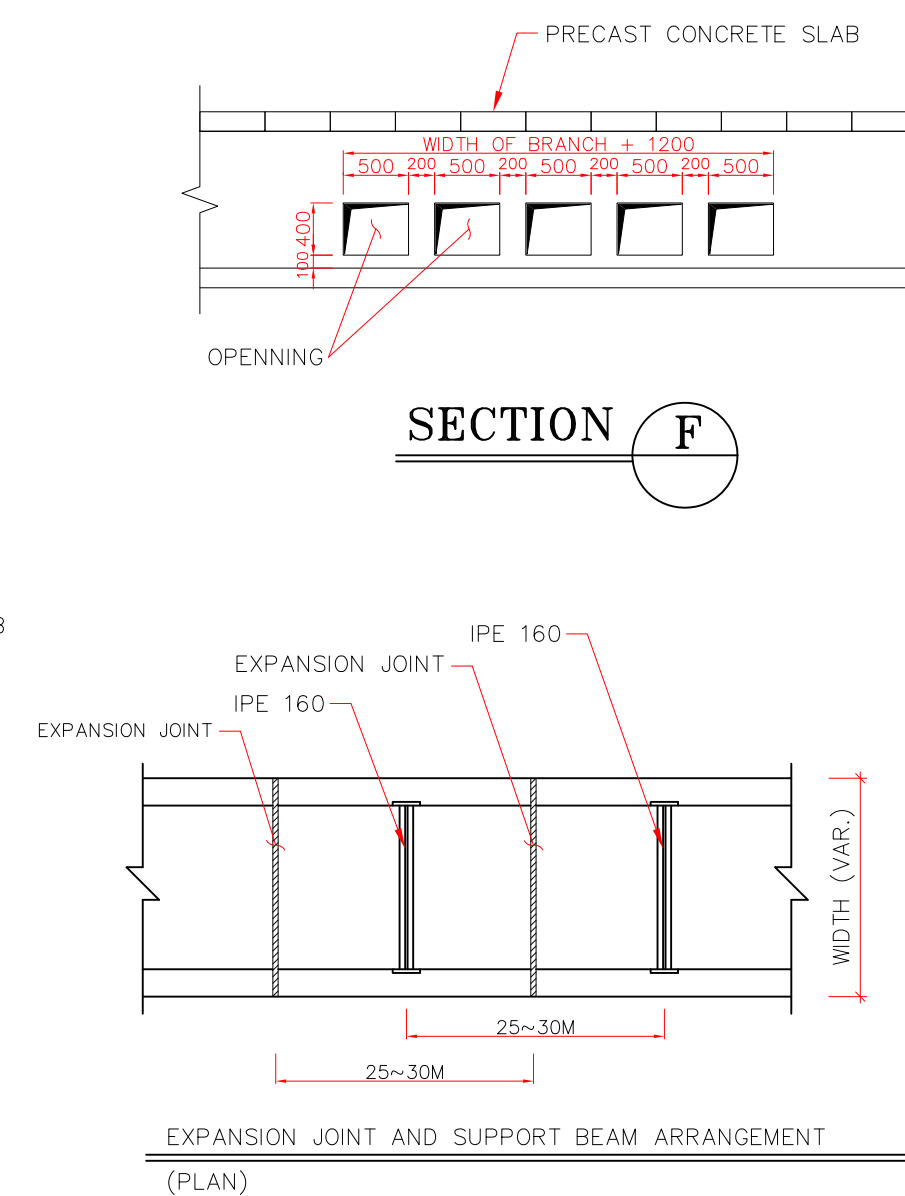
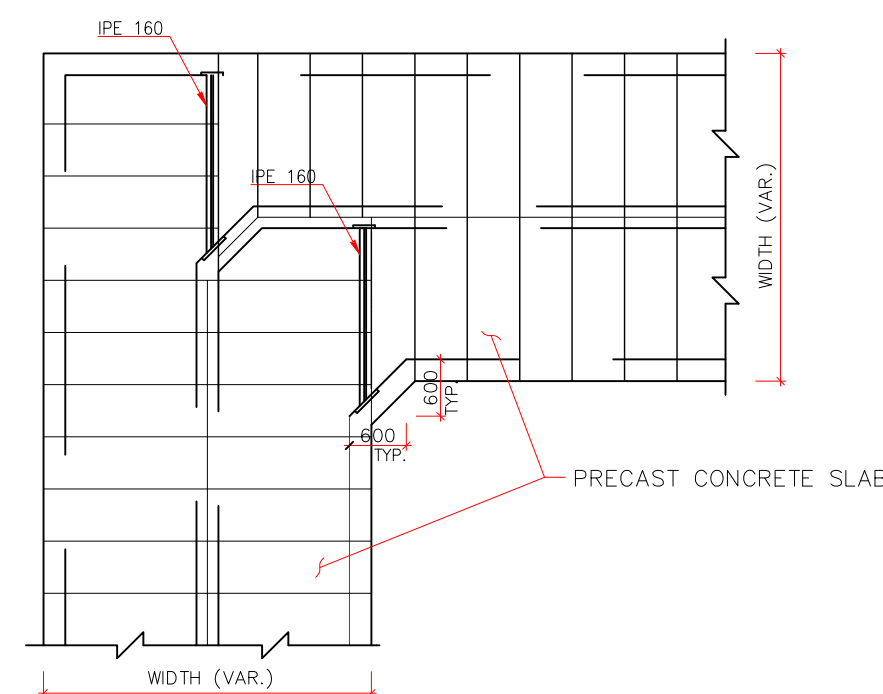
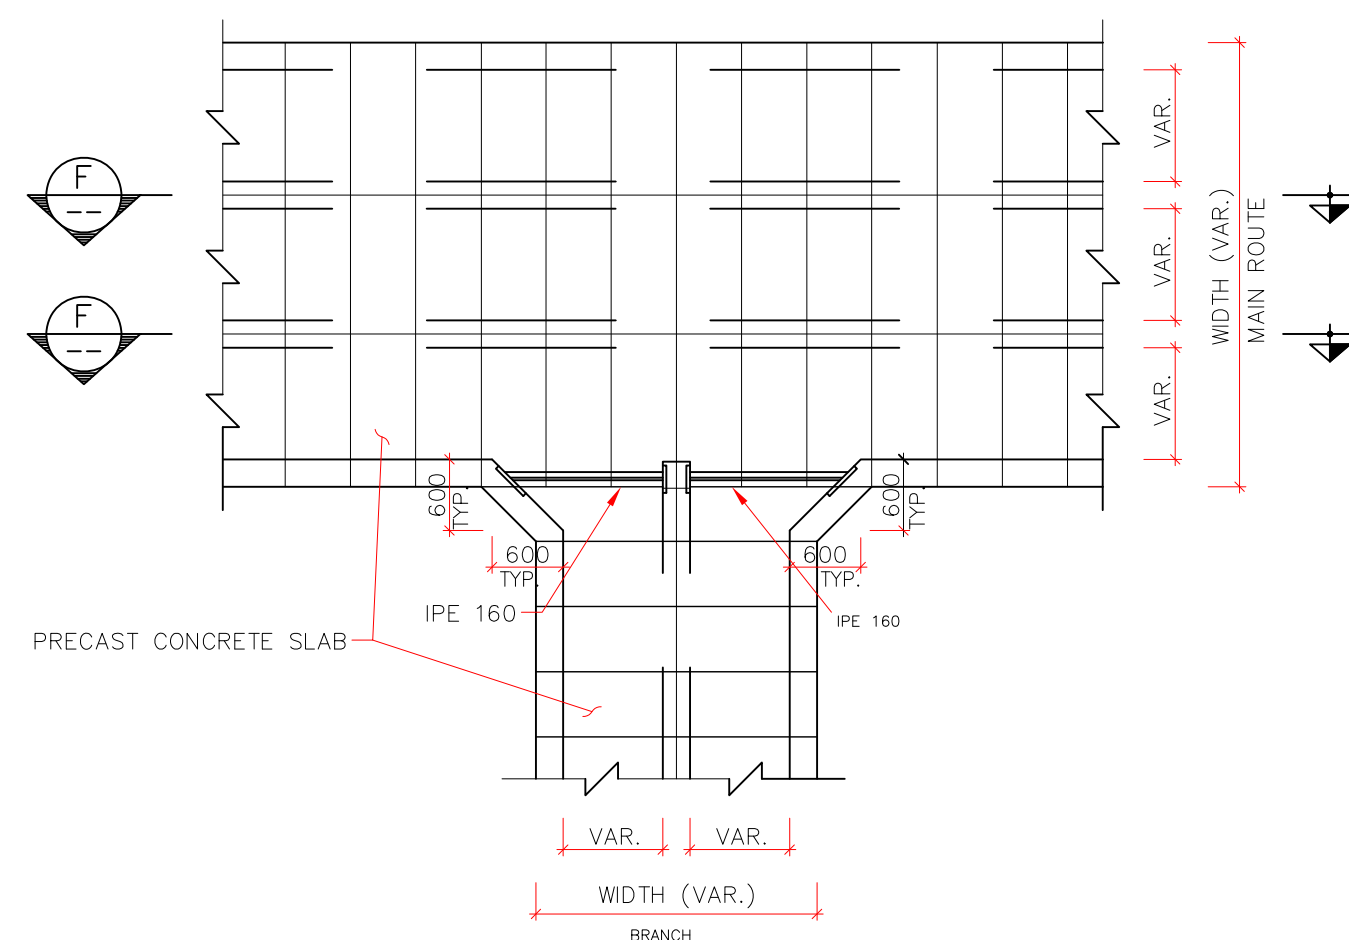
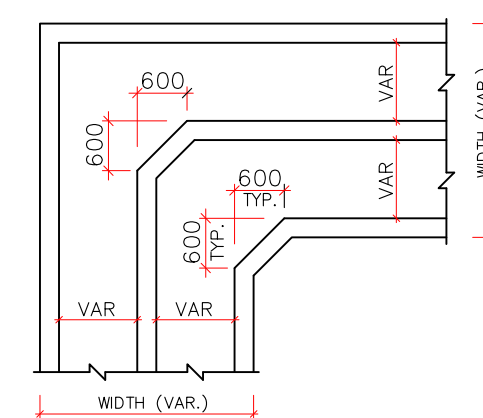
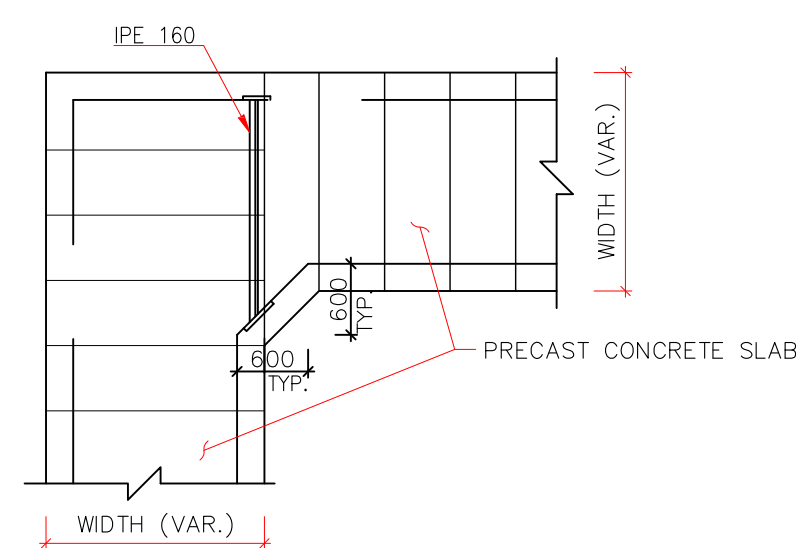


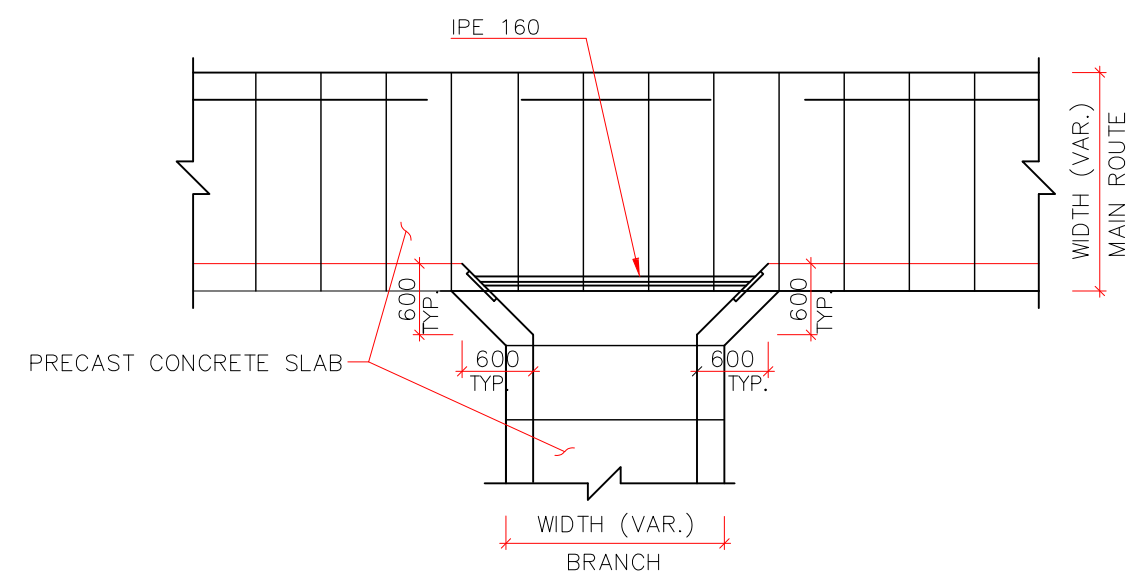

NOTES








1. ALL DIMENSIONS, COORDINATES & ELEVATIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.
2. THE CONTRACTOR SHOULD CHECK AND VERIFY COORDINATES, DIMENSIONS AND ELEVATIONS BEFORE COMMENCING ANY WORK.
3. 28 DAY CHARACTERISTIC COMPRESSIVE STRENGTH OF MAIN CONCRETE IS 250 Kg/cm².
4. 28 DAY CHARACTERISTIC COMPRESSIVE STRENGTH OF LEAN CONCRETE IS 150 Kg/cm².
5. THE SPECIFICATION OF CONCRETE WORK AND SPECIFICATION OF GROUTING SHALL CONFORM TO DOC. NO.
BK-GNRL-PEDCO-000-ST-SP-0001 &
BK-GNRL-PEDCO-000-ST-SP-0004.
6. BACKFILL SHALL BE COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY IN LAYERS NOT EXCEEDING 200mm.
7. CEMENT TO BE TYPE II ACCORDING TO DOC NO.
BK-GNRL-PEDCO-000-ST-SP-0001.
8. TOP OF TRENCHES IN CONCRETE PAVING AREA TO BE FLUSHED WITH PAVING ELEVATION.
9. HE MATERIAL FOR REINFORCEMENT BAR SHALL BE GRADE AIII WITH MINIMUM YIELD STRENGTH 4000 Kg/cm².
10. FOR "W" & "H" PARAMETERS, SEE RELATED COMPOSITE PLAN.
11. FOR ELECTRICAL & INSTRUMENT CABLE TRENCH CROSSING WITH ROAD SEE SHEET.

LEGEND

REFERENCE DRAWING	DRG. No.

KEY PLAN

[illegible]

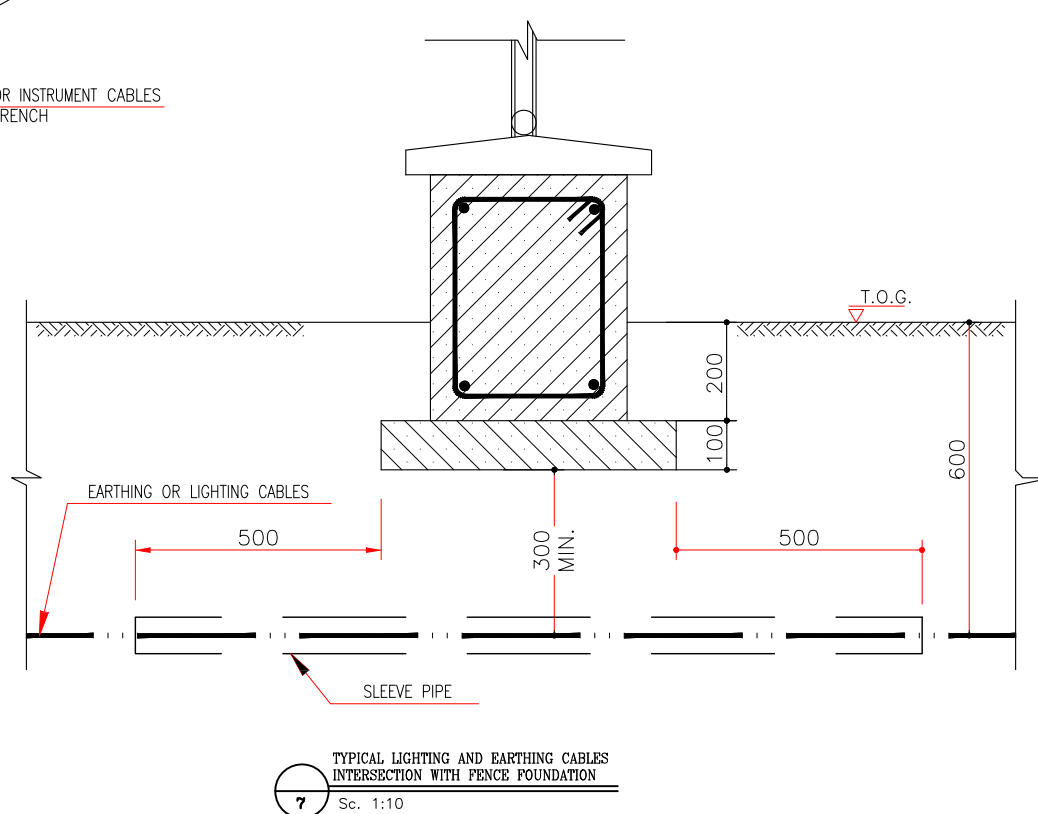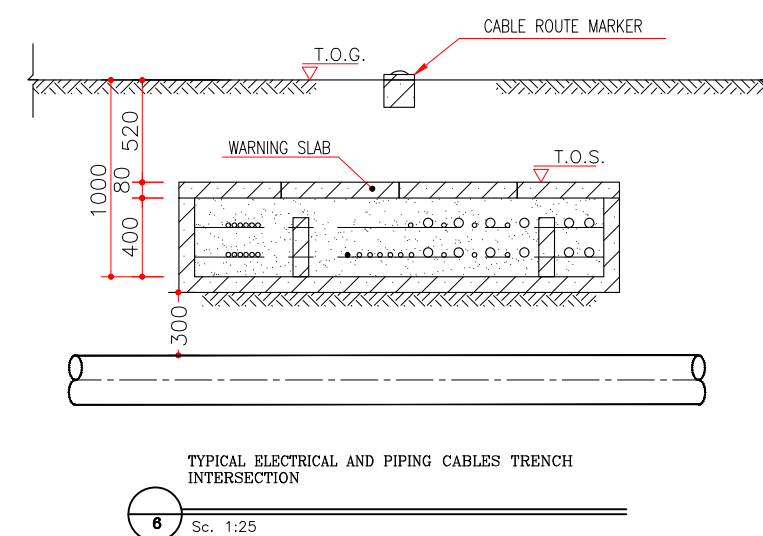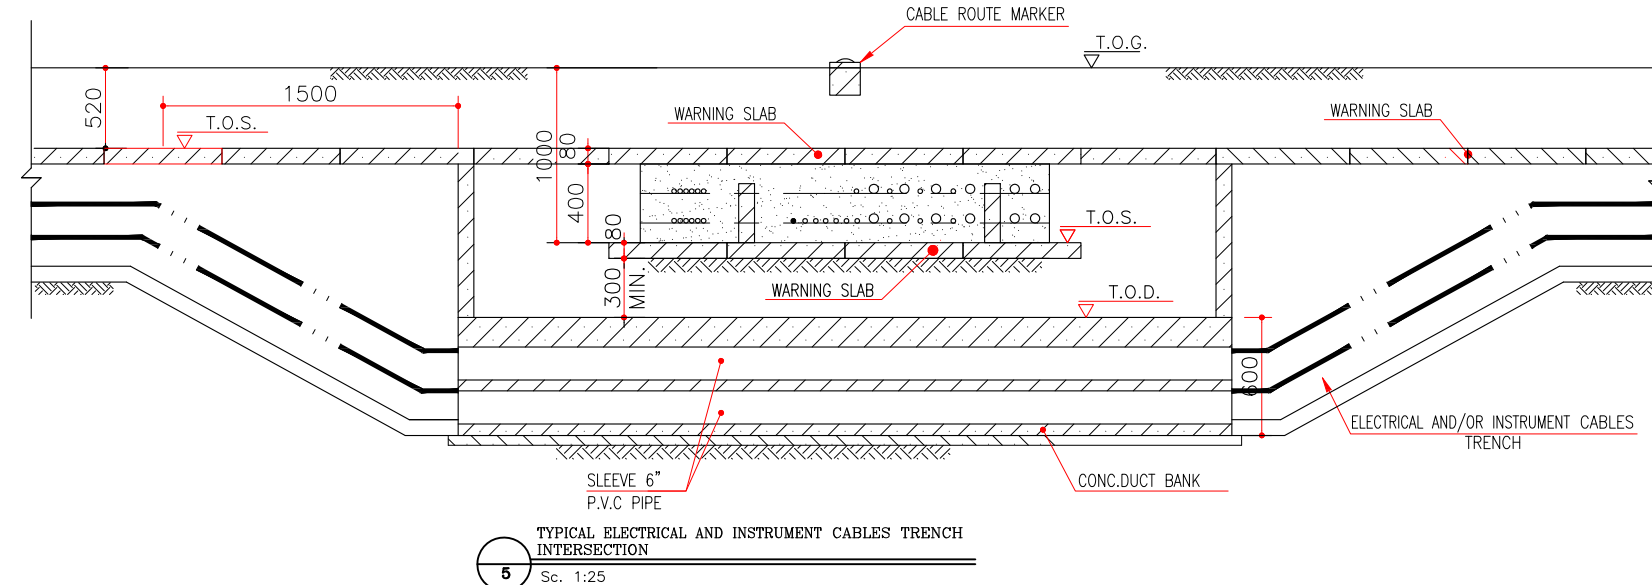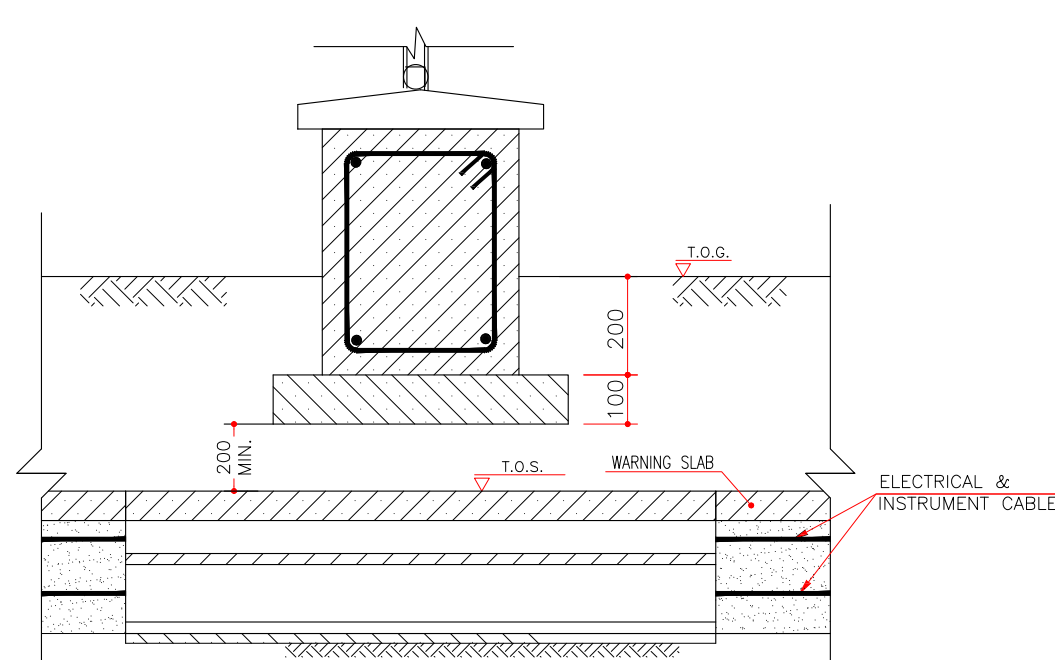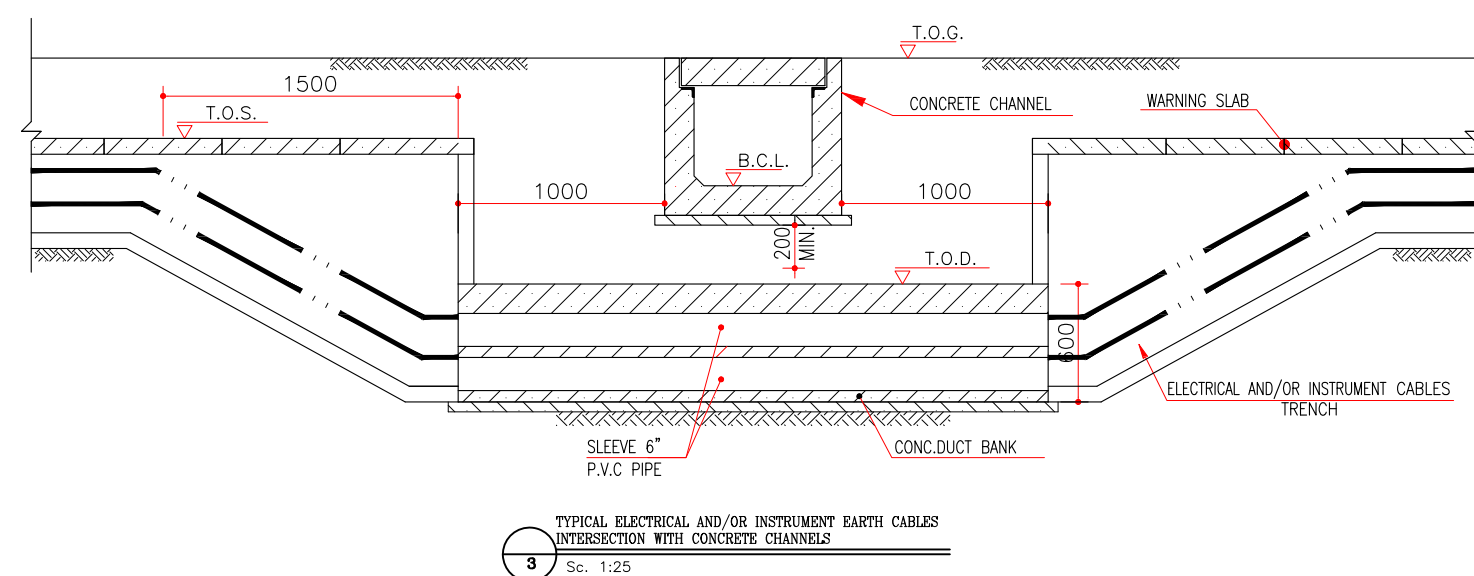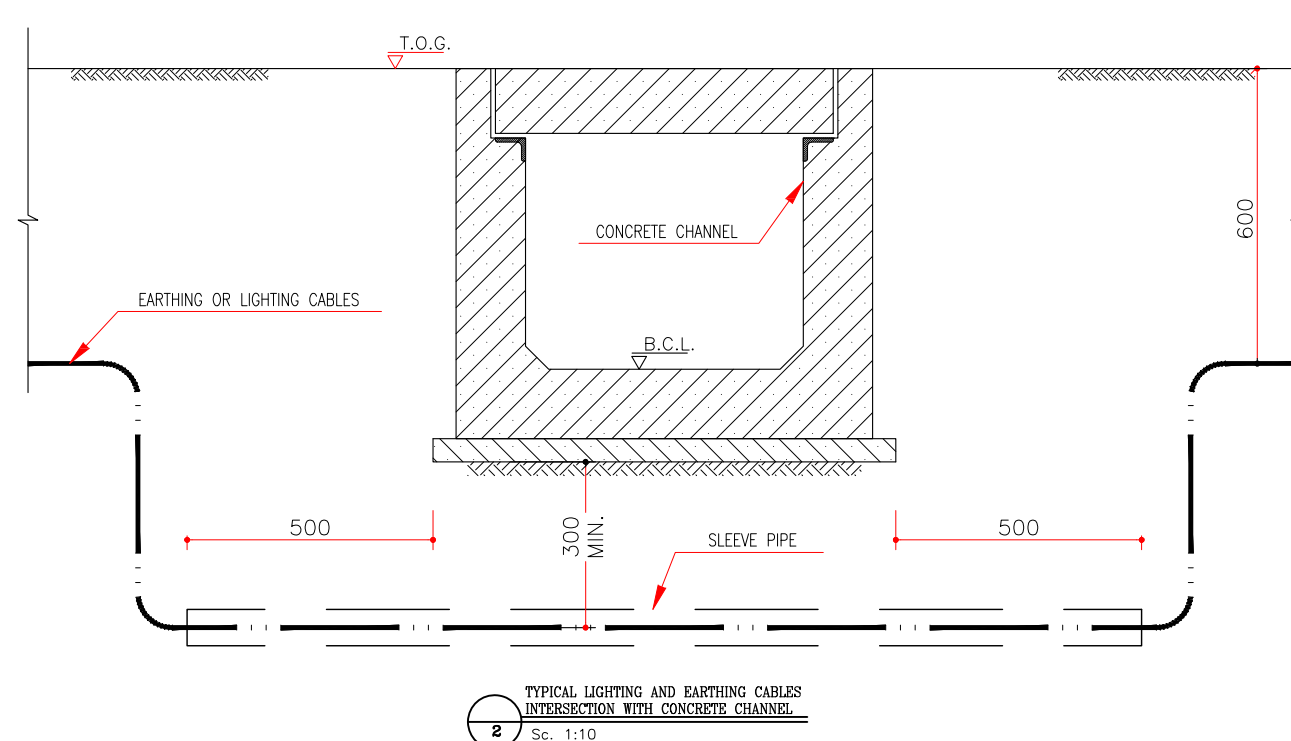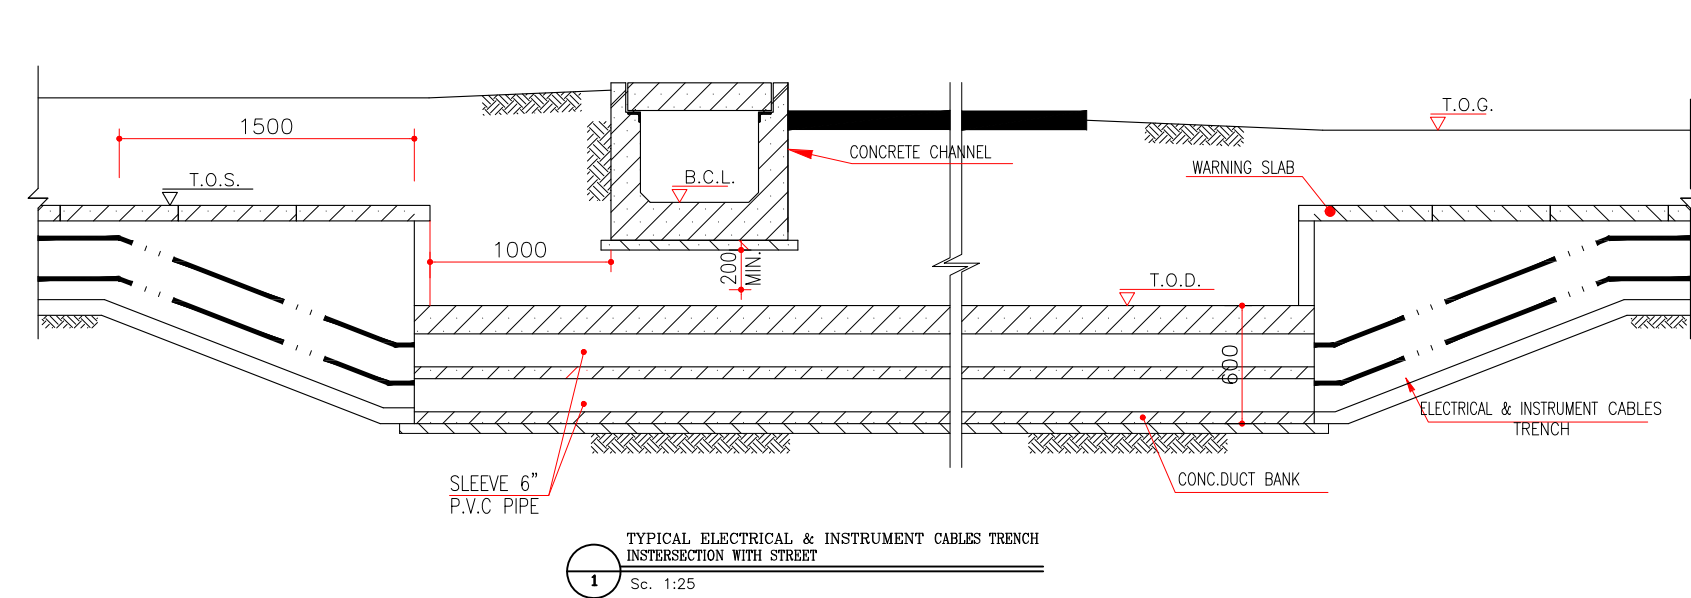

- ### NOTES
1. ALL DIMENSIONS, COORDINATES & ELEVATIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.
 2. THE CONTRACTOR SHOULD CHECK AND VERIFY COORDINATES, DIMENSIONS AND ELEVATIONS BEFORE COMMENCING ANY WORK.
 3. 28 DAY CHARACTERISTIC COMPRESSIVE STRENGTH OF MAIN CONCRETE IS 250 Kg/cm².
 4. 28 DAY CHARACTERISTIC COMPRESSIVE STRENGTH OF LEAN CONCRETE IS 150 Kg/cm².
 5. THE SPECIFICATION OF CONCRETE WORK AND SPECIFICATION OF GROUTING SHALL CONFIRM TO DOC. NO.
BK-GNRL-PEDCO-000-ST-SP-0001 &
BK-GNRL-PEDCO-000-ST-SP-0004.
 6. BACKFILL SHALL BE COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY IN LAYERS NOT EXCEEDING 200mm.
 7. CEMENT TO BE TYPE II ACCORDING TO DOC NO.
BK-GNRL-PEDCO-000-ST-SP-0001.
 8. TOP OF TRENCHES IN CONCRETE PAVING AREA TO BE FLUSHED WITH PAVING ELEVATION.
 9. HE MATERIAL FOR REINFORCEMENT BAR SHALL BE GRADE AIII WITH MINIMUM YIELD STRENGTH 4000 Kg/cm².
 10. FOR "W" & "H" PARAMETERS, SEE RELATED COMPOSITE PLAN.
 11. FOR ELECTRICAL & INSTRUMENT CABLE TRENCH CROSSING WITH ROAD SEE SHEET.


LEGEND

B.C.L.	BOTTOM OF CHANNEL LEVEL
T.O.G.	TOP OF GRAVEL
T.O.D.	TOP OF DUCT BANK
T.O.S.	TOP OF SLAB

REFERENCE DRAWING	DRG. No.

KEY PLAN

[illegible]

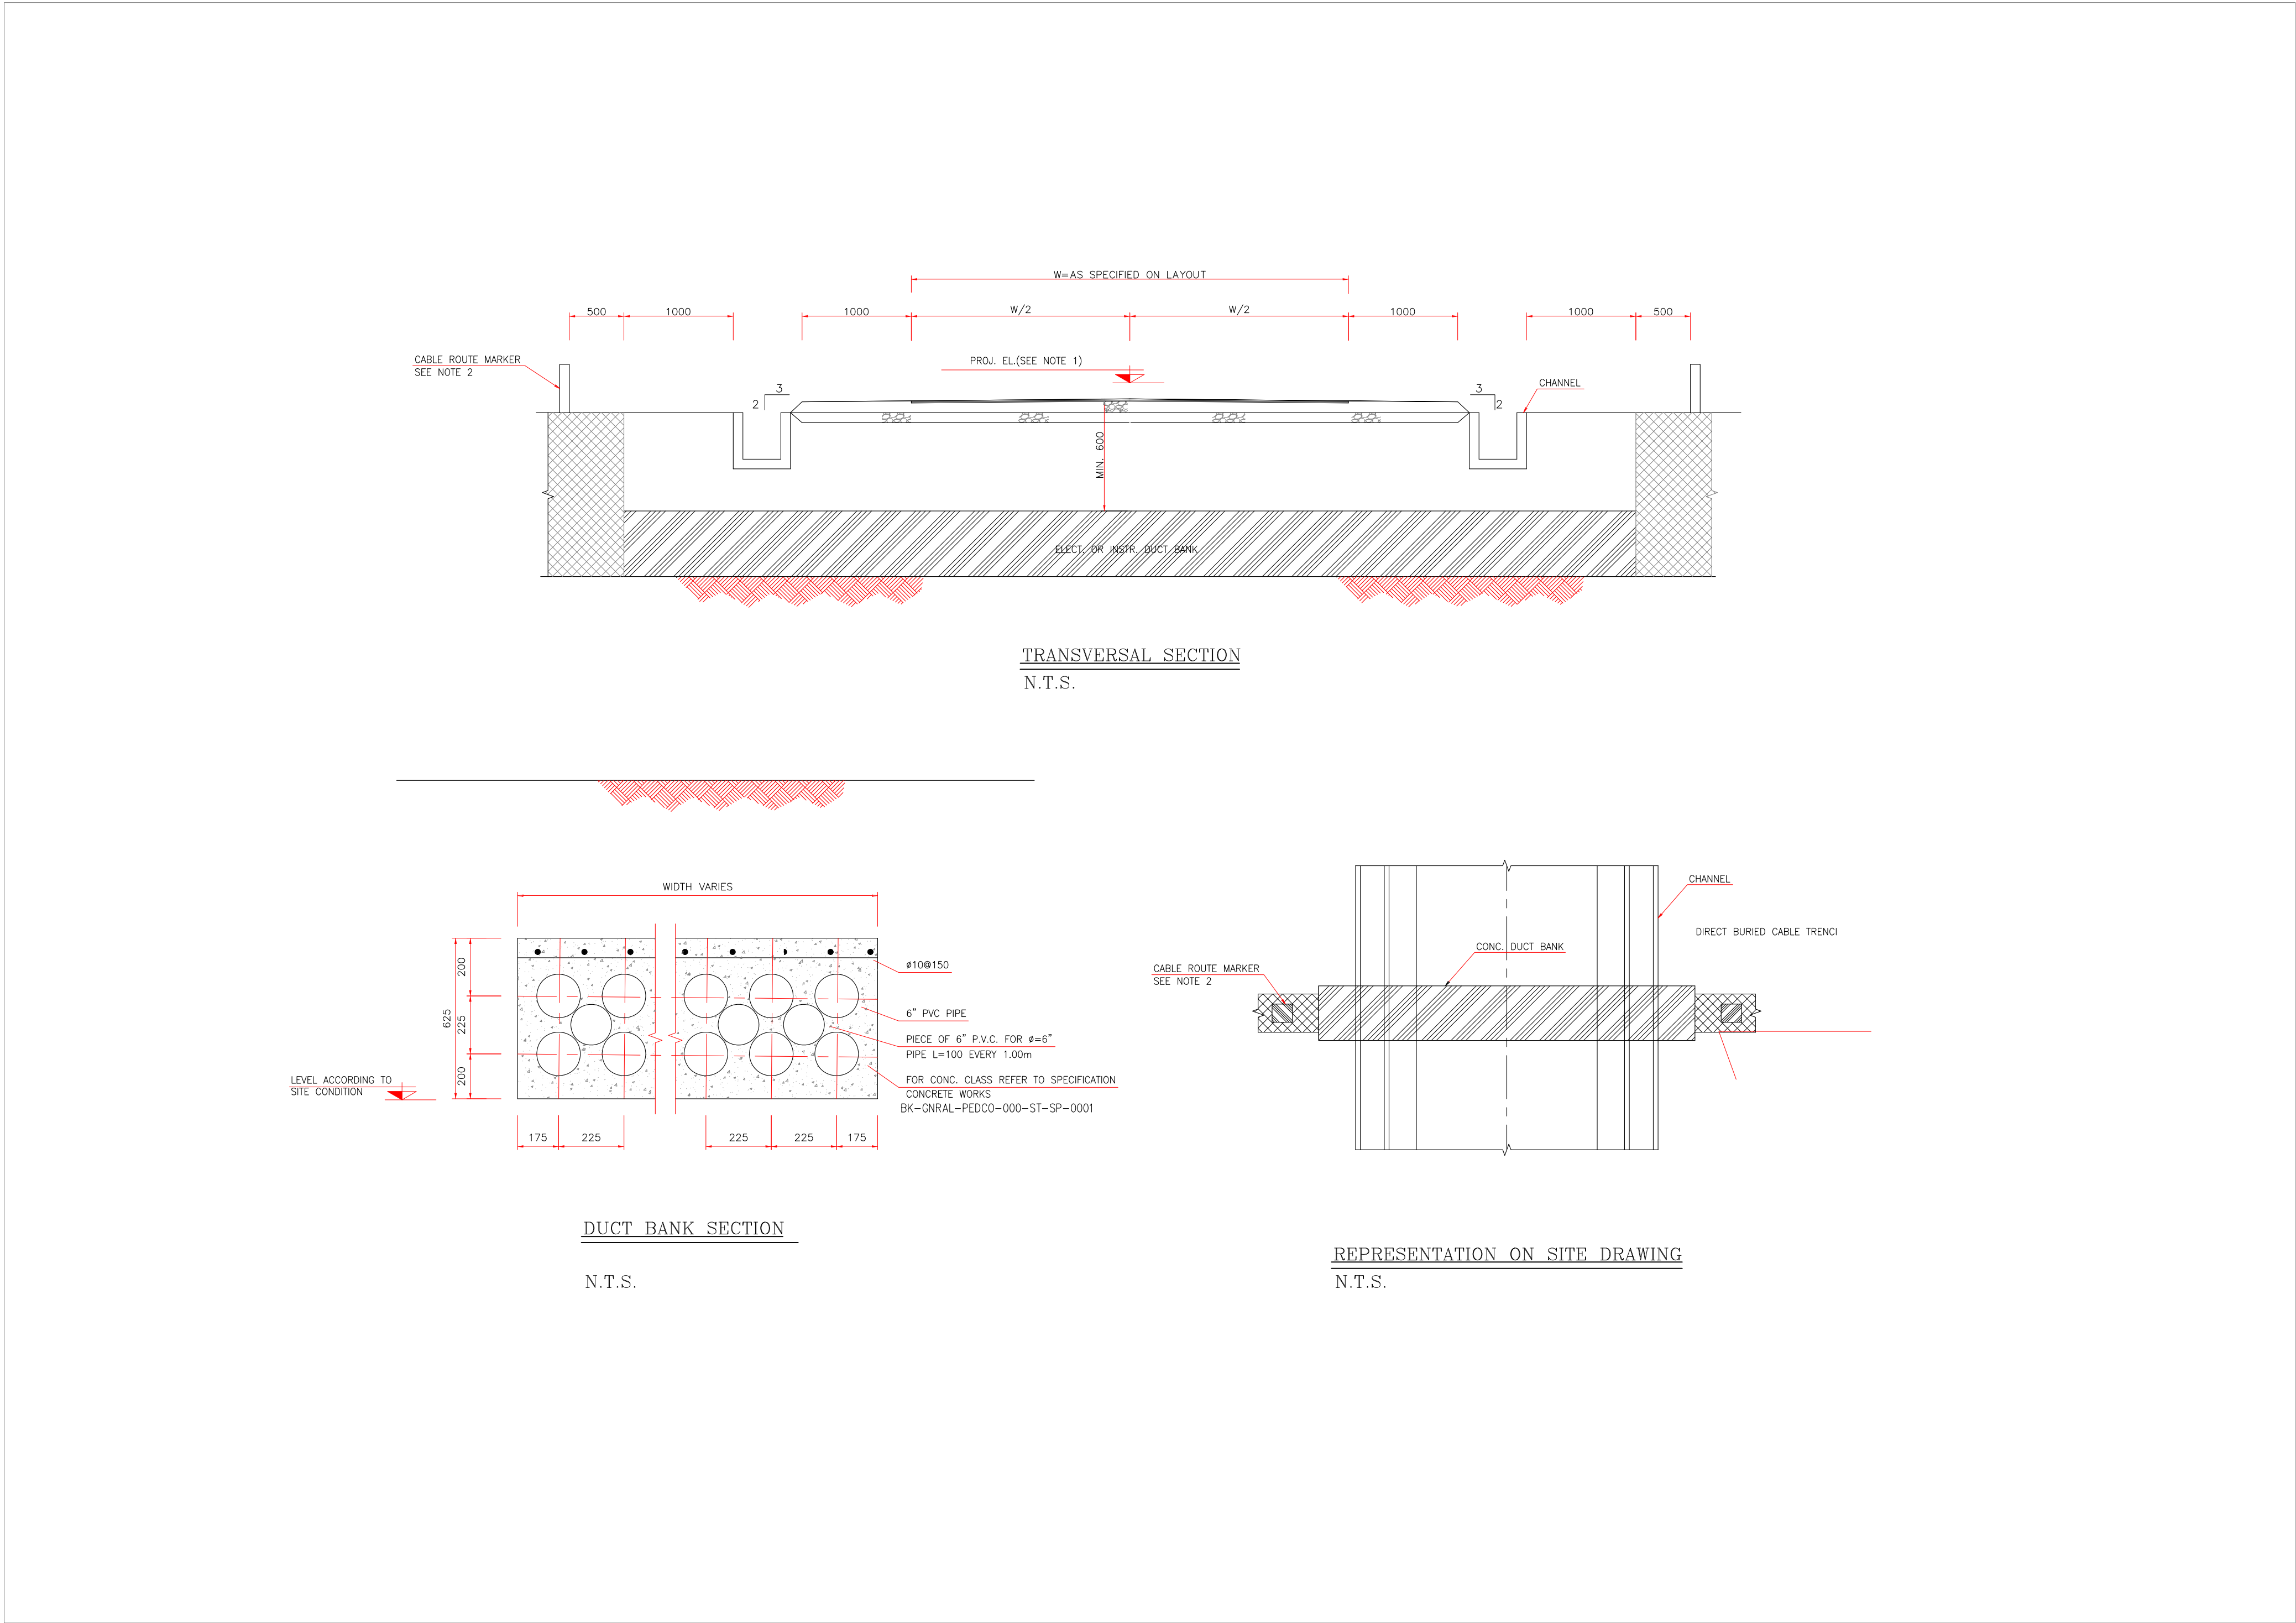

- NOTES
1. ALL DIMENSIONS ARE IN MILLIMETERS & ELEVATION IN METERS UNLESS OTHERWISE STATED.
 2. FOR CABLE ROUTE MARKER, REFER TO DWG IPS-D-EL-208
 3. EACH END OF THE SPARE PVC PIPE SHALL BE CAPPED.
 4. 20% SPARE PVC PIPE SHALL BE PROVIDED.

LEGEND

REFERENCE DRAWING	DRG. No.

KEY PLAN

								***	*****	** **	*** **	** **	*** **	*** **
D01	OCT-2022	IFA	R.BERLOUE	M.PAKHARIAN	SH.GHALIKAR	** **		REV.	DESCRIPTION	BY	DATE	BY	DATE	DATE
D00	AUG-2021	IFI	M.ASHGARIN	M.PAKHARIAN	SH.GHALIKAR	** **				CHECKED		REV. APPR.		
REV.	DATE	P.O.I.S	PREP.	CHK.	APP.	AUT.		اصل و کلیه نسخ این نقشه و حق اقتباس متعلق به شرکت ملی مناطق نفت خیز جنوب میباشد.						
PROJECT NAME:			BINAK OILFIELD DEVELOPMENT GENERAL						THE ORIGINAL AND ALL COPIES OF THIS DRAWING TOGETHER WITH THE COPYRIGHT THEREIN ARE THE SOLE PROPERTY OF N.I.S.O.C./ FIELDS					
PROJECT NO.:			971020											
EPC CONTRACTOR:			EPD/EPC CONTRACTOR (GC):						BINAK OILFIELD DEVELOPMENT GENERAL					
 HIRGAN ENERGY – DESIGN & INSPECTION COMPANIES						 PEDCO			PETROIRAN DEVELOPMENT COMPANY					
									DATE	SCALE	DRAWING BY	CHECKED BY	PROJECT ENG.	
DRAWING TITLE:			Typical Drawing For Electrical Cable Trench					NO CONSTRUCTION PERMITTED UNLESS DRAWING APPROVED						
									APPROVED FOR CONSTRUCTION			BY:		DATE:
SCALE	SIZE	DRAWING NO.			SHEET NO.	REV.		BUDGET REF.	LOCATION	SIZE	CLASS	SERIAL NO.	SHEET	REVISION
N.T.S	A1	BK-GNRL-PEDCO-000-CV-DW-0004			4 OF 4	D01		053-073-9184	F	4	S	707250	4	D01