
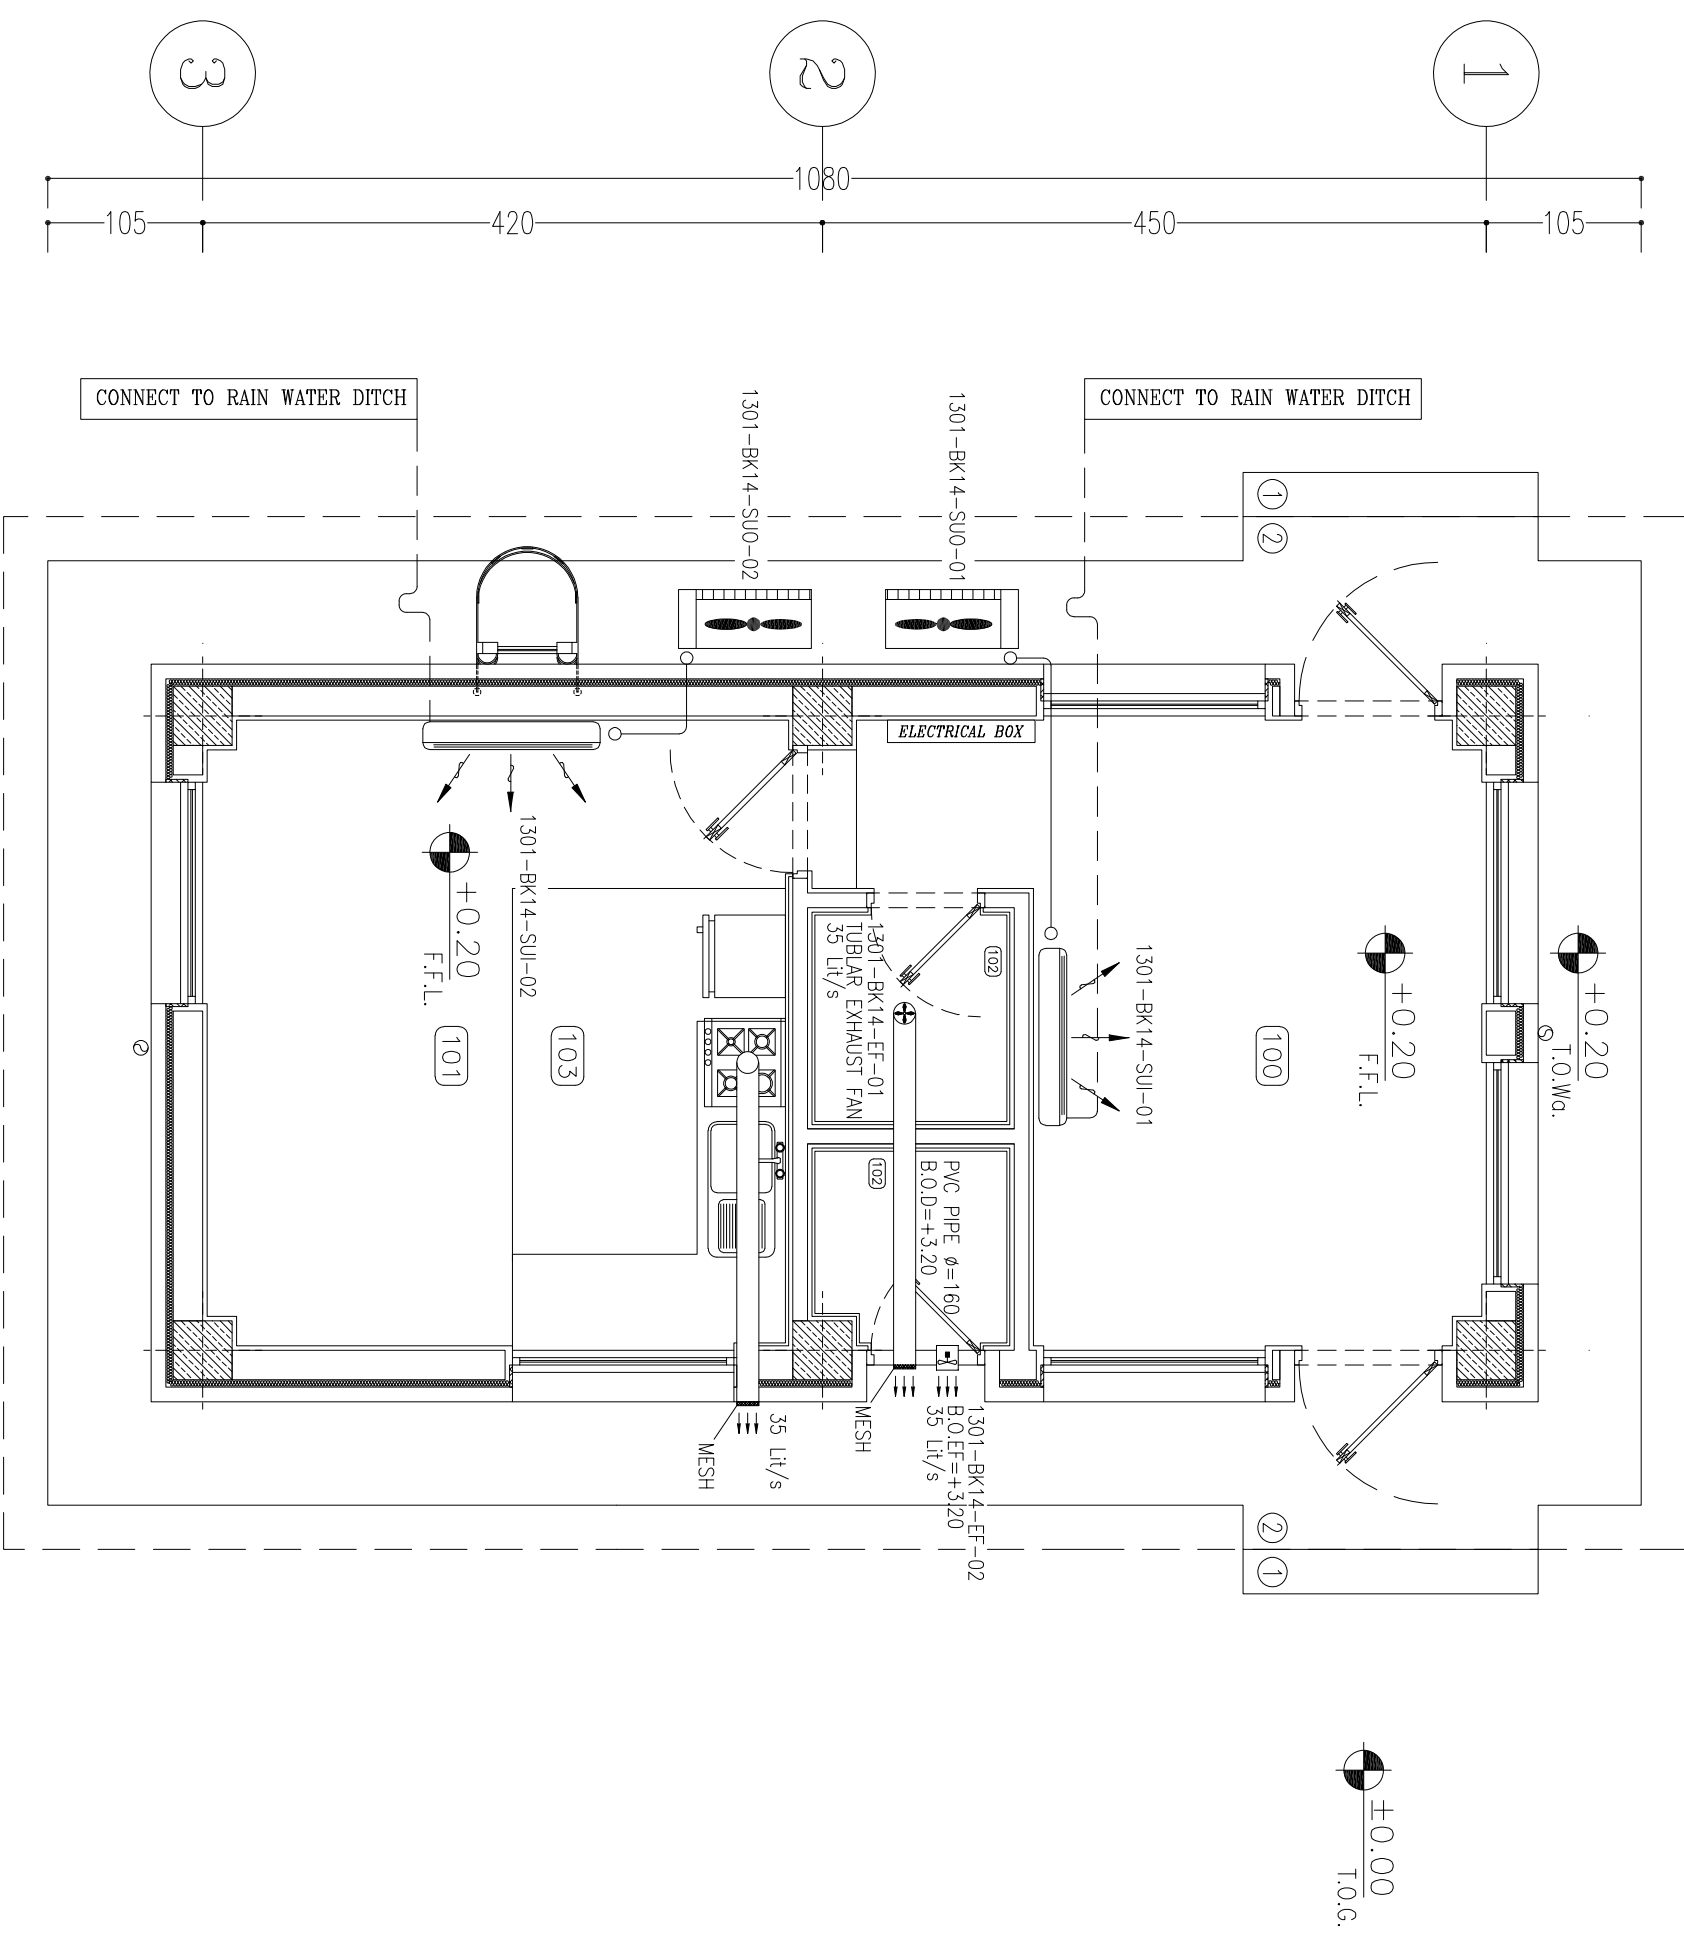
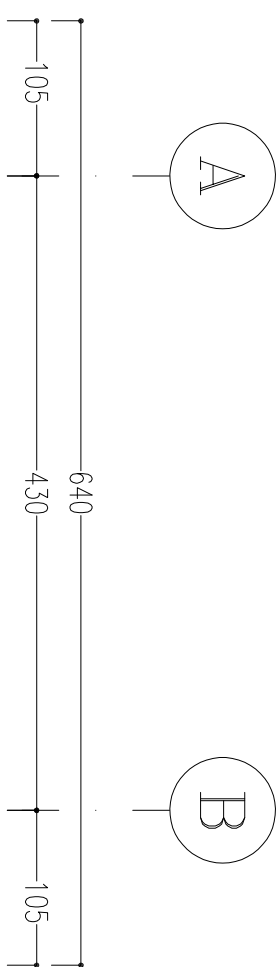


NOTES

- 1- DIMENSIONS AND ELEVATIONS IN "mm" UNLESS SPECIFIED.
- 2- ALL DIMENSIONS AND ELEVATIONS SHALL BE CHECKED BY THE CONTRACTOR PRIOR TO CONSTRUCTION.
- 3- CONTRACTOR SHALL COMPARE ALL ARCHITECTURAL, MECHANICAL, ELECTRICAL, PIPING AND STRUCTURAL DRAWINGS AND IN CASE OF ANY CONFLICTS OR DISCREPANCY, INFORM THE ENGINEER.
- 4- ALL HVAC WORK SHALL BE DONE IN LINE WITH TECHNICAL SPECIFICATIONS.
- 5- REFRIGERANT PIPE (GAS & LIQUID) SIZE SHOULD BE SPECIFIED BY VENDOR.

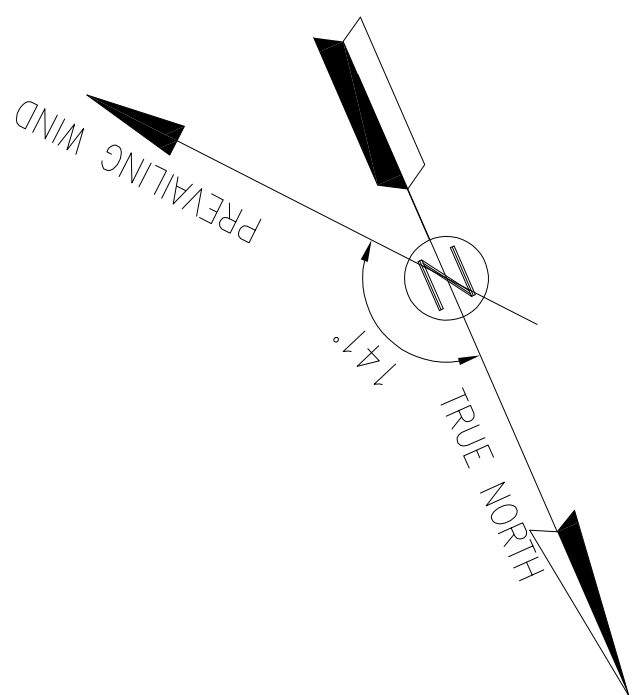

PLAN A  
SC.1:50

| EQUIPMENT NO.   | QTY. | TYPE                | FLOW (L/S) | STATIC PRESSURE (PA.) | SERVICE AREA    | REMARK |
|-----------------|------|---------------------|------------|-----------------------|-----------------|--------|
| 1301-BK14-EF-01 | 1    | AXIAL(PIPE MOUNTED) | 35         | 15                    | TOILET (INDOOR) | -      |
| 1301-BK14-EF-02 | 1    | AXIAL(WALL MOUNTED) | 35         | 15                    | TOILET          | -      |


## EXHAUST FAN

| EQUIPMENT NO.    | QTY. | TYPE         | NOMINAL CAPACITY<br>(BTU/HR) | ELECTRIC POWER<br>SUPPLY (V/PH/Hz) | SERVICE AREA          |
|------------------|------|--------------|------------------------------|------------------------------------|-----------------------|
| 1301-BK14-SU1-01 | 1    | WALL MOUNTED | 24000                        | 230/1/50<br>400/3/50               | SECURITY GUARD ROOM   |
| 1301-BK14-SU1-02 | 1    | WALL MOUNTED | 24000                        | 230/1/50<br>400/3/50               | RESTING AREA & PANTRY |

## DX-SPLIT AIR CONDITIONER UNITS

## SPACE TAG NUMBER

- 100 SECURITY GUARD ROOM
  - 101 RESTING AREA
  - 102 WC
  - 103 PANTRY

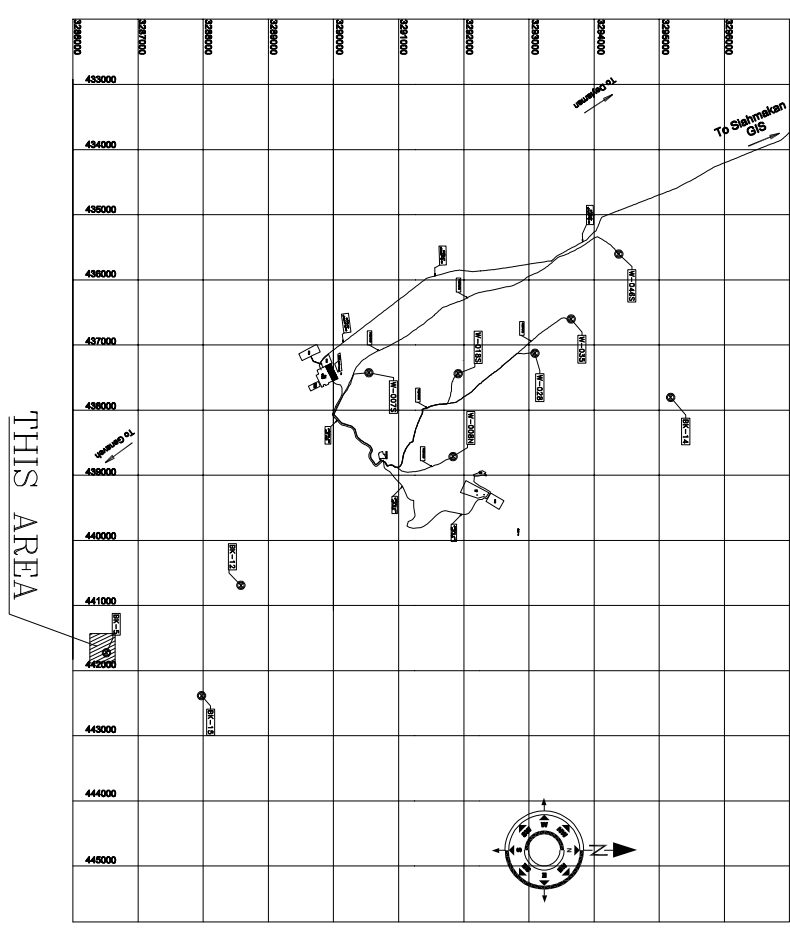[illegible]