
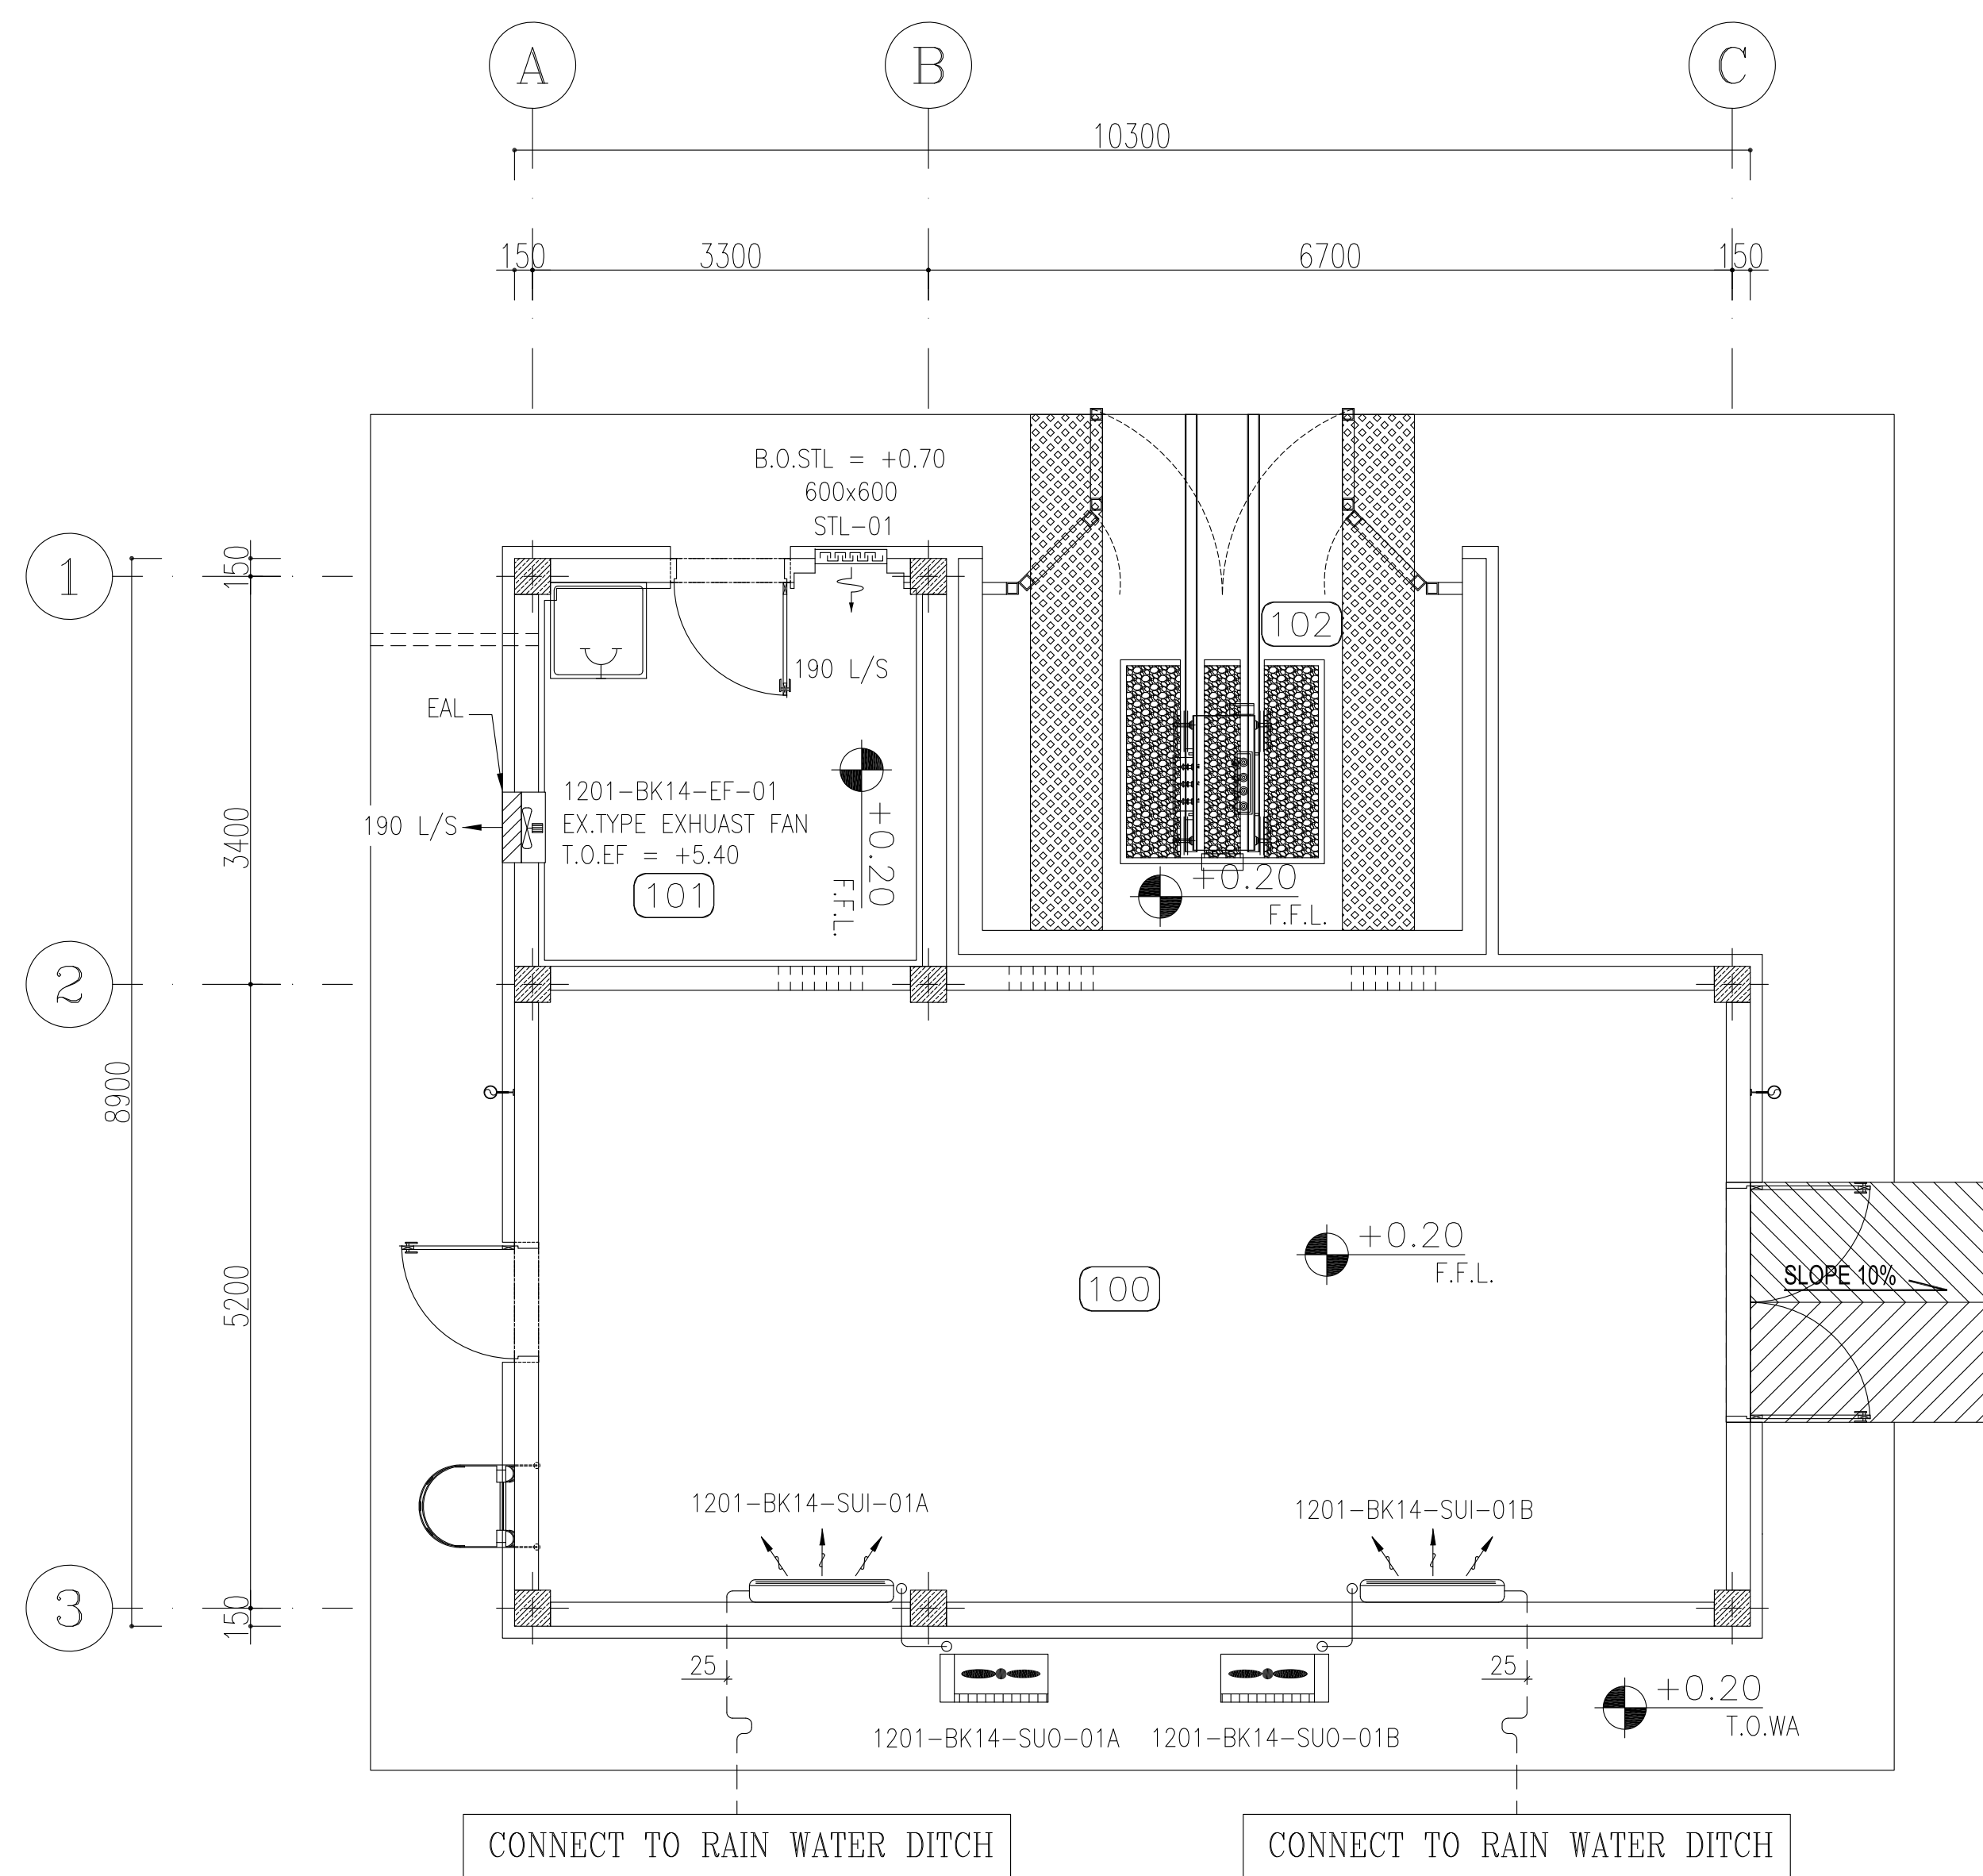


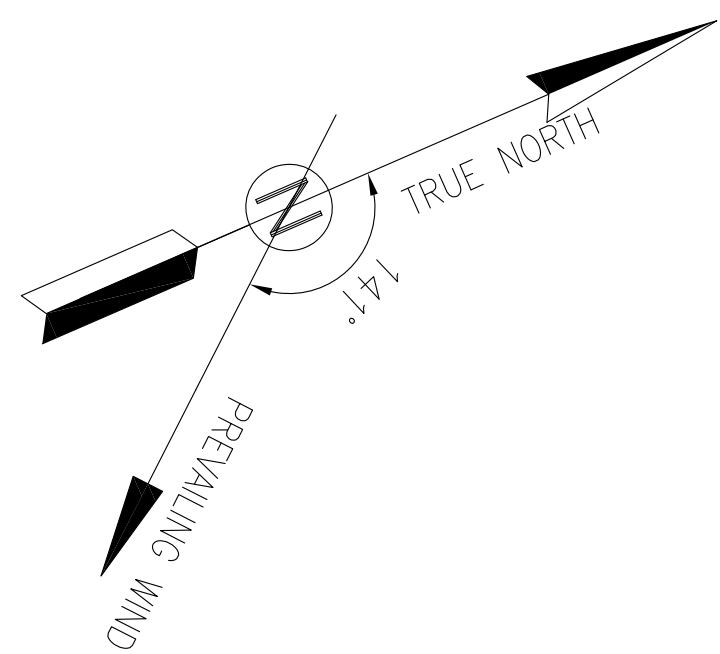

 ± 0.00
F.G.L.

AIR INLET SCHEDULE

ROOM	TYPE	TAG NUMBER	NECK SIZE (MM)	QTY.	FLOW (L/S)
BATTERY ROOM	SAND TRAP LOUVER	STL-01	600x600.	1	190

EXHAUST FAN

EQUIPMENT NO.	QTY.	TYPE	FLOW (L/S)	STATIC PRESSURE (PA.)	SERVICE AREA	REMARK
1201-BK14-EF-01	1	AXIAL- EXPLOSION PROOF Exd- IIC-T3	190	100	BATTERY ROOM	EQUIPPED WITH EXHAUST AIR LOUVER

DX-SPLIT AIR CONDITIONER UNITS

EQUIPMENT NO.	QTY.	TYPE	NOMINAL CAPACITY (BTU/HR)	ELECTRIC POWER SUPPLY (V/PH/Hz)	SERVICE AREA
1201-BK14-SUI-01A/B 1201-BK14-SUO-01A/B	2	WALL MOUNTED	24000	230/1/50	SWITCHGEAR ROOM

HVAC SYSTEM LAYOUT

SC.1:50

SPACE TAG NUMBER

(100) SWITCHGEAR ROOM

101 BATTERY ROOM

102 TRANSFORMER SHELTER

[illegible]