


NOTES

1. EQUIPMENT & ACCESS ARE TO BE INSTALLED OUTSIDE THE SAFETY RADIUS OF X-MASS TREE.
2. DELETED.
3. THE CONTROL AND PROTECTION OF WELHEAD FACILITIES MUST BE CONSIDERED BY PUMP VENDOR.
4. PAINTING IS NOT NECESSARY FOR PIPES THAT LOCATED OUTSIDE OF FENCE.
5. FOR INSTRUMENT CONNECTION REFER TO INSTRUMENT HOOK UP DIAGRAM.
6. ACCORDING TO THE GRADIENT OF THE BURN PIT PIPELINE, IT IS CONSIDERED ONE LOCAL DRAIN IN THE WELL PAD AREA.
7. ACCORDING TO STANDARD DRAWING SD-002 THESE FLANGES ARE 3000 PSI.
8. A 1" BLIND CONNECTION SHOULD BE CONSIDERED ON SC.

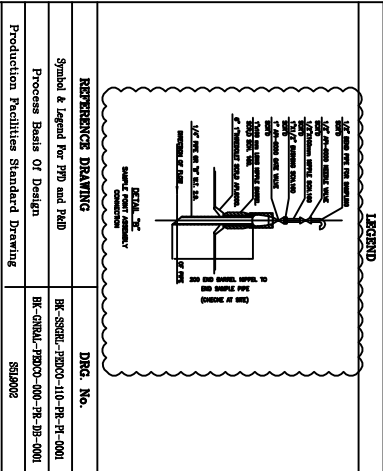

KEY PLAN

Case No.	Case Name	Case Type	Case Status	Case Date	Case Time	Case Location	Case Description	Case Notes	Case Comments
1	John Doe	Medical	Open	2023-01-01	10:00	Room 101	John Doe, 45 years old, male, presented with chest pain and shortness of breath. Vital signs: BP 120/80, HR 90, RR 20, SpO2 95%.	ECG showed sinus tachycardia. Chest X-ray showed clear lung fields.	Admitted to the medical ward for further observation.
2	Jane Smith	Medical	Closed	2023-01-02	11:30	Room 102	Jane Smith, 32 years old, female, presented with a headache and nausea. Vital signs: BP 110/70, HR 75, RR 18, SpO2 98%.	ECG showed normal sinus rhythm. Blood tests showed normal results.	Discharged home with painkillers and instructions.
3	Michael Brown	Medical	Open	2023-01-03	14:15	Room 103	Michael Brown, 60 years old, male, presented with a fall and a laceration on his right arm. Vital signs: BP 130/90, HR 100, RR 22, SpO2 96%.	ECG showed sinus tachycardia. Wound was cleaned and sutured.	Admitted to the surgical ward for wound management.
4	Sarah Johnson	Medical	Closed	2023-01-04	09:45	Room 104	Sarah Johnson, 28 years old, female, presented with a fever and cough. Vital signs: BP 100/60, HR 85, RR 16, SpO2 94%.	ECG showed normal sinus rhythm. Blood tests showed elevated white blood cell count.	Admitted to the medical ward for infection management.
5	David Wilson	Medical	Open	2023-01-05	13:00	Room 105	David Wilson, 55 years old, male, presented with a headache and dizziness. Vital signs: BP 140/90, HR 95, RR 20, SpO2 97%.	ECG showed sinus tachycardia. Blood tests showed normal results.	Admitted to the medical ward for further observation.
6	Emily Davis	Medical	Closed	2023-01-06	10:30	Room 106	Emily Davis, 38 years old, female, presented with a fever and sore throat. Vital signs: BP 115/75, HR 80, RR 18, SpO2 98%.	ECG showed normal sinus rhythm. Blood tests showed elevated white blood cell count.	Admitted to the medical ward for infection management.
7	Robert Miller	Medical	Open	2023-01-07	12:45	Room 107	Robert Miller, 70 years old, male, presented with a fall and a laceration on his left leg. Vital signs: BP 125/85, HR 105, RR 22, SpO2 96%.	ECG showed sinus tachycardia. Wound was cleaned and sutured.	Admitted to the surgical ward for wound management.
8	Lisa Anderson	Medical	Closed	2023-01-08	11:00	Room 108	Lisa Anderson, 42 years old, female, presented with a headache and nausea. Vital signs: BP 110/70, HR 75, RR 18, SpO2 98%.	ECG showed normal sinus rhythm. Blood tests showed normal results.	Discharged home with painkillers and instructions.
9	James Taylor	Medical	Open	2023-01-09	14:30	Room 109	James Taylor, 50 years old, male, presented with a fever and cough. Vital signs: BP 105/65, HR 85, RR 16, SpO2 94%.	ECG showed normal sinus rhythm. Blood tests showed elevated white blood cell count.	Admitted to the medical ward for infection management.
10	Amanda White	Medical	Closed	2023-01-10	09:15	Room 110	Amanda White, 30 years old, female, presented with a headache and dizziness. Vital signs: BP 135/95, HR 95, RR 20, SpO2 97%.	ECG showed sinus tachycardia. Blood tests showed normal results.	Admitted to the medical ward for further observation.

[illegible]

WO46S

BINAK PRODUCTION WELL

DESIGN PRESS. : 5000 PSIA

DESIGN TEMP.: 105 °C

IRP-1301

SUCKER ROD PUMP (IRP)

(BY VENDOR)

DESIGN PRESS. : 3000 PSIA
DESIGN TEMP. : 105 °C


DESIGN TEMP.: 105 °C

ST-1301

STONE TRAP

DESIGN PRESS. : 3000 PSIA

DESIGN TEMP.: 105 °C

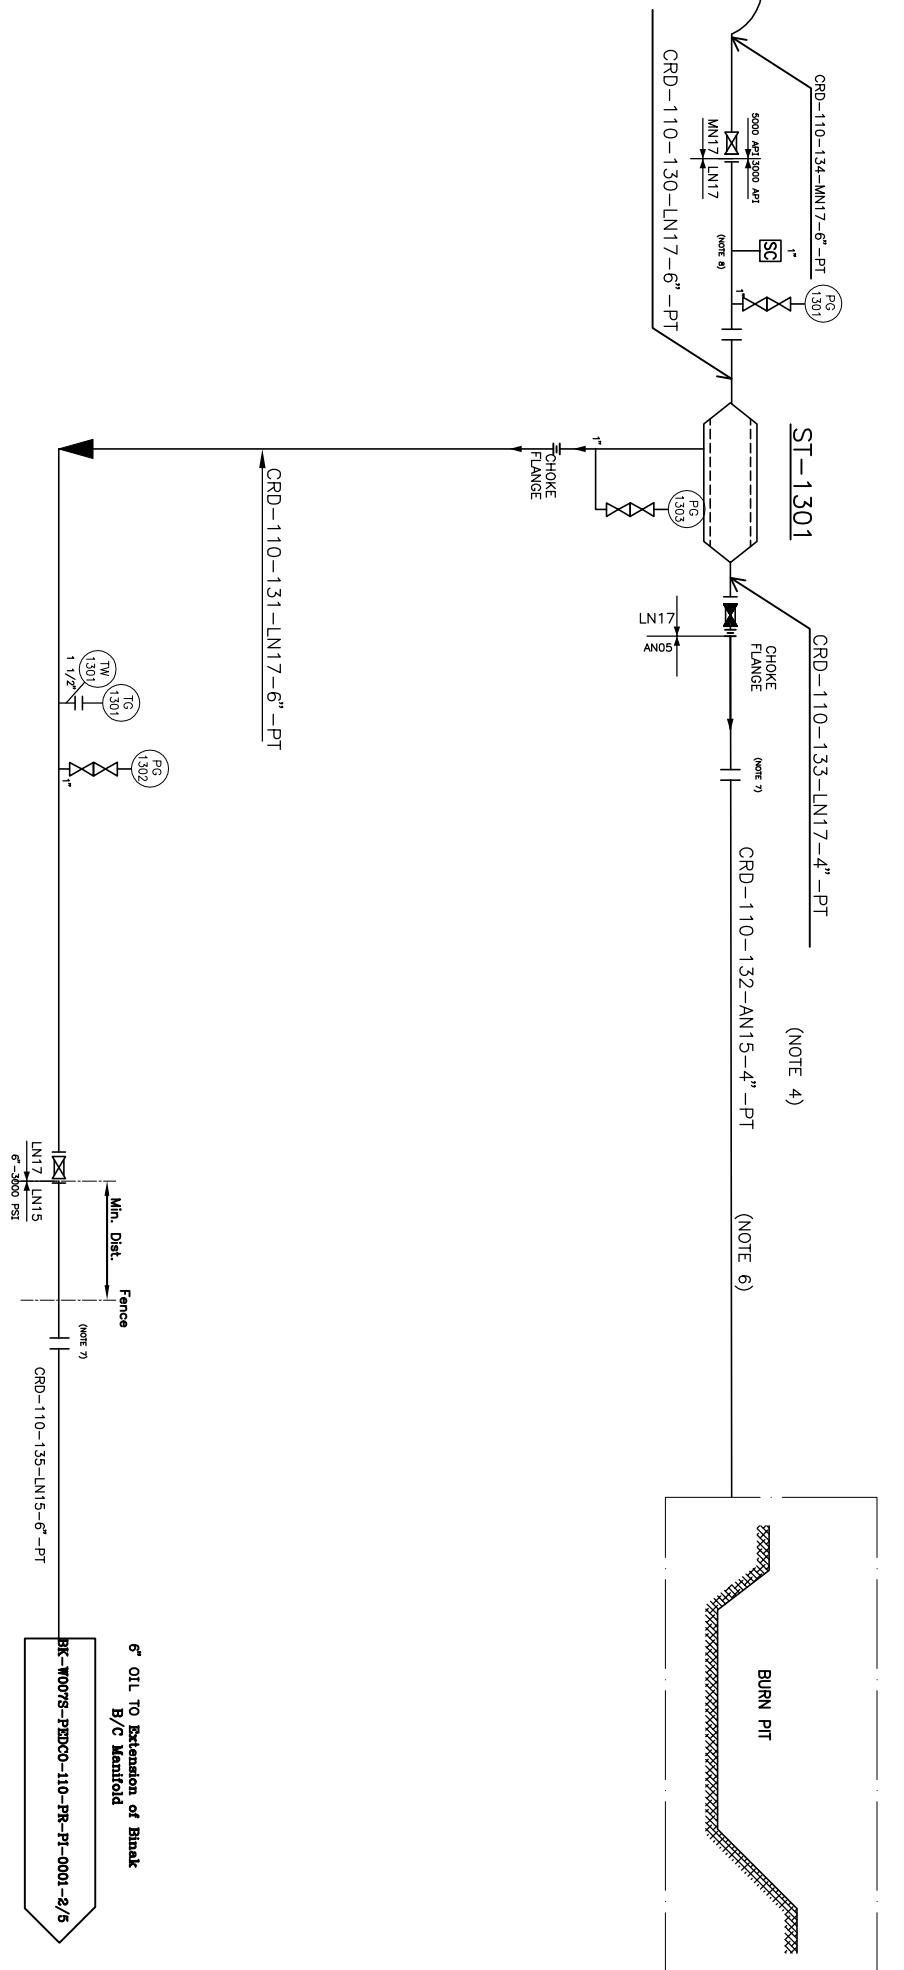

(NOTE 1,3)

IRP-1301

W046S

WELLHEAD

(SUB SURFACE SCOPE OF WORK)