


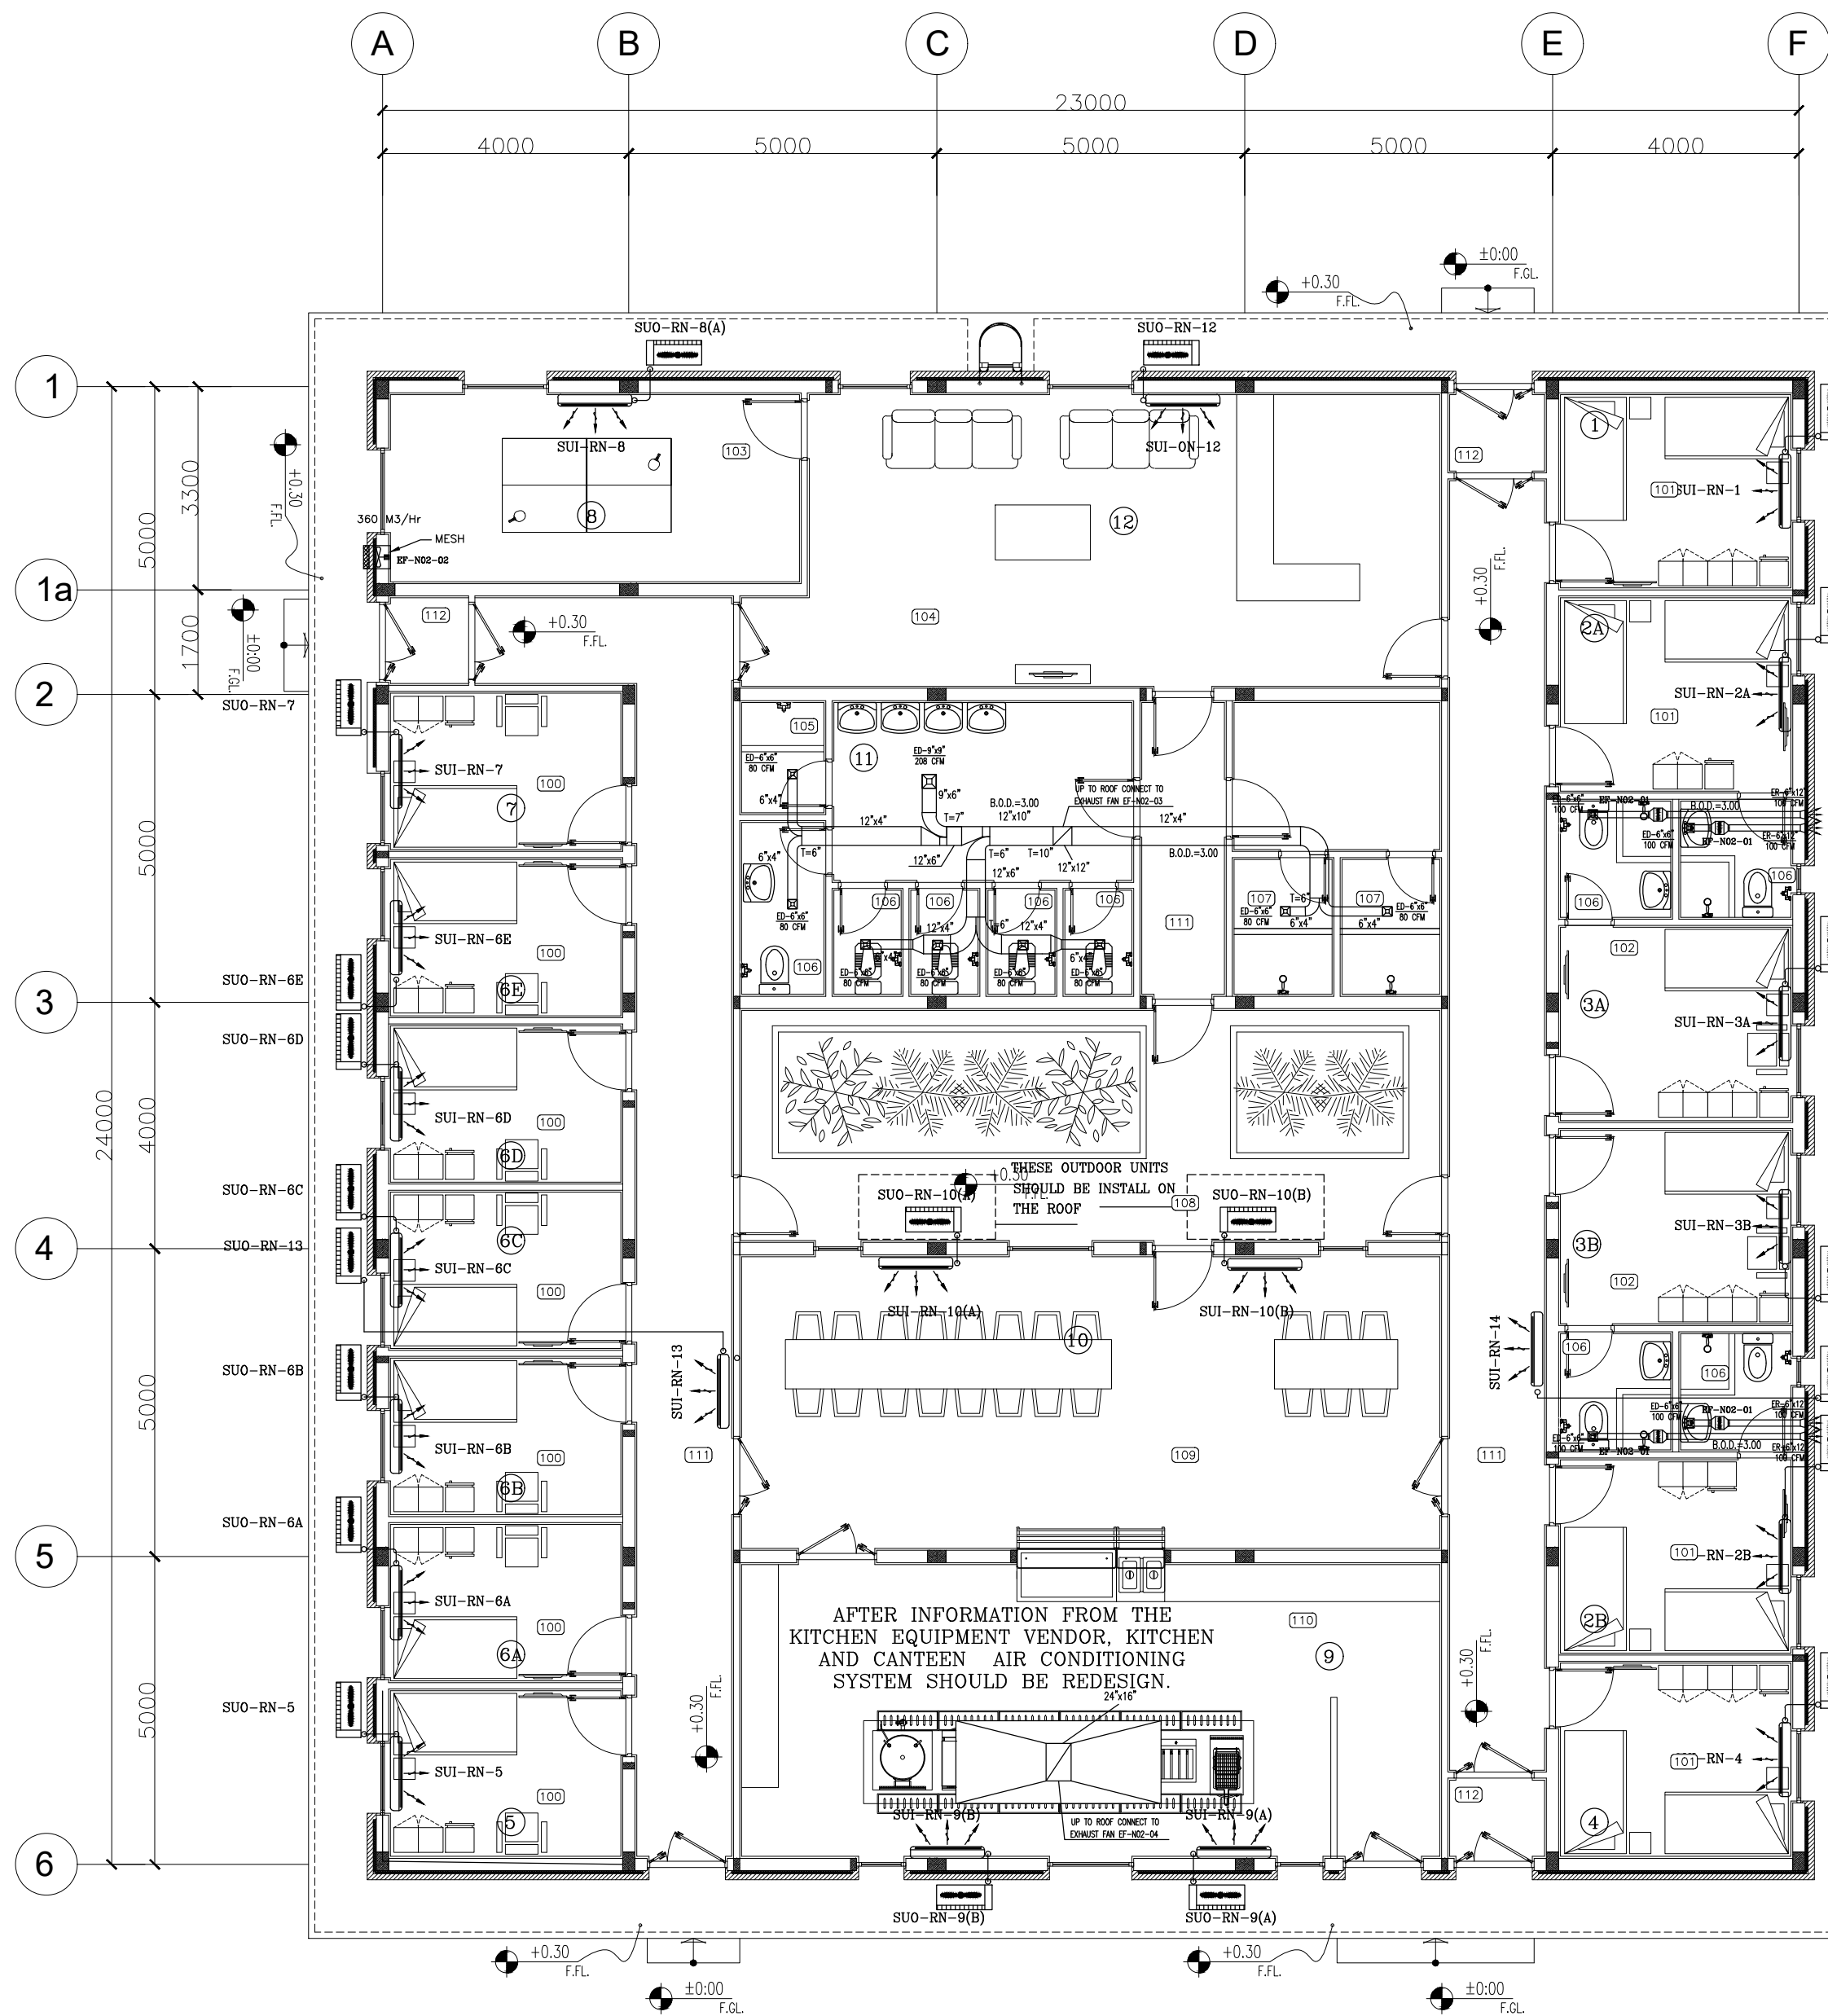

100 SINGLE BED REST ROOM
 101 DOUBLE BED REST ROOM
 102 MASTER REST ROOM
 103 SPORT ROOM
 104 TV ROOM
 105 J.C
 106 TOILET
 107 BATH
 108 PATIO
 109 CANTEEN
 110 KITCHEN
 111 CORRIDOR
 112 AIRLOCK

1-ALL DIMENSIONS ARE IN MILLIMETERS AND ALL ELEVATIONS ARE IN METERS.

2-THE EQUIPMENT SIZE MAY BE CHANGEABLE BY THE LATEST VENDOR DATA.

3-THESE DRAWINGS MUST BE READ IN CONJUNCTION WITH ARCH, STRUCTURAL, ELECTRICAL, INSTRUMENT, HVAC, SAFETY AND ... DRAWINGS.

4-DETAILS OF INDOOR & OUTDOOR UNIT INSTALLATION SHALL BE SUBMITTED AFTER VENDOR FINALIZED.

5-F.G.L. LEVEL (± 0.00) = 11.60 (IN THIS DRAWING).

HVAC EQUIPMENT SCHEDULE	BK-GNRL-PEDCO-220-HV-LI-0001
-------------------------	------------------------------

[illegible]


EQUIPMENT NO.	QTY.	SERVICE AREA	TYPE	TYPE CAPACITY (M ³ /HR)	STATIC PRESS. (PA)	MAX. ALLOWABLE NOISE LEVEL (dBA)	ELEC. POWER SUPPLY V/PH/Hz	ELECTRIC POWER INPUT (KW)	REMARK
EF-N02-01	4	REST ROOMS	CENTRIFUGE	170	58	55	230/1/50	BY VENDOR	DUCT MOUNTED STANDARD ACCESSORY
EF-N02-02	1	SPORT ROOM	AXIAL	360	30	55	230/1/50	BY VENDOR	WALL MOUNTED STANDARD ACCESSORY
EF-N02-03	1	TOILET/BATH	CENTRIFUGE	1440	150	55	230/1/50	BY VENDOR	EQUIPPED EXHAUST AIR LOUVER WITH STANDARD ACCESSORY
EF-N02-04 ⁴	1	KITCHEN&CANTEN	CENTRIFUGE	4633	100	55	230/1/50	BY VENDOR	EQUIPPED EXHAUST AIR LOUVER WITH STANDARD ACCESSORY

DX-SPLIT AIR CONDITIONER HEAT PUMP TYPE (NISOC RESIDENTIAL CAMP)

SPACE ID	SPACE ACTUAL COOLING LOAD (BTU/HR)	EQUIPMENT NO.	QTY.	TYPE	TYPE NOMINAL COOLING CAPACITY (BTU/HR)	ELEC. POWER SUPPLY V/PH/Hz	MANUFACTURE MODEL NUMBER	SERVICE AREA	REMARK
1	65838	SUI-RN-1 SUI-RN-1	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
2A	6580	SUI-RN-2A SUI-RN-2A	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
2B	6580	SUI-RN-2B SUI-RN-2B	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
3A	6580	SUI-RN-3A SUI-RN-3A	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
3B	6580	SUI-RN-3B SUI-RN-3B	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
4	7064	SUI-RN-4 SUI-RN-5	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
5	6742	SUI-RN-5 SUI-RN-5	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
6A	4472	SUI-RN-6A SUI-RN-6A	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
6B	4489	SUI-RN-6B SUI-RN-6B	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
6C	4489	SUI-RN-6C SUI-RN-6C	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
6D	4489	SUI-RN-6D SUI-RN-6D	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
6E	4489	SUI-RN-6E SUI-RN-6E	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
7	4736	SUI-RN-7 SUI-RN-7	1	TROPICAL, HEAT PUMP, WALL MOUNTED	12000	230/1/50	BY VENDOR	REST ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
8	20269	SUI-RN-8 SUI-RN-8	1	TROPICAL, HEAT PUMP, WALL MOUNTED	24000	230/1/50	BY VENDOR	SPORT ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
9	45967	SUI-RN-9(A),(B) SUI-RN-9(A),(B)	2 *	TROPICAL, HEAT PUMP, WALL MOUNTED	30000	230/1/50	BY VENDOR	KITCHEN	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
10	41362	SUI-RN-10(A),(B) SUI-RN-10(A),(B)	2 *	TROPICAL, HEAT PUMP, WALL MOUNTED	24000	230/1/50	BY VENDOR	CANTEN	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
12	17362	SUI-RN-12 SUI-RN-12	1	TROPICAL, HEAT PUMP, WALL MOUNTED	24000	230/1/50	BY VENDOR	TV ROOM	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
13	10807	SUI-RN-13 SUI-RN-13	1	TROPICAL, HEAT PUMP, WALL MOUNTED	18000	230/1/50	BY VENDOR	CORRIDOR	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.
14	10819	SUI-RN-14 SUI-RN-14	1	TROPICAL, HEAT PUMP, WALL MOUNTED	18000	230/1/50	BY VENDOR	CORRIDOR	OUTDOOR & INDOOR UNIT WALL MOUNTED WITH THERMOSTAT AND ALL SPLIT UNITS SHALL WORK FOR T3 CATEGORY AND COOLING LOAD SHALL DE-RATE 30% IN COMPARE WITH T1 RATING.

* AFTER INFORMATION FROM THE KITCHEN EQUIPMENT VENDOR, KITCHEN AND CANTEEN AIR CONDITIONING SYSTEM SHOULD BE REDESIGN.

SC 1:100

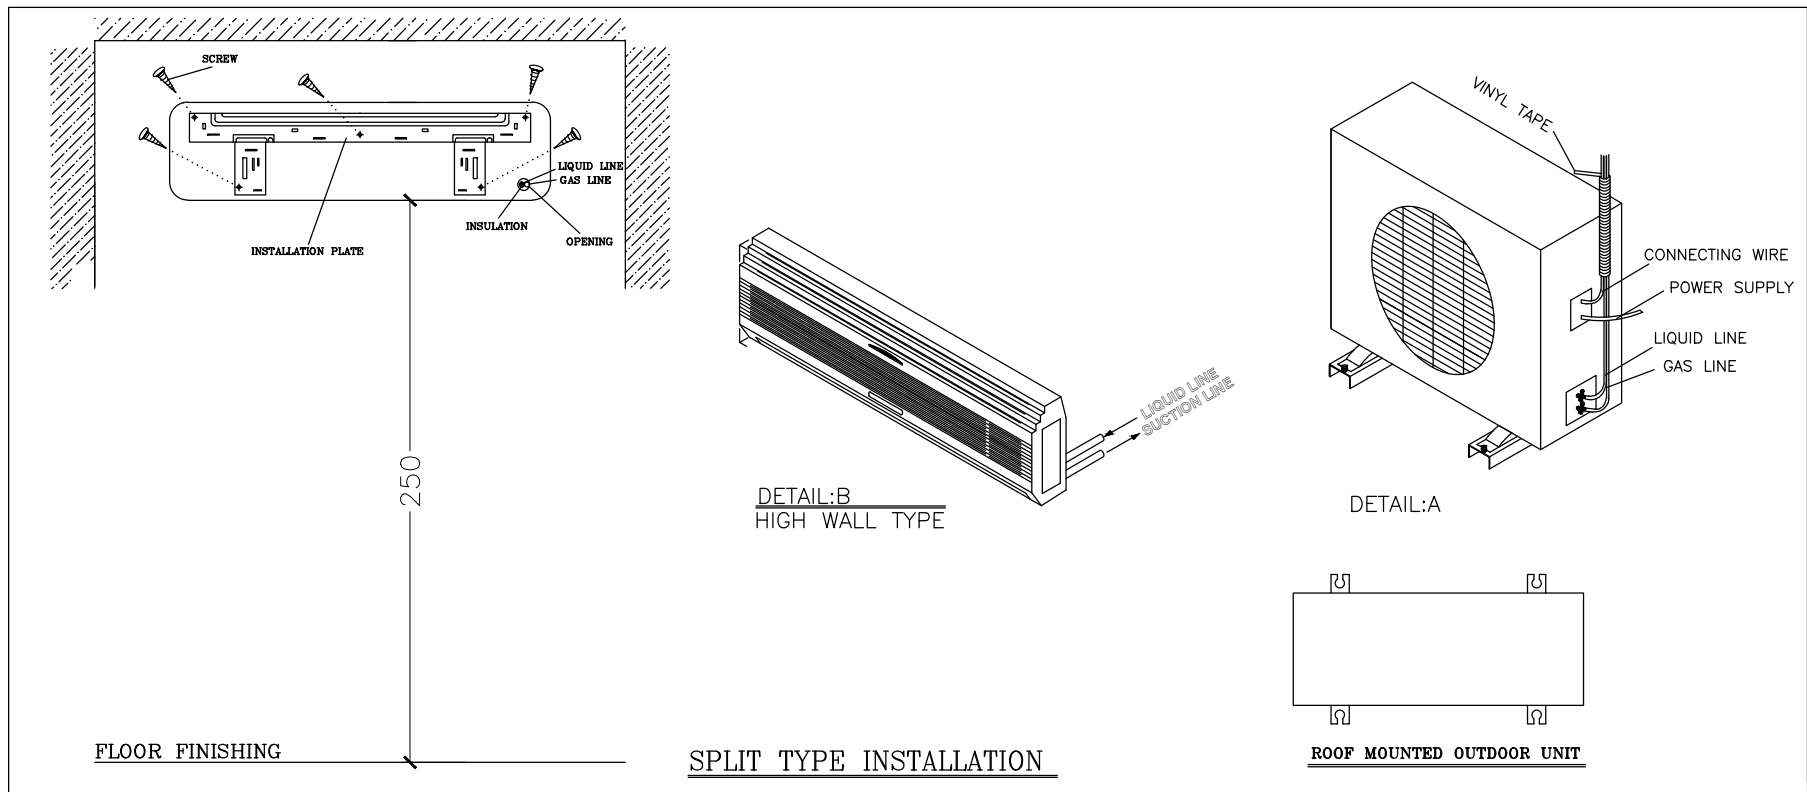[illegible]