


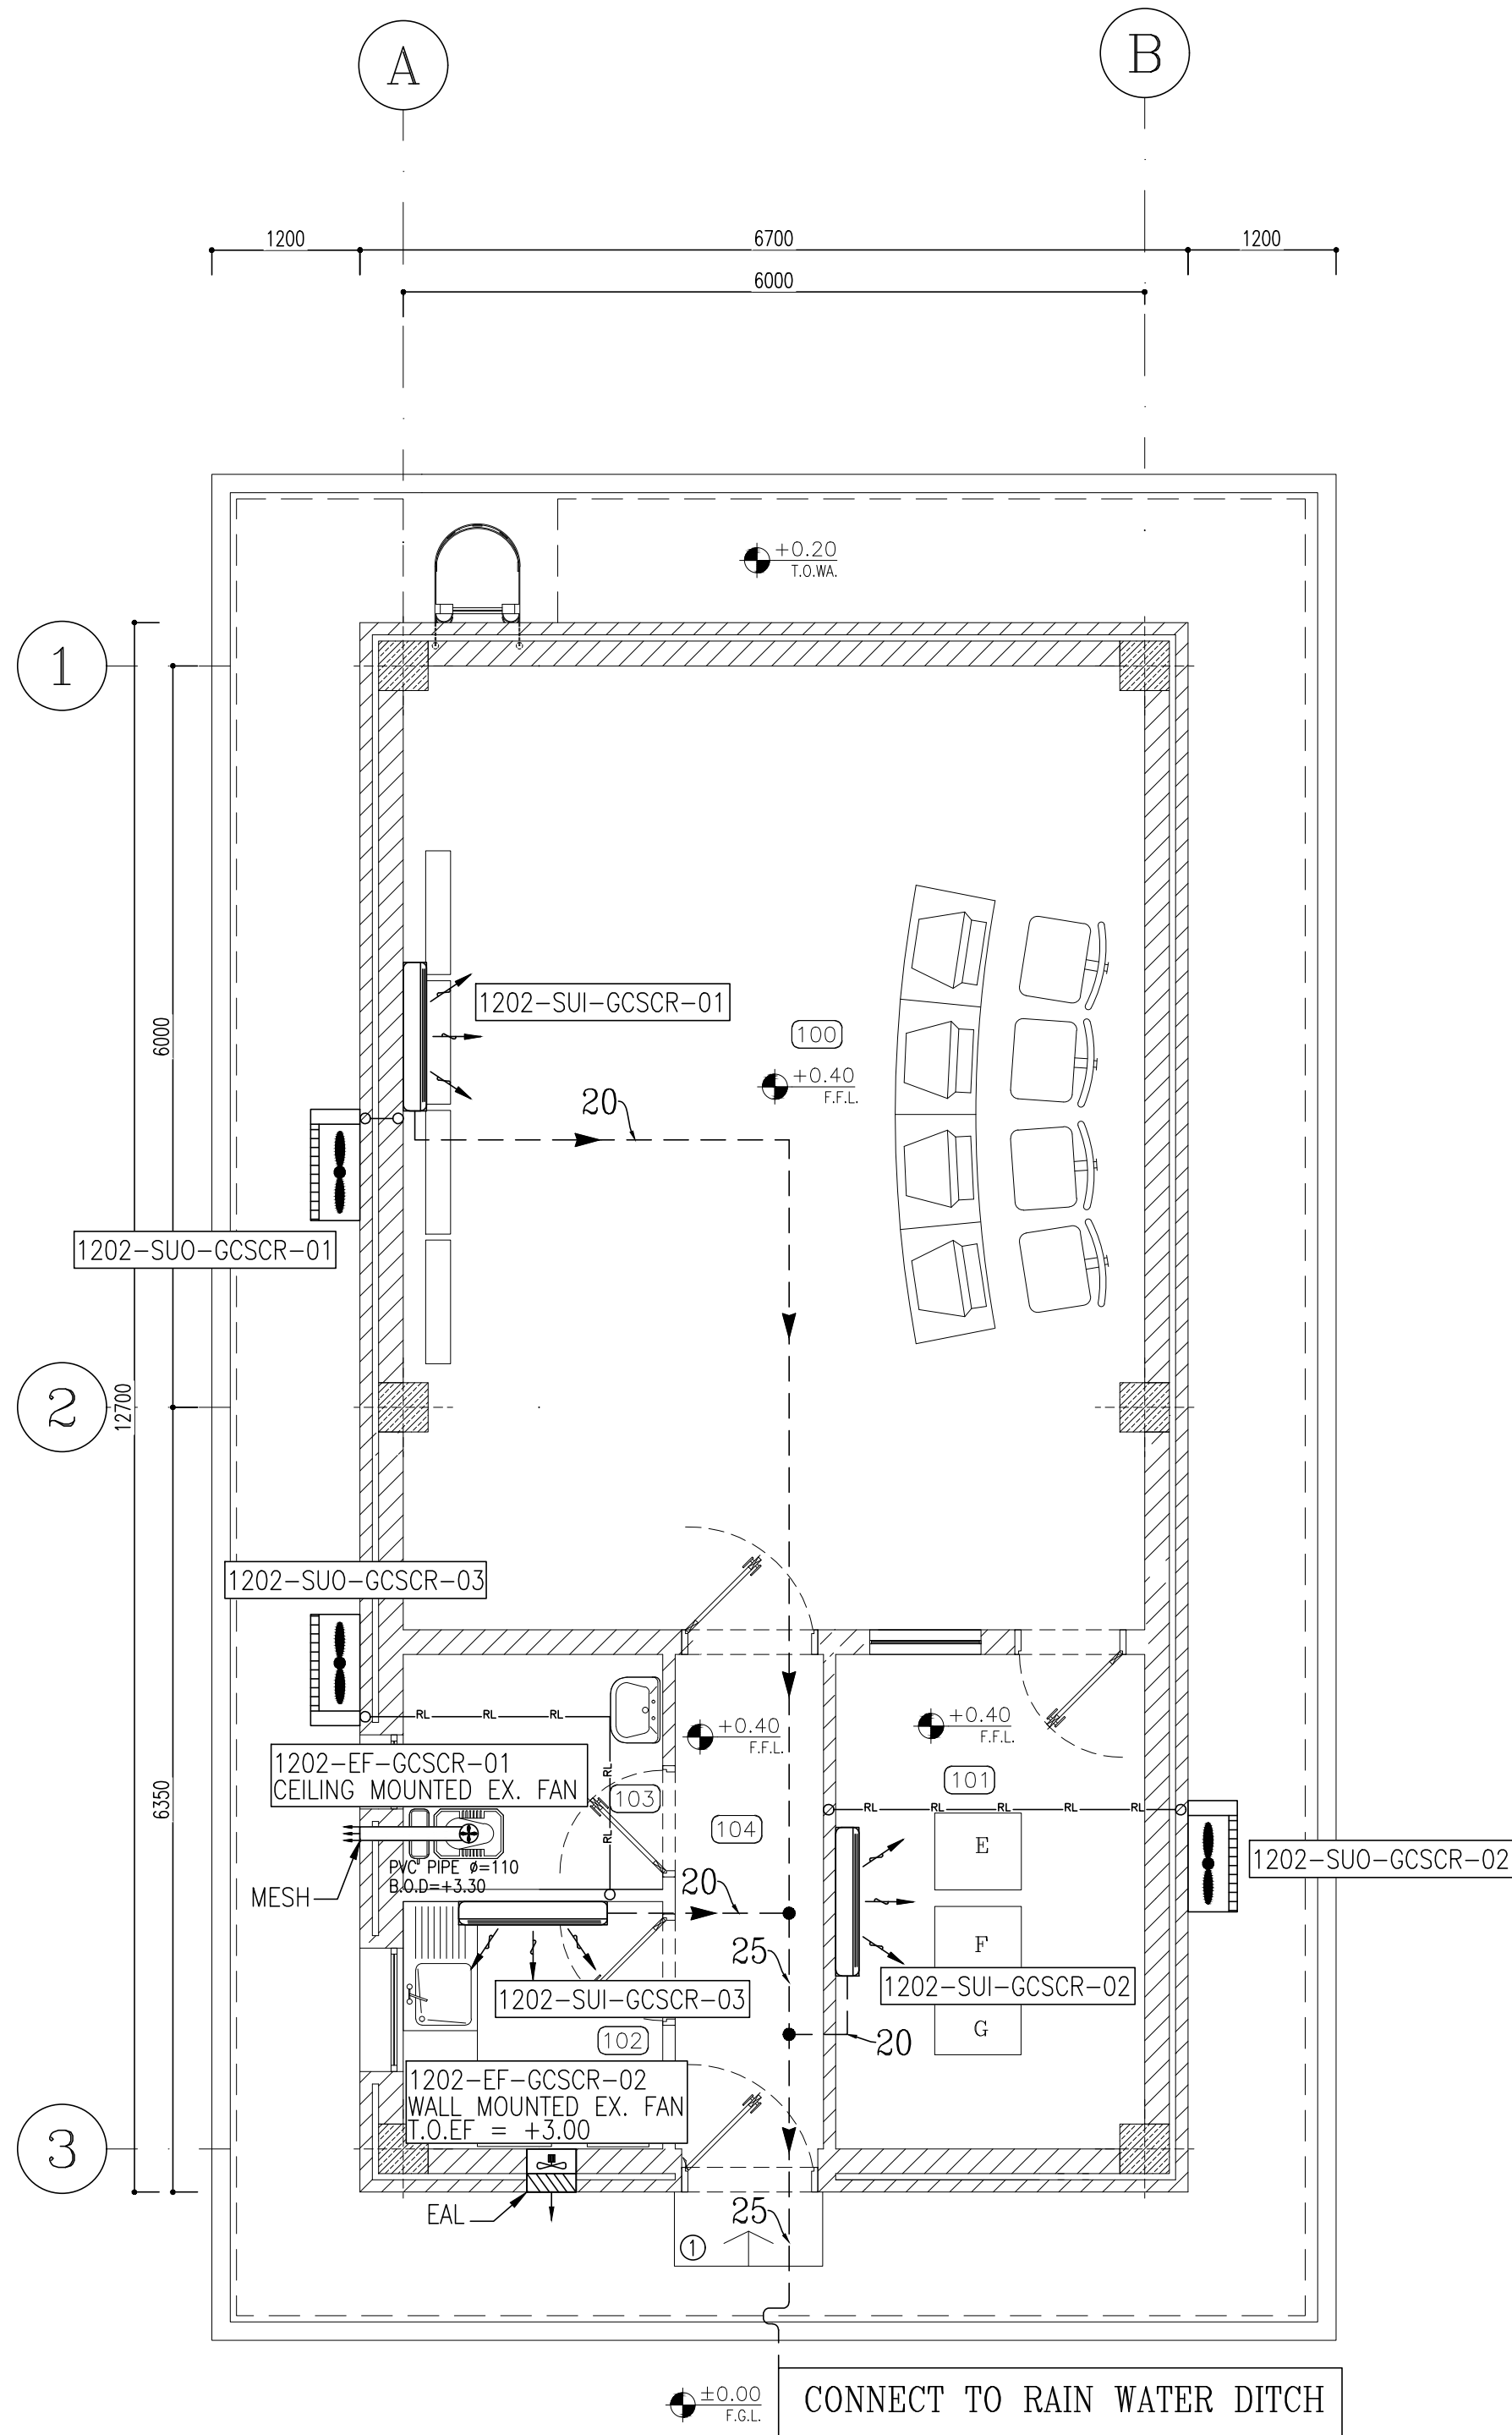

# 1 FLOOR PLAN HVAC System Layout

| EQUIPMENT NO.    | TYPE                    | FLOW (L/S) | TOTAL EXTERNAL<br>PRESSURE DROP* (PA.) | SERVICE AREA | QTY. | REMARK                              |
|------------------|-------------------------|------------|----------------------------------------|--------------|------|-------------------------------------|
| 1202-EF-GCSCR-01 | CEILING MOUNTED EX. FAN | 52.5       | 0.62                                   | WC           | 1    | —                                   |
| 1202-EF-GCSCR-02 | WALL MOUNTED EX. FAN    | 21.8       | —                                      | PANTRY       | 1    | EQUIPPED WITH EXHAUST<br>AIR LOUVER |

|     |              |
|-----|--------------|
| 100 | CONTROL ROOM |
| 101 | RACK ROOM    |
| 102 | PANTRY       |
| 103 | WC           |
| 104 | ENTRANCE     |

[illegible]