


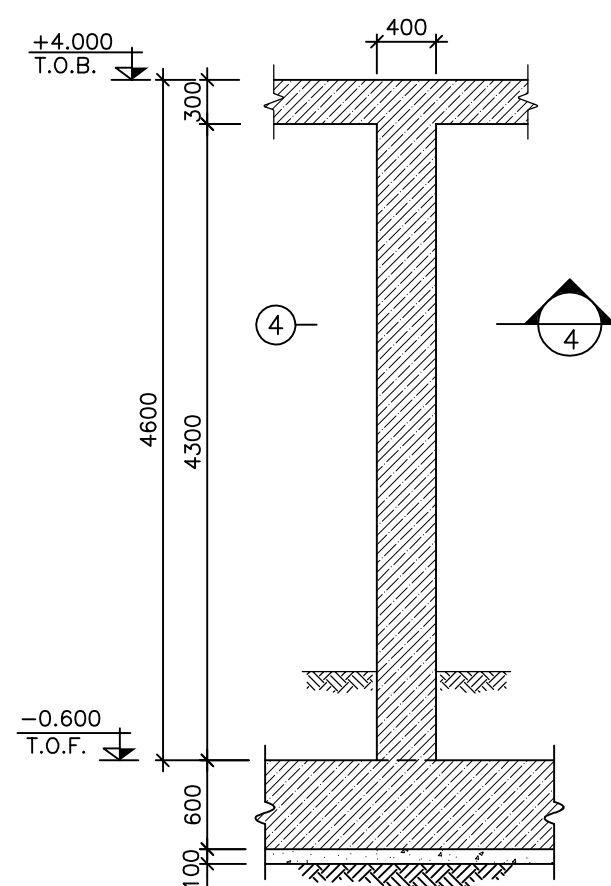
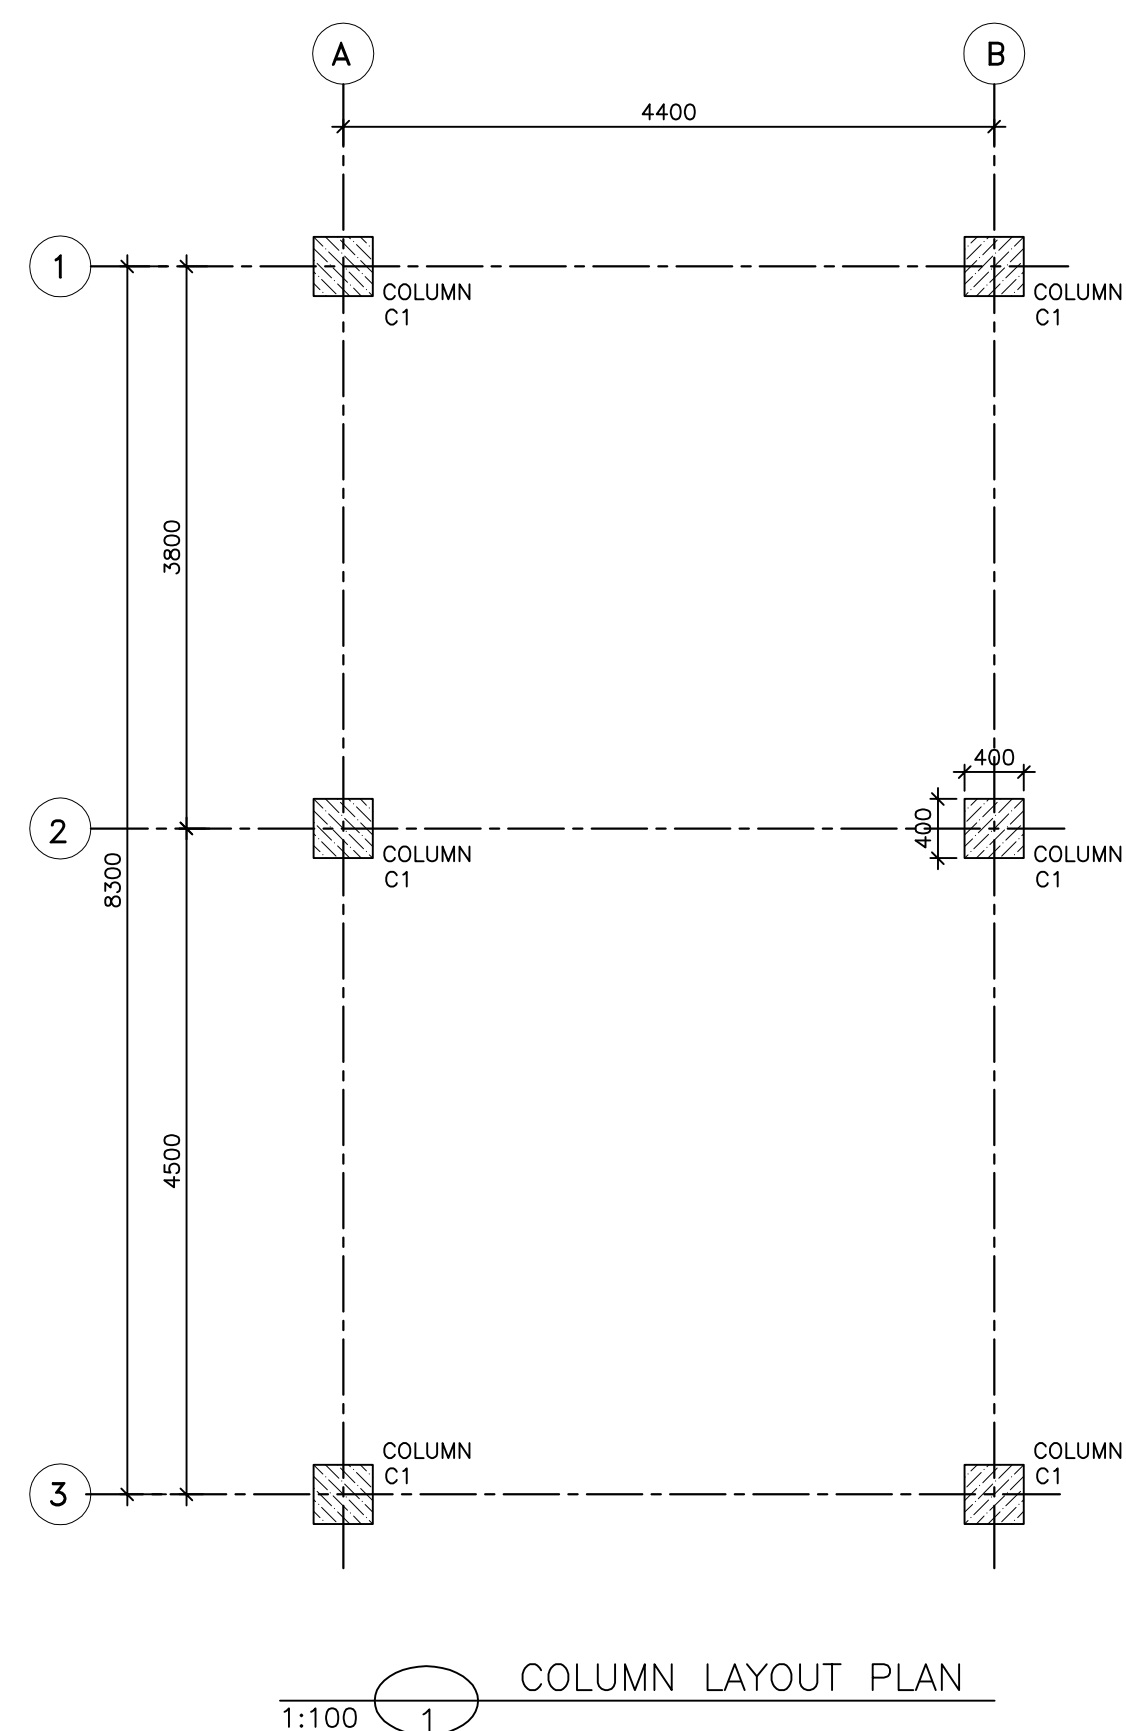
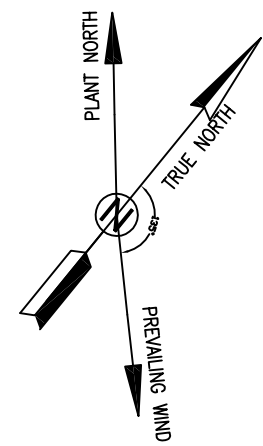


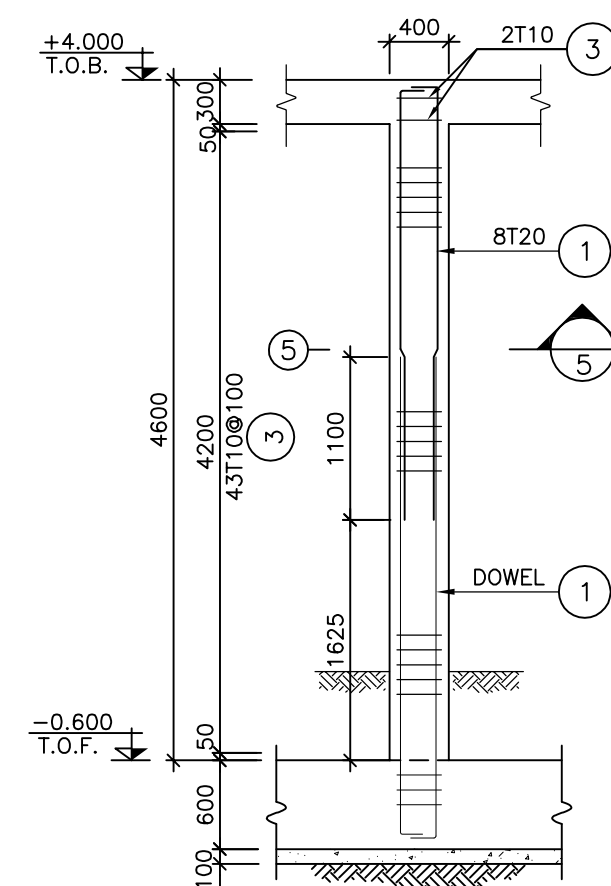

1:50 2 COLUMN TYPE C1
FORMWORK
N=6

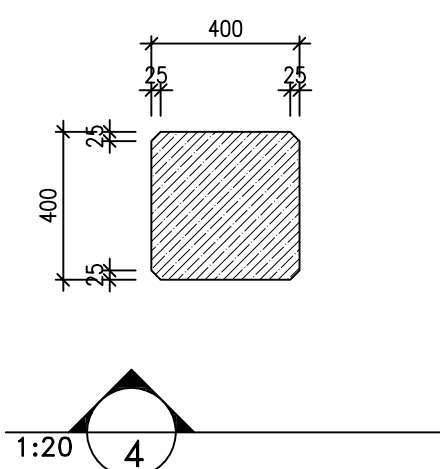

1:50  COLUMN TYPE C1
REINFORCEMENT

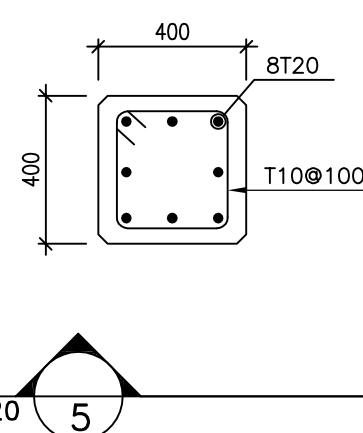

Pos	Spec.	Shape	L/A	No.	T10	T12	T20
1	T20		3.20	48			153.60
2	T10		1.40	270	378.00		
TOTAL LENGTH OR AREA (m/m2)					378.00	---	153.60
UNIT WEIGH (Kg)					0.616	0.887	1.997
WEIGH (Kg)					233.044	---	378.79
GRAND TOTAL (Kg)					≈ 612 Kg.		



- | NOTES | |
|-------|--|
| 1) | ALL ELEVATIONS AND COORDINATES ARE IN "m" AND DIMENSIONS ARE IN "mm" UNLESS OTHERWISE NOTED. |
| 2) | ALL DIMENSIONS AND ELEVATIONS SHALL BE CHECKED BY THE CONTRACTOR PRIOR TO CONSTRUCTION. |
| 3) | ACCORDING TO THE SPECIFICATION OF CONCRETE WORKS:
"bk-GNRL-PEDCO-000-ST-SP-0001",28 DAYS CHARACTERISTIC COMPRESSIVE STRENGTH OF MAIN CONCRETE IS 30 MPa |
| 4) | ACCORDING TO THE SPECIFICATION OF CONCRETE WORKS:
"bk-GNRL-PEDCO-000-ST-SP-0001",28 DAYS CHARACTERISTIC COMPRESSIVE STRENGTH OF LEAN CONCRETE IS 15 MPa |
| 5) | REINFORCING BARS SHALL BE S400 ACCORDING TO: ISIRI3132 AND INBC9 WITH MINIMUM TENSILE YIELD STRENGTH 400 N/mm ² |
| 6) | CONCRETE COVER OVER BARS SHALL BE 75mm FOR FOUNDATION AND 50mm FOR BEAMS & COLUMNS. |
| 7) | UNDERGROUND CONCRETE SHALL BE PROTECTED AND COATED ACCORDING TO RELEVANT SPECIFICATION. |
| 8) | CEMENT TYPE 2 SHALL BE USED ACCORDING TO GEOTECHNICAL REPORT SUGGESTION. |

±0.00 = +26.05(F.G.L)MSL


LEGEND




F.G.L.	: FINISH GROUND LEVEL
T.O.F.	: TOP OF FOUNDATION
B.O.B.	: BOTTOM OF BASEPLATE
T.O.B.	: TOP OF BEAM



 REINFORCED CONCRETE
 LEAN CONCRETE
 GROUND




REFERENCE DRAWING	DRG. No.
ARCHITECTURAL DRAWING FOR SECURITY BUILDING FOR WELLPADS-W007S	BK-W007S-PEDCO-110-AR-DW-0004
FOUNDATION DRAWING FOR SECURITY BUILDING FOR WELLPADS-W007S	BK-W007S-PEDCO-110-ST-DW-0008
GENERAL NOTES-REINFORCED CONCRETE STRUCTURES	BK-GN-RAL-PEDCO-000-ST-DW-0012
STANDARD DRAWING FOR INSERT PLATES IN CONCRETE	BK-GN-RAL-PEDCO-000-ST-DW-0007
PLOT PLAN DRAWING -W007S	BK-W007S-PEDCO-110-PI-PY-0002
GENERAL CIVIL LAYOUT -W007S	BK-W007S-PEDCO-110-CV-PY-0001

KEY PLAN

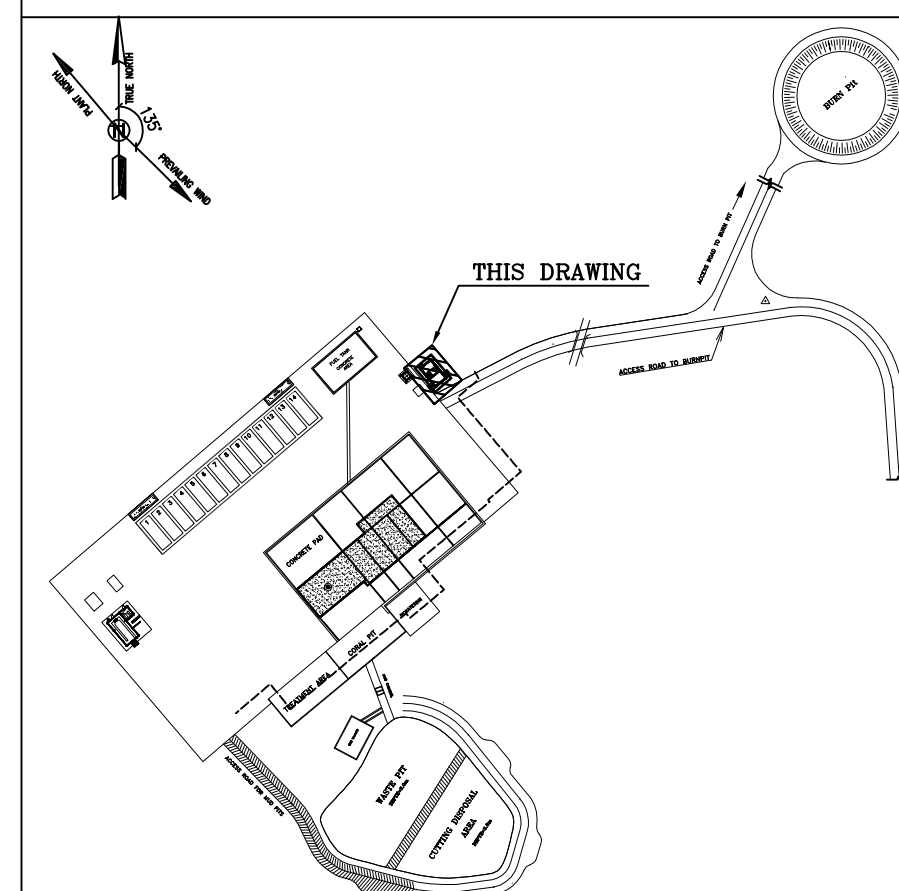[illegible]

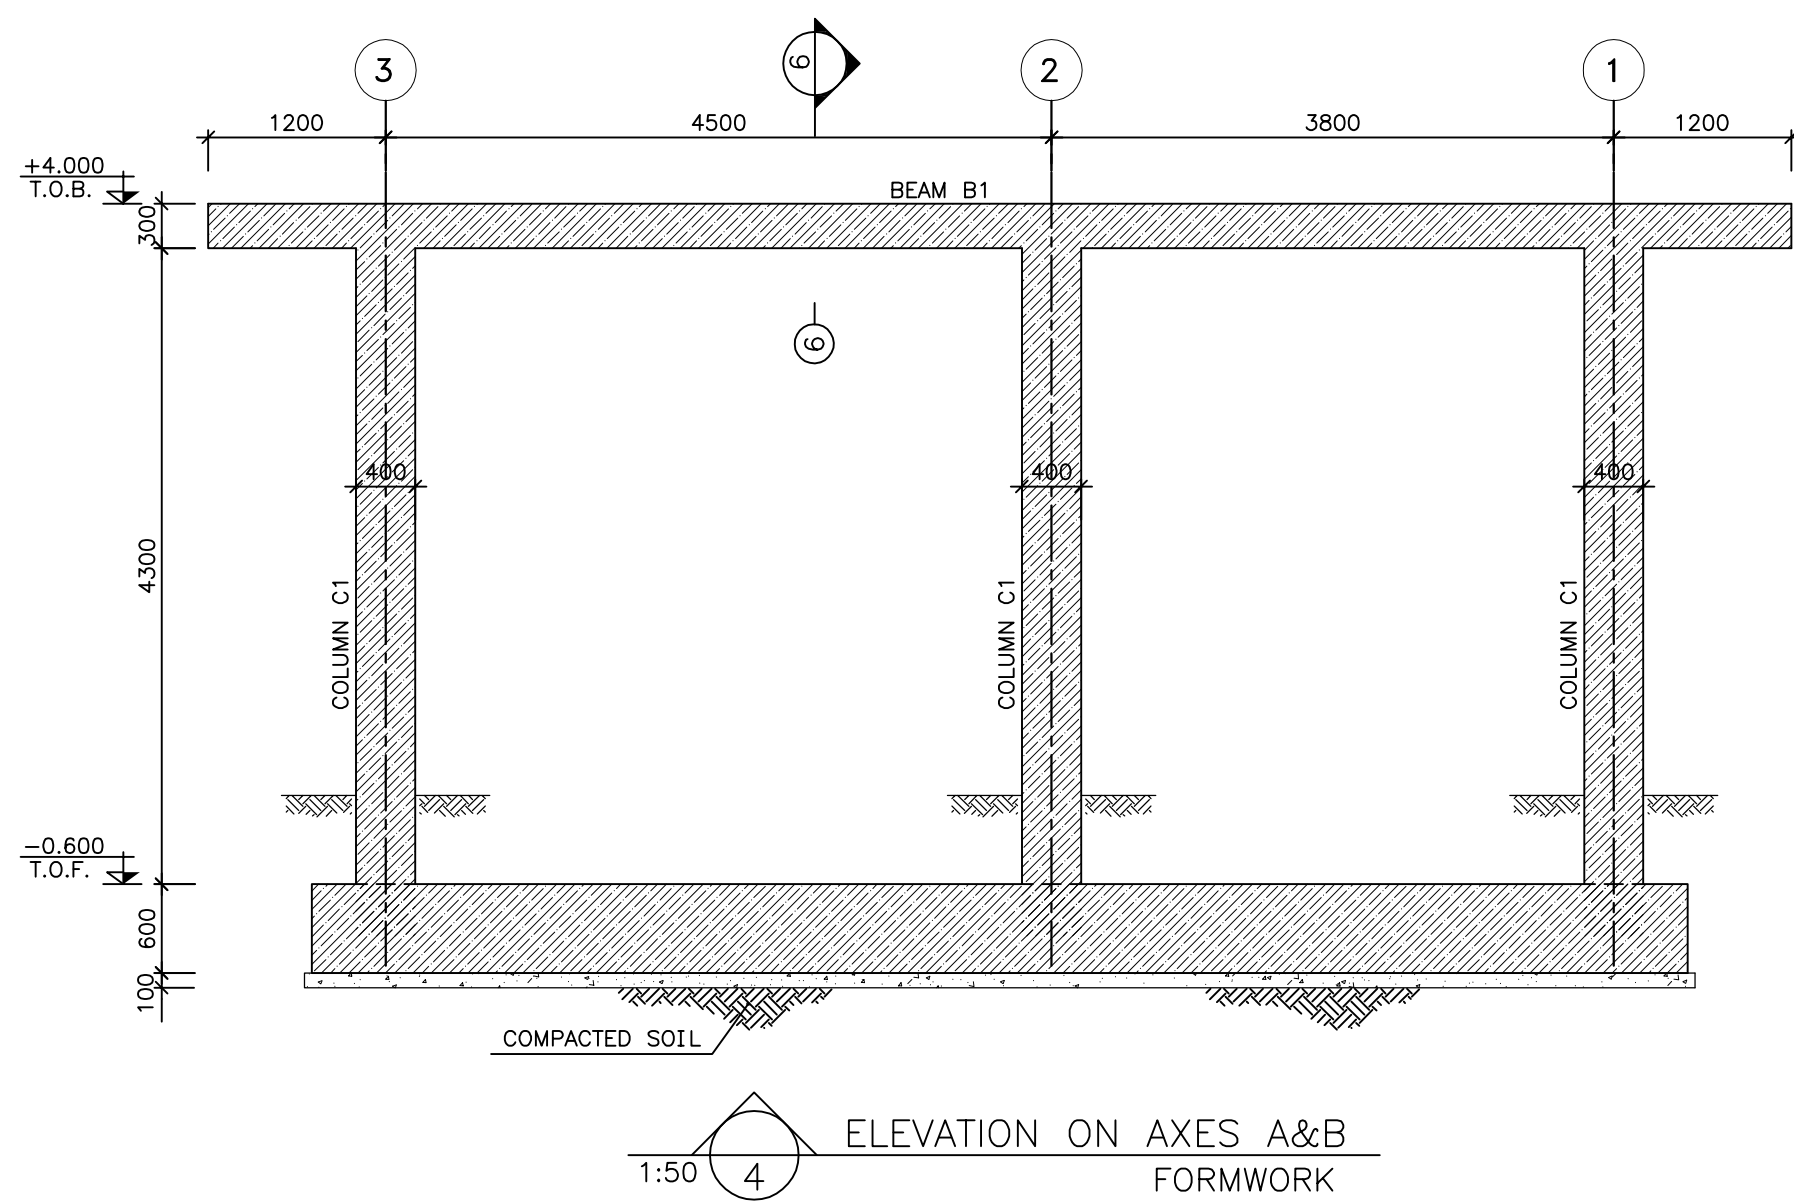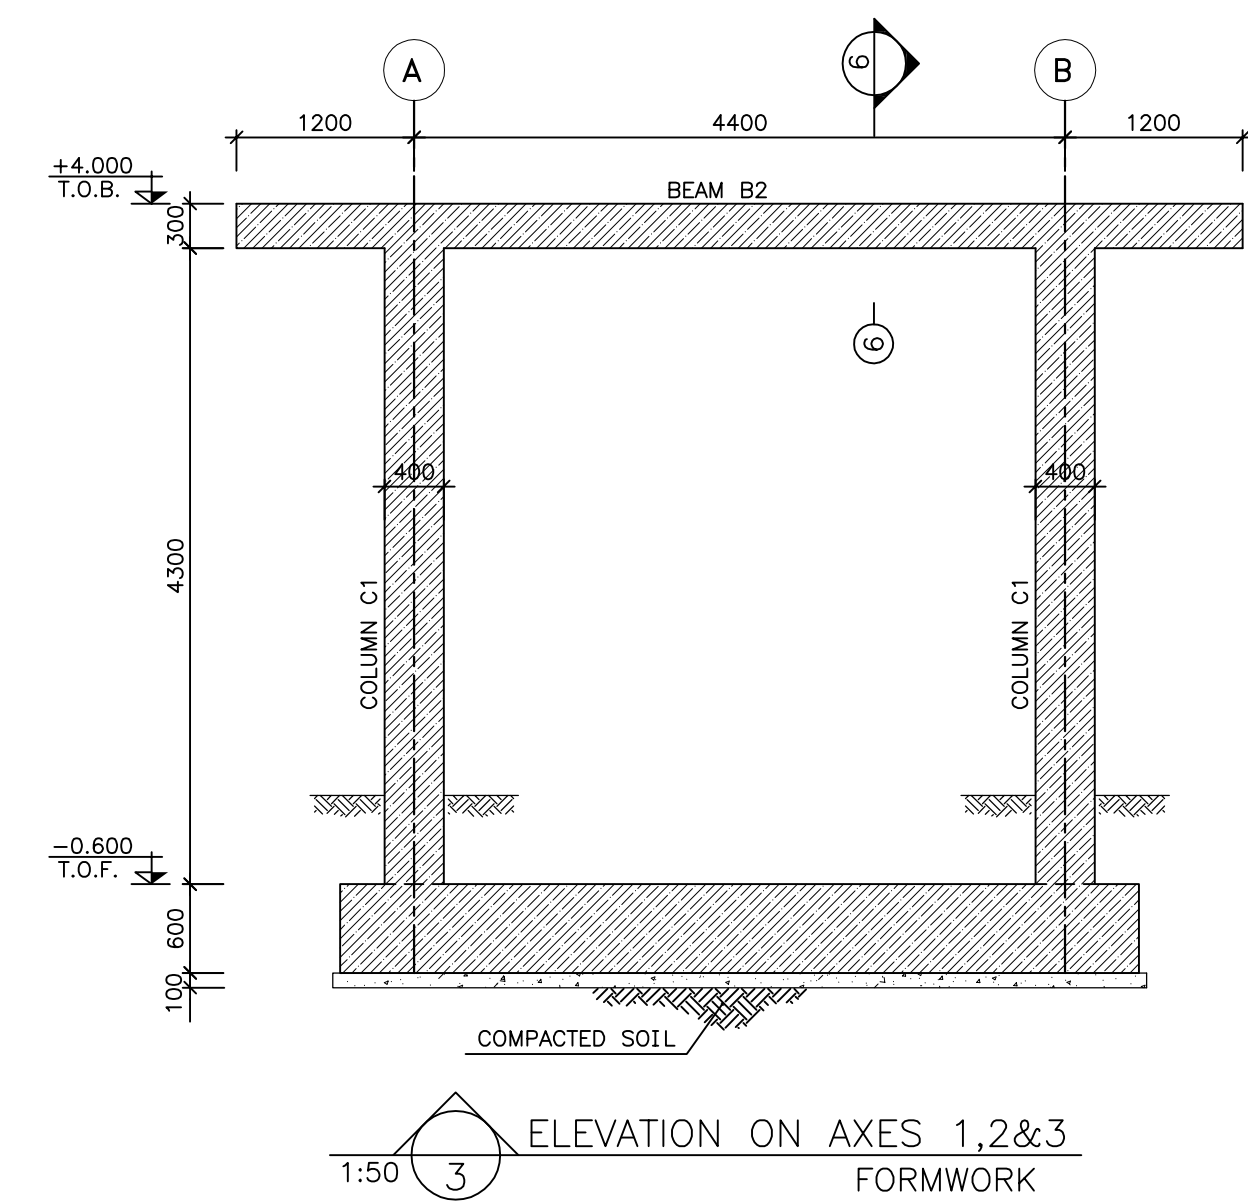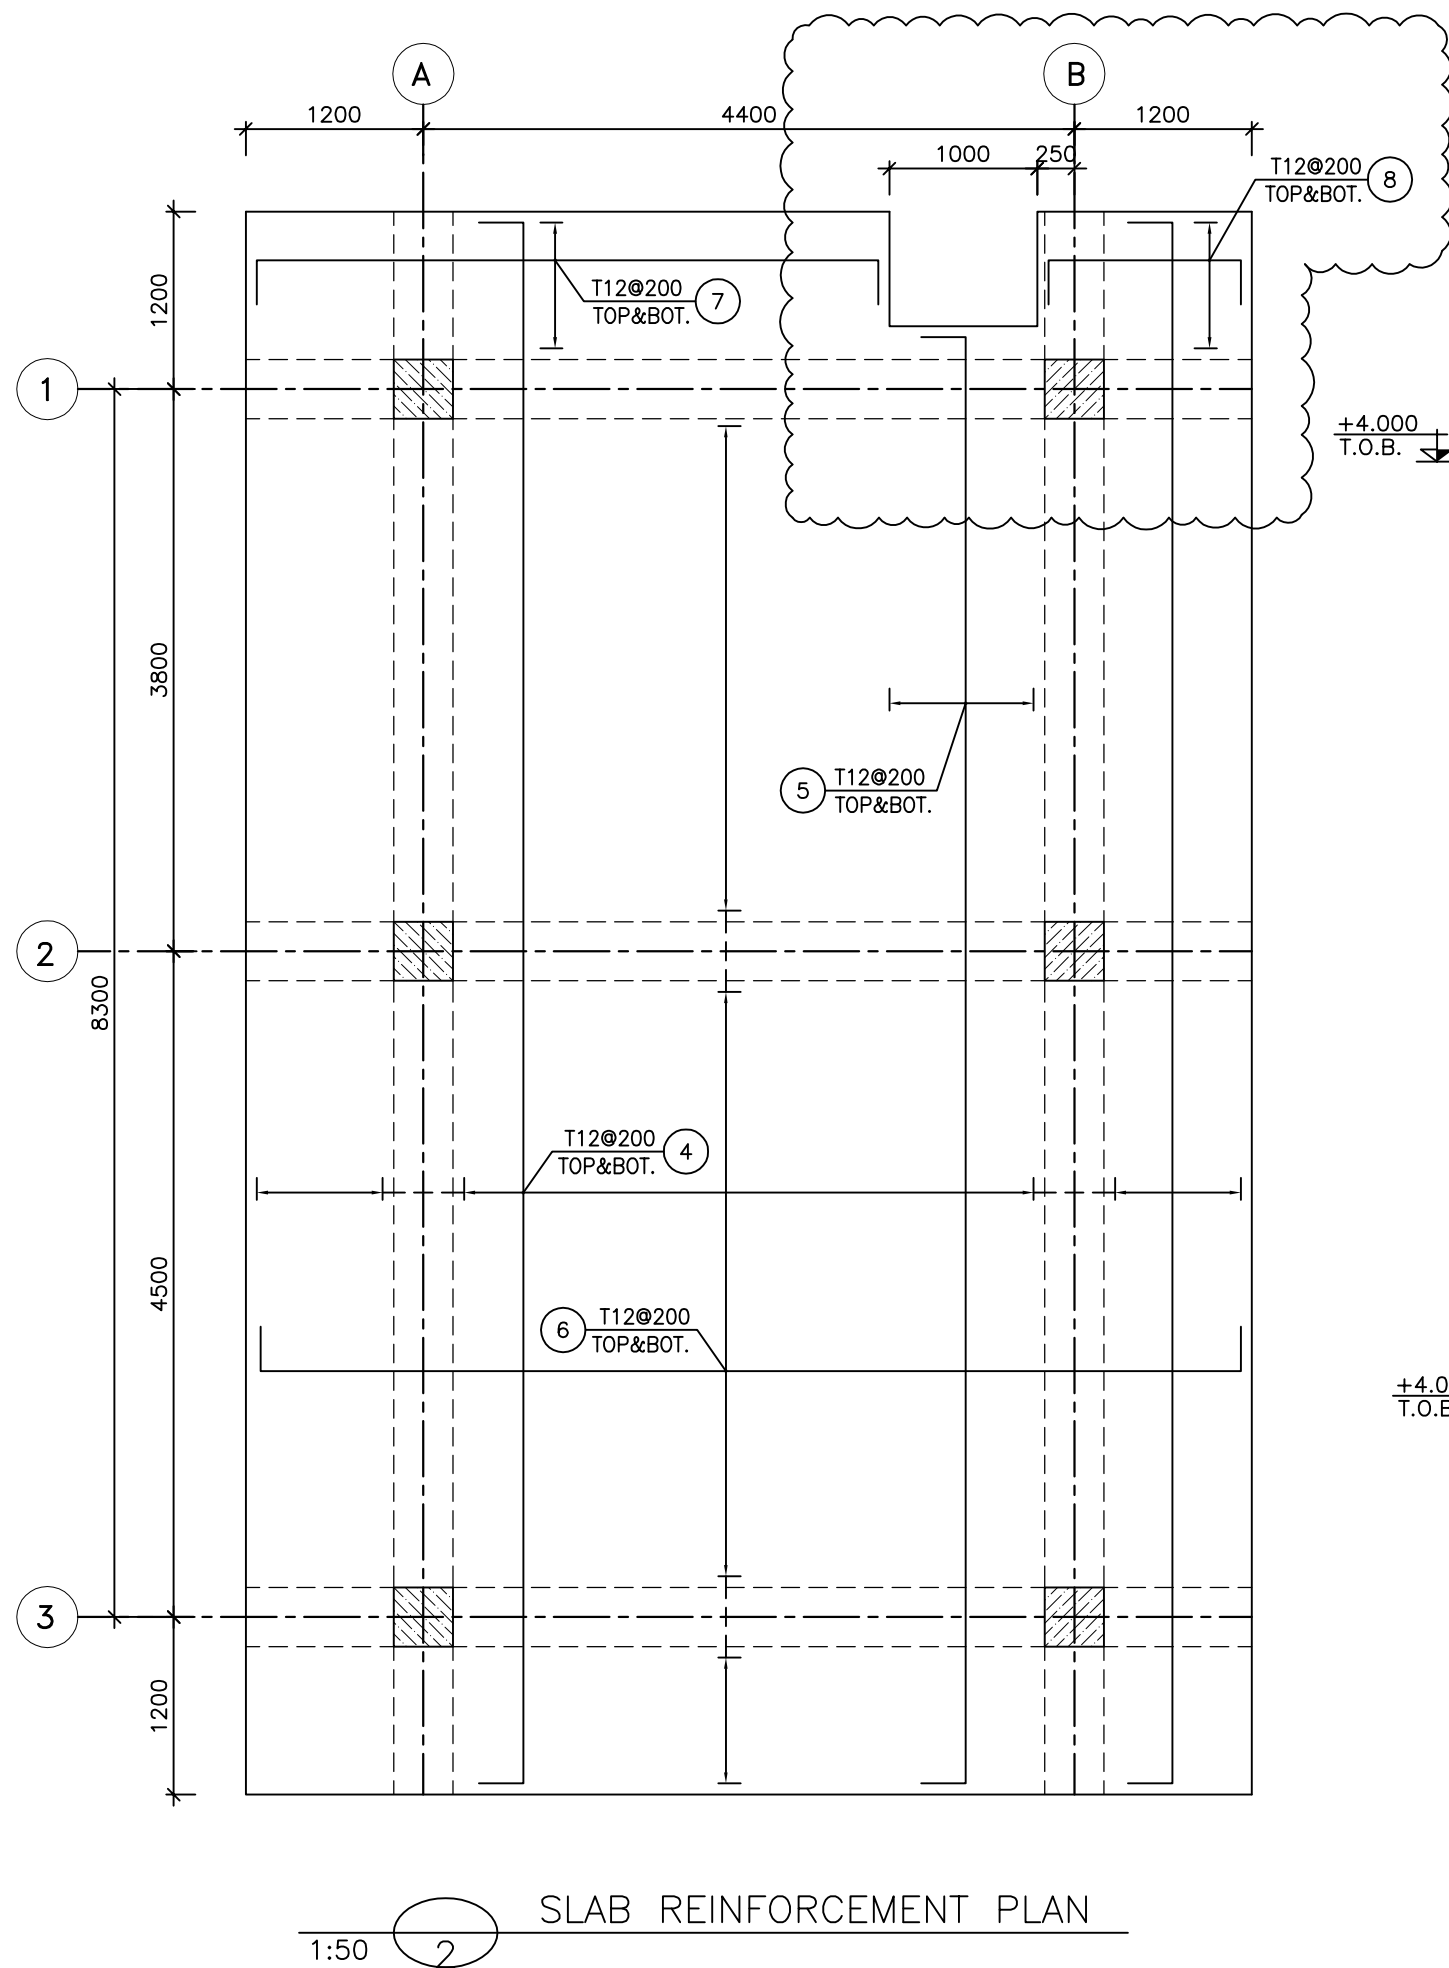

NOTES	
1) ALL ELEVATIONS AND COORDINATES ARE IN "m" AND DIMENSIONS ARE IN "mm" UNLESS OTHERWISE NOTED.	
2) ALL DIMENSIONS AND ELEVATIONS SHALL BE CHECKED BY THE CONTRACTOR PRIOR TO CONSTRUCTION.	
3) ACCORDING TO THE SPECIFICATION OF CONCRETE WORKS: "BK-GNRL-PEDCO-000-ST-SP-0001", 28 DAYS CHARACTERISTIC COMPRESSIVE STRENGTH OF MAIN CONCRETE IS 30 MPa	
4) ACCORDING TO THE SPECIFICATION OF CONCRETE WORKS: "BK-GNRL-PEDCO-000-ST-SP-0001", 28 DAYS CHARACTERISTIC COMPRESSIVE STRENGTH OF LEAN CONCRETE IS 15 MPa	
5) REINFORCING BARS SHALL BE S400 ACCORDING TO: ISIRI3132 AND INBC9 WITH MINIMUM TENSILE YIELD STRENGTH 400 N/mm ²	
6) CONCRETE COVER OVER BARS SHALL BE 75mm FOR FOUNDATION AND 50mm FOR BEAMS & COLUMNS.	
7) UNDERGROUND CONCRETE SHALL BE PROTECTED AND COATED ACCORDING TO RELEVANT SPECIFICATION.	
8) CEMENT TYPE 2 SHALL BE USED ACCORDING TO GEOTECHNICAL REPORT SUGGESTION.	
$\pm 0.00 = +26.05(\text{F.G.L.})\text{MSL}$	
LEGEND	
F.G.L. : FINISH GROUND LEVEL	
T.O.F. : TOP OF FOUNDATION	
B.O.B. : BOTTOM OF BASEPLATE	
T.O.B. : TOP OF BEAM	
 REINFORCED CONCRETE	
 LEAN CONCRETE	
 GROUND	
REFERENCE DRAWING	DRG. No.
ARCHITECTURAL DRAWING FOR SECURITY BUILDING OF WELLPADS-W007S	BK-W007S-PEDCO-110-AR-DW-0004
FOUNDATION DRAWING FOR SECURITY BUILDING FOR WELLPADS-W007S	BK-W007S-PEDCO-110-ST-DW-0008
GENERAL NOTES-REINFORCED CONCRETE STRUCTURES	BK-GNRL-PEDCO-000-ST-DW-0012
STANDARD DRAWING FOR INSERT PLATES IN CONCRETE	BK-GNRL-PEDCO-000-ST-DW-0007
PLOT PLAN DRAWING -W007S	BK-W007S-PEDCO-110-PI-PY-0002
GENERAL CIVIL LAYOUT- W007S	BK-W007S-PEDCO-110-CV-PY-0001

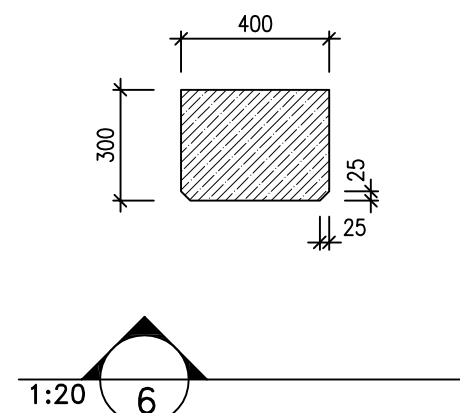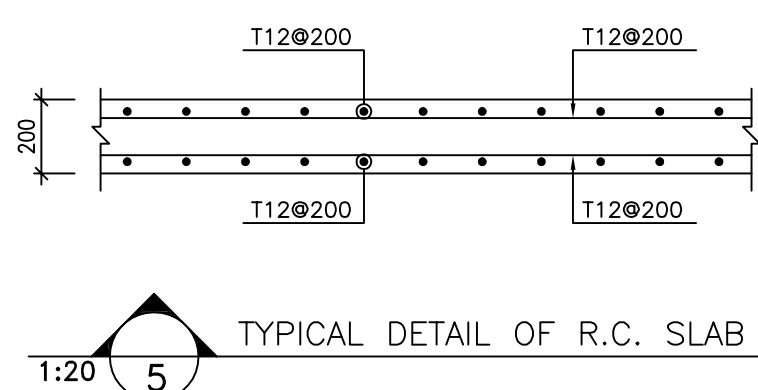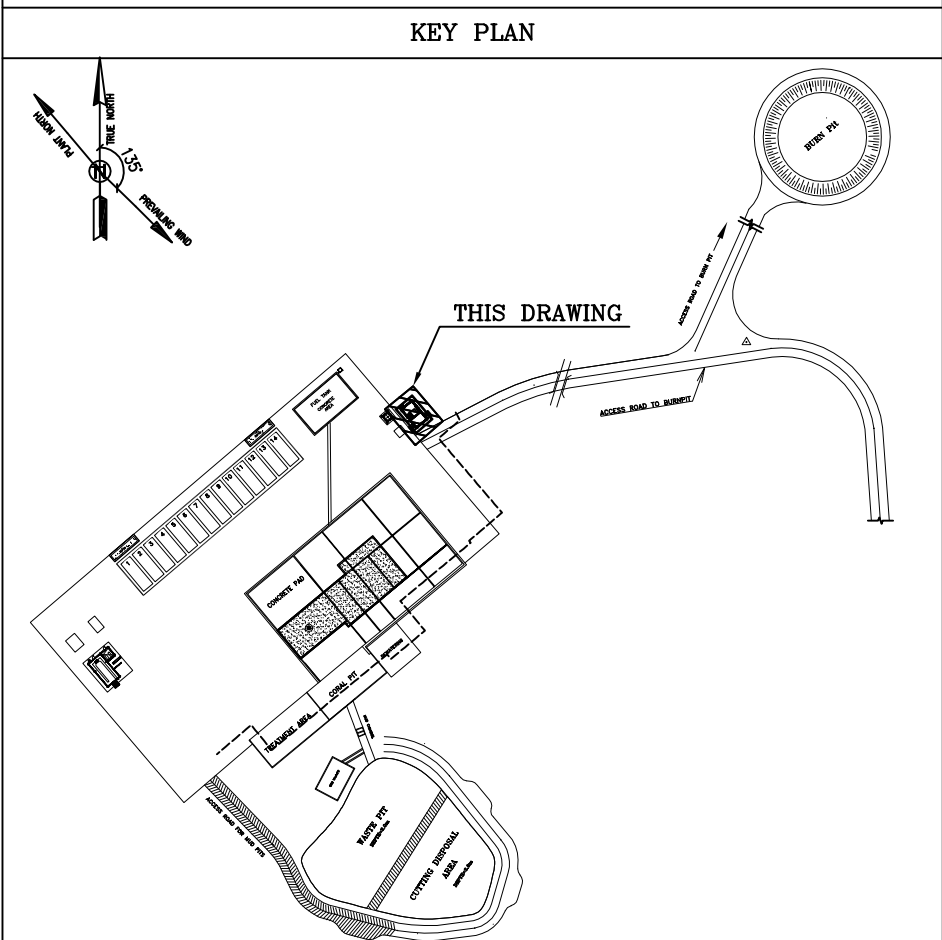[illegible]