



## نگهداشت و افزایش تولید میدان نفتی بینک سطح الارض

#### احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک



شماره پیمان:

## **Calculation Note For CCTV Rack Room- Binak PU**

نسخه	سریال	نوع مدرک	رشته	تسهیلات	صادر کننده	بسته کار
D01	0029	CN	ST	120	PEDCO	GCS

شماره صفحه : 1 از 29

## طرح نگهداری و افزایش تولید 27 مخزن

## **Calculation Note For CCTV Rack Room- Binak PU**

## نگهداشت و افزایش تولید میدان نفتی بینک

D01	JAN. 2024	IFA	R.Berlouie	M.Fakharian	S.Faramarzpour		
D00	OCT. 2023	IFC	R.Berlouie	M.Fakharian	S.Faramarzpour		
Rev.	Date	Purpose of Issue/Status	Prepared by:	Checked by:	Approved by:	CLIENT Approval	
Class:3		COMPANY Reg. Number: F02-700401					

---

**Status:**

- IDC:** Inter-Discipline Check  
**IFC:** Issued For Comment  
**IFA:** Issued For Approval  
**AFD:** Approved For Design  
**AFC:** Approved For Construction  
**AFP:** Approved For Purchase  
**AFQ:** Approved For Quotation  
**IFI:** Issued For Information  
**AB-R:** As-Built for CLIENT Review  
**AB-A:** As-Built –Approved

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 2 از 29

### REVISION RECORD SHEET

PAGE	D00	D01	D02	D03	D04
1	X	X			
2	X	X			
3	X				
4	X				
5	X				
6	X				
7	X				
8	X	X			
9	X				
10	X				
11	X				
12	X				
13	X				
14	X				
15	X				
16	X				
17	X				
18	X				
19	X				
20	X				
21	X	X			
22	X	X			
23	X	X			
24	X				
25	X				
26	X	X			
27	X	X			
28	X	X			
29	X				
30					
31					
32					
33					
34					
35					
36					
37					
38					
39					
40					
41					
42					
43					
44					
45					
46					
47					
48					
49					
50					
51					
52					
53					
54					
55					
56					
57					
58					
59					
60					
61					
62					
63					
64					
65					

PAGE	D00	D01	D02	D03	D04
66					
67					
68					
69					
70					
71					
72					
73					
74					
75					
76					
77					
78					
79					
80					
81					
82					
83					
84					
85					
86					
87					
88					
89					
90					
91					
92					
93					
94					
95					
96					
97					
98					
99					
100					
101					
102					
103					
104					
105					
106					
107					
108					
109					
110					
111					
112					
113					
114					
115					
116					
117					
118					
119					
120					
121					
122					
123					
124					
125					
126					
127					
128					
129					
130					

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 3 از 29

## CONTENTS

<b>1.0 INTRODUCTION .....</b>	<b>5</b>
<b>2.0 SCOPE.....</b>	<b>6</b>
<b>3.0 NORMATIVE REFERENCES.....</b>	<b>6</b>
3.1 LOCAL CODES AND STANDARDS .....	6
3.2 INTERNATIONAL CODES AND STANDARDS .....	6
3.3 THE PROJECT DOCUMENTS .....	6
3.4 ORDER OF PRECEDENCE.....	7
<b>4.0 MATERIAL PROPERTIES .....</b>	<b>7</b>
<b>5.0 COMPUTER SOFTWARE.....</b>	<b>7</b>
<b>6.0 DESIGN INFORMATION.....</b>	<b>7</b>
6.1 STRUCTURE LOCATION .....	7
6.2 ARCHITECTURAL PLANS .....	8
<b>7.0 MATERIAL PROPERTIES .....</b>	<b>9</b>
7.1 REINFORCED CONCRETE .....	9
7.2 STIFFNESS MODIFICATION.....	9
<b>8.0 DESIGN LOADS .....</b>	<b>9</b>
8.1 GENERAL .....	9
<b>9.0 DEAD LOAD .....</b>	<b>10</b>
<b>10.0 LIVE LOAD .....</b>	<b>12</b>
<b>11.0 SNOW LOAD .....</b>	<b>13</b>
<b>12.0 SEISMIC LOAD.....</b>	<b>14</b>
12.1 HORIZONTAL SEISMIC LOAD .....	14
12.2 VERTICAL SEISMIC LOAD.....	15
<b>13.0 REDUNDANCY FACTOR <math>\rho</math> .....</b>	<b>16</b>
<b>14.0 LOADING TABLE .....</b>	<b>17</b>
<b>15.0 LOAD COMBINATIONS.....</b>	<b>18</b>
<b>16.0 STRUCTURE ANALYSIS AND DESIGN .....</b>	<b>20</b>
<b>17.0 STRUCTURAL DESIGN RESULTS .....</b>	<b>21</b>
<b>18.0 DRIFT CONTROL .....</b>	<b>22</b>
<b>19.0 JOIST SHEAR CAPACITY RATIO CONTROL .....</b>	<b>23</b>
<b>20.0 STRONG COLUMN-WEAK BEAM REQUIREMENTS IN SPECIAL CONCRETE MOMENT FRAME.....</b>	<b>23</b>
<b>21.0 FOUNDATION DESIGN AND RESULTS .....</b>	<b>24</b>

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 4 از 29

21.1	FOUNDATION MODEL .....	24
21.2	SOIL CHARACTERISTIC .....	24
21.3	LOADS .....	26
21.4	SETTLEMENT CONTROL.....	26
21.5	SOIL PRESSURE CONTROL .....	27
21.6	PUNCHING SHEAR CONTROL .....	28
21.7	FOUNDATION DESIGN .....	28

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>																
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b> <table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th>بروزه</th><th>بسته کاری</th><th>صادرکننده</th><th>تسهیلات</th><th>دشته</th><th>نوع مدرک</th><th>سربال</th><th>نسخه</th></tr> <tr> <th>BK</th><th>GCS</th><th>PEDCO</th><th>120</th><th>ST</th><th>CN</th><th>0029</th><th>D01</th></tr> </thead> </table>	بروزه	بسته کاری	صادرکننده	تسهیلات	دشته	نوع مدرک	سربال	نسخه	BK	GCS	PEDCO	120	ST	CN	0029	D01	شماره صفحه : 5 از 29
بروزه	بسته کاری	صادرکننده	تسهیلات	دشته	نوع مدرک	سربال	نسخه											
BK	GCS	PEDCO	120	ST	CN	0029	D01											

## 1.0 INTRODUCTION

Binak oilfield in Bushehr province is a part of the southern oilfields of Iran, is located 20 km northwest of Genaveh city.

With the aim of increasing production of oil from Binak oilfield, an EPC/EPD Project has been defined by NIOC/NISOC and awarded to Petro Iran Development Company (PEDCO). Also PEDCO (as General Contractor) has assigned the EPC-packages of the Project to "Hirgan Energy - Design and Inspection" JV.

As a part of the Project, a New Gas Compressor Station (adjacent to existing Binak GCS) shall be constructed to gather of 15 MMSCFD (approx.) associated gases and compress & transfer them to Siahmakan GIS.

### **GENERAL DEFINITION**

The following terms shall be used in this document.

<b>CLIENT:</b>	National Iranian South Oilfields Company (NISOC)
<b>PROJECT:</b>	Binak Oilfield Development – Surface Facilities; New Gas Compressor Station
<b>EPD/EPC CONTRACTOR (GC):</b>	Petro Iran Development Company (PEDCO)
<b>EPC CONTRACTOR:</b>	Joint Venture of : Hirgan Energy – Design & Inspection (D&I) Companies
<b>VENDOR:</b>	The firm or person who will fabricate the equipment or material.
<b>EXECUTOR:</b>	Executor is the party which carries out all or part of construction and/or commissioning for the project.
<b>THIRD PARTY INSPECTOR (TPI):</b>	The firm appointed by EPD/EPC CONTRACTOR (GC) and approved by CLIENT (in writing) for the inspection of goods.
<b>SHALL:</b>	Is used where a provision is mandatory.
<b>SHOULD:</b>	Is used where a provision is advisory only.
<b>WILL:</b>	Is normally used in connection with the action by CLIENT rather than by an EPC/EPD CONTRACTOR, supplier or VENDOR.
<b>MAY:</b>	Is used where a provision is completely discretionary.

 <b>NISOC</b>	<p style="text-align: center;"> <b>نگهداشت و افزایش تولید میدان نفتی بینک</b>  <b>سطح الارض</b>  <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b> </p>																	
شماره پیمان: 053 - 073 - 9184	<p style="text-align: center;"><b>Calculation Note For CCTV Rack Room- Binak PU</b></p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>نامه</th> <th>سریال</th> <th>نوع مدرک</th> <th>رشته</th> <th>تسهیلات</th> <th>صادر کننده</th> <th>بسته کاری</th> <th>بروزه</th> </tr> </thead> <tbody> <tr> <td>D01</td> <td>0029</td> <td>CN</td> <td>ST</td> <td>120</td> <td>PEDCO</td> <td>GCS</td> <td>BK</td> </tr> </tbody> </table>	نامه	سریال	نوع مدرک	رشته	تسهیلات	صادر کننده	بسته کاری	بروزه	D01	0029	CN	ST	120	PEDCO	GCS	BK	شماره صفحه : 6 از 29
نامه	سریال	نوع مدرک	رشته	تسهیلات	صادر کننده	بسته کاری	بروزه											
D01	0029	CN	ST	120	PEDCO	GCS	BK											

## **2.0 SCOPE**

This report covers designing of structure & foundation of the "CCTV Control Room-Binak PU". The structure calculation is performed by "ETABS" & calculation of foundation is performed by "SAFE" software's.

### **3.0 NORMATIVE REFERENCES**

### **3.1 LOCAL CODES AND STANDARDS**

- INBC Part 6 “Iranian National Building Code
  - INBC Part 7 “Iranian National Building Code
  - INBC Part 9 “Iranian National Building Code
  - INBC Part 10 “Iranian National Building Code
  - Iranian Seismic Design Code for Petroleum Facilities(3<sup>rd</sup> edition)

### **3.2 INTERNATIONAL CODES AND STANDARDS**

- ASCE 7-10 “Minimum Design Loads and Associated Criteria for Buildings and Other Structures-American Society of Civil Engineers”.
  - ACI 318 “Building Code Requirements for Reinforced Concrete”, American Concrete Institute.
  - AISC 358 “Prequalified Connections for Special and Intermediate Steel Moment Frames for Seismic Applications.” American Institute of Steel Construction, Inc.
  - AISC 360 “Specification for Structural Steel Buildings”. American Institute of Steel Construction, Inc.

### **3.3 THE PROJECT DOCUMENTS**

- BK-GNRAL-PEDCO-000-ST-SP-0001 Specification for Concrete Work
  - BK-GNRAL-PEDCO-000-ST-DC-0001 Structural Design Criteria
  - BK-GNRAL-PEDCO-000-CV-SP-0004 Specification for Earth Work
  - BK-GCS-PEDCO-120-GT-RT-0001 Geotechnical Investigation Report for Compressor Station
  - BK-GCS-PEDCO-120-AR-DW-0010 Architectural Drawing for CCTV Rack Room-Binak PU

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>																
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b> <table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th>بروزه</th><th>بسته کاری</th><th>صادرکننده</th><th>تسهیلات</th><th>دشته</th><th>نوع مدرک</th><th>سربال</th><th>نسخه</th></tr> <tr> <th>BK</th><th>GCS</th><th>PEDCO</th><th>120</th><th>ST</th><th>CN</th><th>0029</th><th>D01</th></tr> </thead> </table>	بروزه	بسته کاری	صادرکننده	تسهیلات	دشته	نوع مدرک	سربال	نسخه	BK	GCS	PEDCO	120	ST	CN	0029	D01	شماره صفحه : 7 از 29
بروزه	بسته کاری	صادرکننده	تسهیلات	دشته	نوع مدرک	سربال	نسخه											
BK	GCS	PEDCO	120	ST	CN	0029	D01											

### 3.4 ORDER OF PRECEDENCE

In case of any conflict between the contents of this document or any discrepancy between this document and other project documents or reference standards, this issue must be reported to the CLIENT. The final decision in this situation will be made by CLIENT.

## 4.0 MATERIAL PROPERTIES

Material properties are delivered in the following table.

Material properties	
Structure and Foundation concrete	F'c=300 kg/cm <sup>2</sup> (28 days cylindrical sample)
Long. Reinforcement	Fy=4000 kg/cm <sup>2</sup> (AIII)
Trans. Reinforcement	Fy=4000 kg/cm <sup>2</sup> (AIII)

## 5.0 COMPUTER SOFTWARE

Computer's Software, which is used in structure and foundation analysis and design, are defined in the following table.

Computer software	
analysis and design of structure	ETABS 16.2.1
analysis and design of foundation	SAFE 16.0.2

## 6.0 DESIGN INFORMATION

### 6.1 STRUCTURE LOCATION

The CCTV control room is located in Binak oilfield.



نگهداری و افزایش تولید میدان نفتی بینک  
سطح الارض

### احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک



شماره پیمان:  
053 - 073 - 9184

#### Calculation Note For CCTV Rack Room- Binak PU

شماره صفحه: 8 از 29

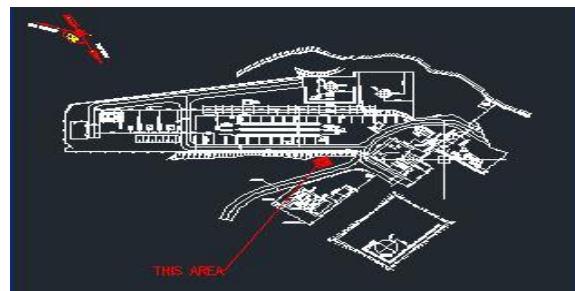


Figure 1: Project Location

## 6.2 ARCHITECTURAL PLANS

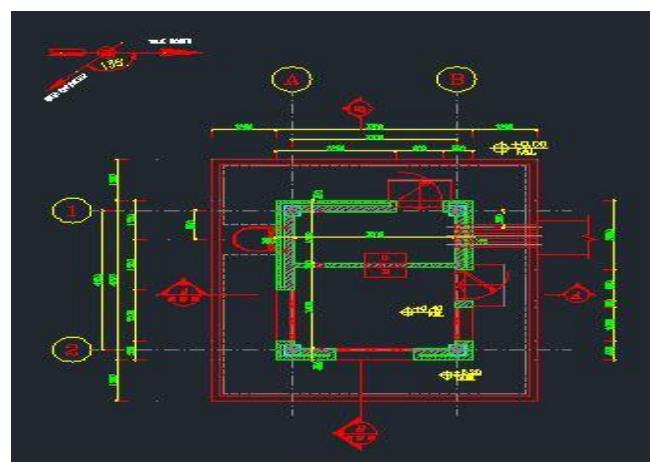


Figure 2: Plan of CCTV control room-PU

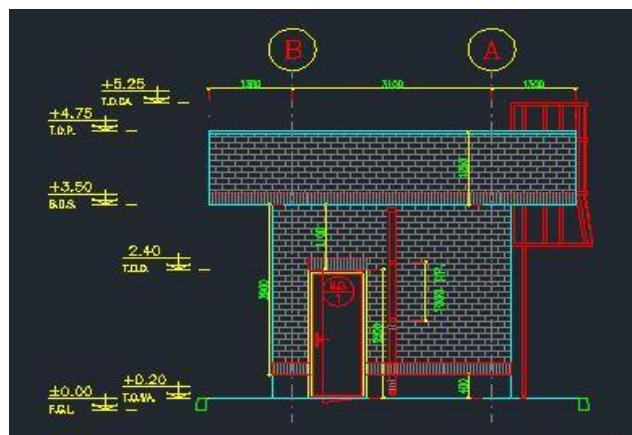


Figure 3: Elevation 1

 NISOC	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 Hirgan Energy																
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>بروزه</th><th>بسته کاری</th><th>صادرکننده</th><th>تسهیلات</th><th>رشته</th><th>نوع مدرک</th><th>سربال</th><th>نسخه</th></tr> <tr> <th>BK</th><th>GCS</th><th>PEDCO</th><th>120</th><th>ST</th><th>CN</th><th>0029</th><th>D01</th></tr> </thead> </table>	بروزه	بسته کاری	صادرکننده	تسهیلات	رشته	نوع مدرک	سربال	نسخه	BK	GCS	PEDCO	120	ST	CN	0029	D01	شماره صفحه : 9 از 29
بروزه	بسته کاری	صادرکننده	تسهیلات	رشته	نوع مدرک	سربال	نسخه											
BK	GCS	PEDCO	120	ST	CN	0029	D01											

## 7.0 MATERIAL PROPERTIES

### 7.1 REINFORCED CONCRETE

Concrete shall generally conform to the specification for Concrete Work, Document No: BK-GNRAL-PEDCO-000-ST-SP-0001. The following properties of concrete are used.

Lean concrete:  $f'c = 150 \text{ kg/cm}^2$

Cast in place concrete:  $f'c = 300 \text{ kg/cm}^2$

Where  $f'c$  is the minimum compressive characteristic strength of a cylinder specimen at 28 days.

Young Modulus of concrete:  $E_c = 15100\sqrt{f'c} \text{ kg/cm}^2 = 261540 \text{ kg/cm}^2$

Poisson's Ratio:  $\nu = 0.2$

Unit weight of reinforced concrete:  $2500 \text{ kg/m}^3$

Reinforcing Steel:  $f_y = 4000 \text{ kg/cm}^2$  (Minimum yield stress)

### 7.2 STIFFNESS MODIFICATION

For analysis of concrete structure, the following modifications for flexural stiffness of elements are considered.

Columns.....0.7Ig

Beams.....0.35Ig

## 8.0 DESIGN LOADS

### 8.1 GENERAL

Structural elements stability and stress checking have been performed considering the following load conditions.

- Dead Load
- Live Load
- Seismic Load
- Snow Load

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 10 از 29

## 9.0 DEAD LOAD

Dead Load is considered as the weight of materials forming a permanent part of the structure plant. The weight of materials of construction incorporated into the building, including but not limited to walls, floors, roofs, ceilings, stairways, built-in partitions, finishes, cladding and other similarly incorporated architectural and structural items, and the weight of fixed service equipment, such as plumbing stacks and risers, electrical feeders, heating, ventilating and air-conditioning systems.

Specific weight of materials which will be used is based on Iranian National Building Code, Part 6, where applicable. Other weights are in accordance with the specifications and/or drawings of vendors and manufacturers.

As it mentioned above the self-weight of structural elements (introduced Dead Load in software) is automatically considered by ETABS program with the specific weights below:

Reinforced Concrete: 2500 kg/m<sup>3</sup>

Structural Steel and Bars: 7850 kg/m<sup>3</sup>

Here is the calculation of design dead load for floors and walls.

- **dead load for parapet wall( for 120cm height) :**

(Pressed brick = 20cm × 1700 = 340 → 340 × 1.2 = 408 kg/m) + (Travertine stone= 2500 × 2cm = 50 → 50 × 1.2 = 60 kg/m) + (mortar = 1cm × 2100 = 21 → 21 × 1.2 = 25.2 kg/m) + (Terrazzo tile (30\*30\*2.5)= 2500 × 2cm = 50 → 50 × 0.3 = 15 kg/m) + (mortar = 1cm × 2100 = 21 → 21 × 0.3 = 6.3 kg/m) + (cement = 3cm × 2100 = 63 → 63 × 1 = 63 kg/m) + (Waterproofing (Isolation or Similar = 15 kg/m<sup>2</sup> × 30cm = 4.5 kg/m) → totally ≈ 585 kg/m

- **dead load for wall (for supper dead load(wall)) :**

(Face Brick = 5cm × 1700 = 85) + (Pressed brick = 20cm × 1700 = 340) + (plaster and soil mortar = 3cm × 1600 = 48) → totally ≈ 475 kg/m<sup>2</sup>

- **dead load for roof :**

(mosaic = 2.5cm × 2250 = 56.5) + (mortar = 2.5cm × 2100 = 52.5) + +( pumice = 9cm × 600 = 54) + (clay block = 8 × 10 = 80) + (facilities = 20) + (waterproofing = 15) → totally ≈ 300 kg/m<sup>2</sup>

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 11 از 29

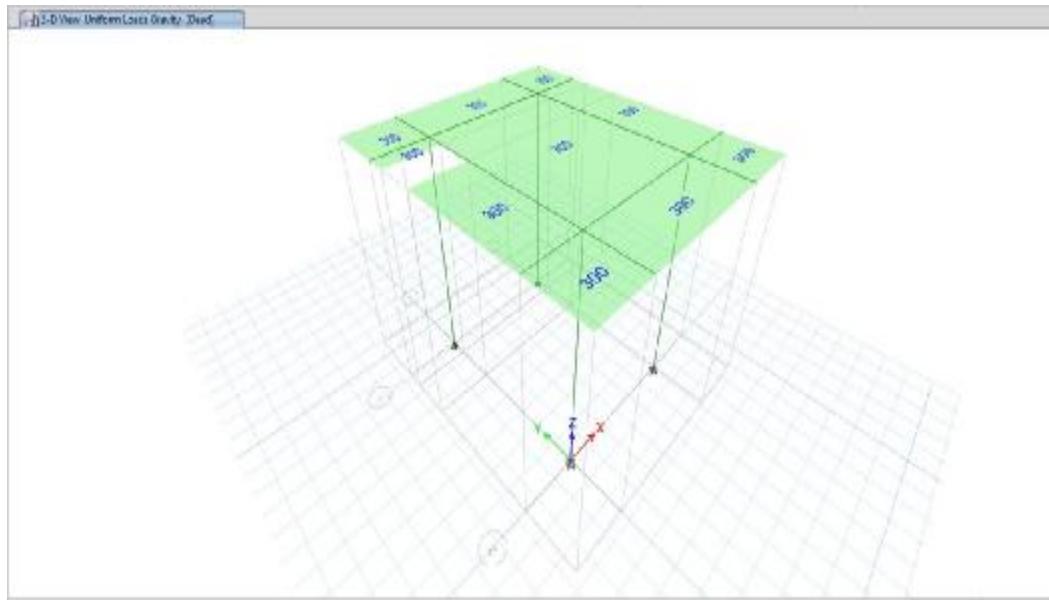


Figure 4: Dead load on roof

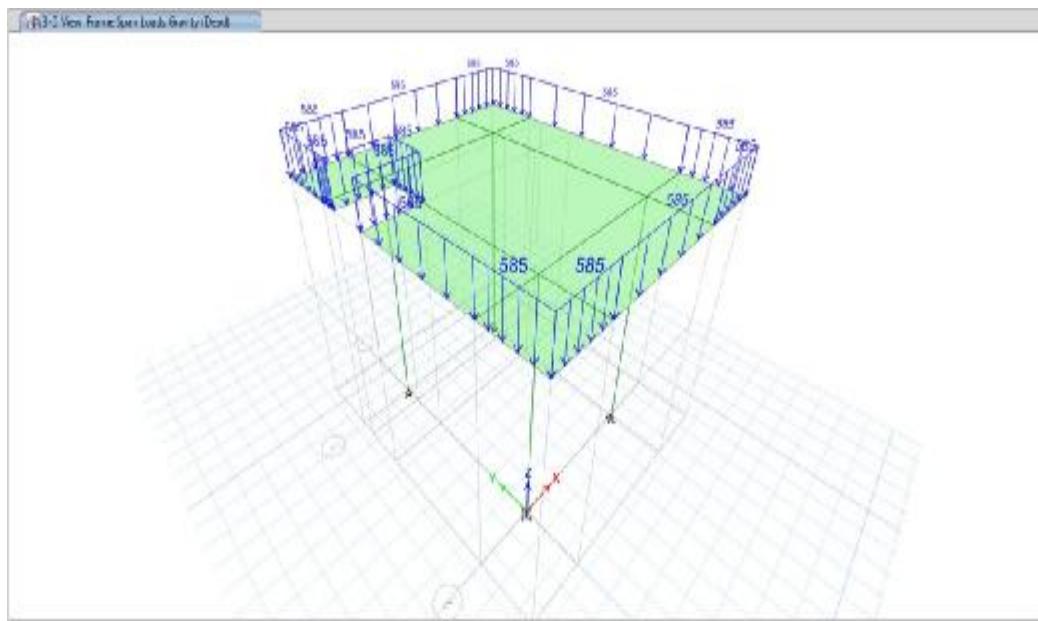


Figure 5: Parapet dead load

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>																
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b> <table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th>پروژه</th><th>بسته کاری</th><th>صادرکننده</th><th>تسهیلات</th><th>رشته</th><th>نوع مدرک</th><th>سربال</th><th>نسخه</th></tr> </thead> <tbody> <tr> <td>BK</td><td>GCS</td><td>PEDCO</td><td>120</td><td>ST</td><td>CN</td><td>0029</td><td>D01</td></tr> </tbody> </table>	پروژه	بسته کاری	صادرکننده	تسهیلات	رشته	نوع مدرک	سربال	نسخه	BK	GCS	PEDCO	120	ST	CN	0029	D01	شماره صفحه : 12 از 29
پروژه	بسته کاری	صادرکننده	تسهیلات	رشته	نوع مدرک	سربال	نسخه											
BK	GCS	PEDCO	120	ST	CN	0029	D01											

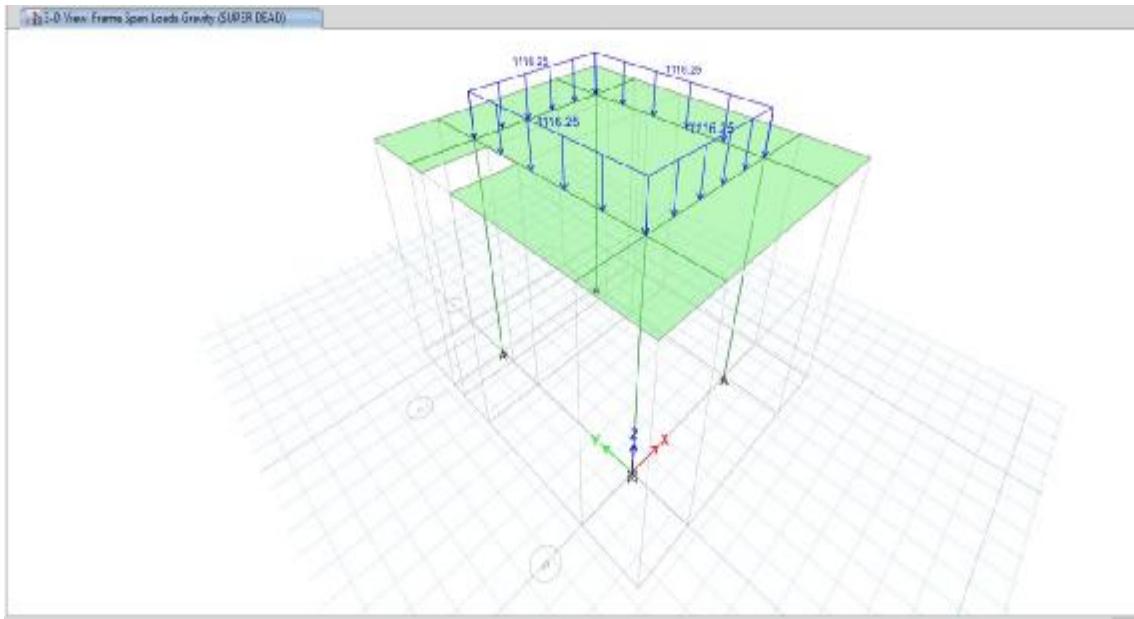


Figure 6: Dead load for wall

## 10.0 LIVE LOAD

Live Load is defined as the weight of all movable loads, including partition walls, personnel, tools, miscellaneous equipment and temporarily stored materials.

Generally where applicable, the live loads shall be in accordance with Iranian National Building Code, Part 6. The Live Loads is generally considered as uniformly distributed over the horizontal projection of the loaded areas, except for the loads with a concentrated nature.

The live load has been considered according to the following table.

Table 1- Live Load

NO.	Level	kg/m <sup>2</sup>
1	Roof	150

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه: 13 از 29

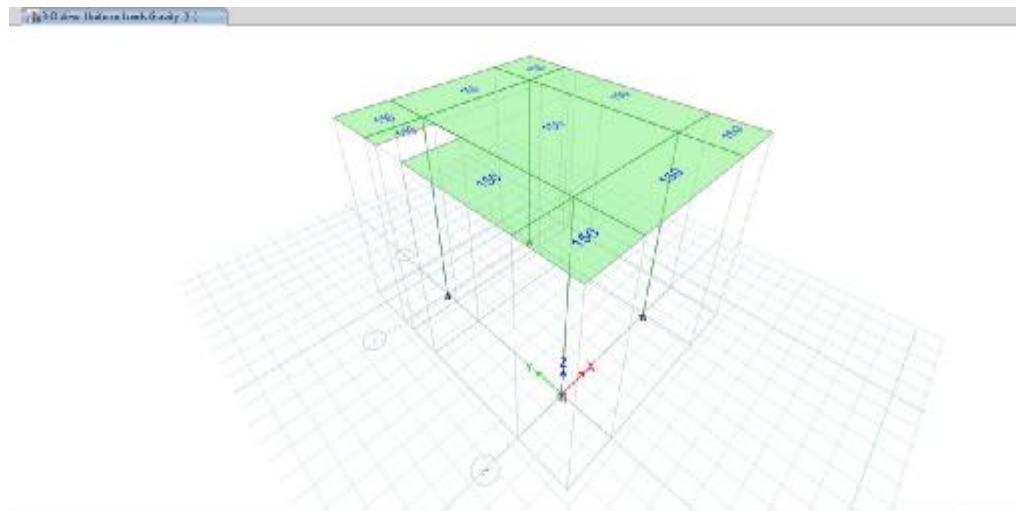


Figure 7: Live load on roof

## 11.0 SNOW LOAD

Snow load of this structure is calculated in accordance with Iranian National Building Code No.6 Latest edition. Parameters which are used in calculation of snow force is presented in below:

$$P_r = I_s \cdot C_n \cdot C_h \cdot C_s \cdot P_s \quad P_s = 25 \text{ kg/m}^2$$

$$I_s = 1, C_n = 1, C_h = 1, C_s = 1 \rightarrow P_r = P_s = 25 \text{ kg/m}^2$$

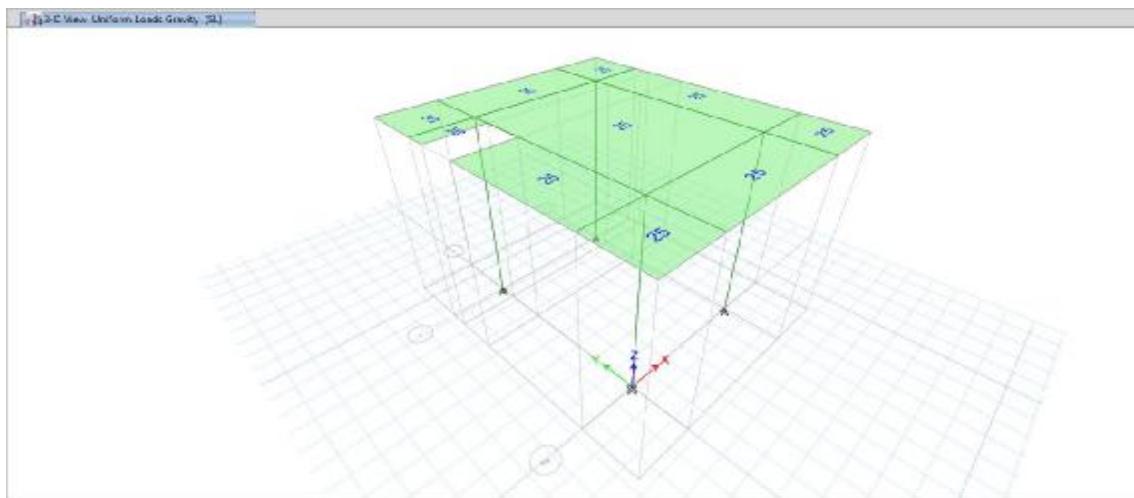


Figure 8: Snow load on roof

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>																	
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b> <table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th>پروژه</th><th>بسته کاری</th><th>بسطه کننده</th><th>تصهیلات</th><th>تسهیلات</th><th>رشته</th><th>نوع مدرک</th><th>سربال</th><th>نسخه</th></tr> <tr> <th>BK</th><th>GCS</th><th>PEDCO</th><th>120</th><th>ST</th><th>CN</th><th>0029</th><th>D01</th></tr> </thead> </table>	پروژه	بسته کاری	بسطه کننده	تصهیلات	تسهیلات	رشته	نوع مدرک	سربال	نسخه	BK	GCS	PEDCO	120	ST	CN	0029	D01	شماره صفحه : 14 از 29
پروژه	بسته کاری	بسطه کننده	تصهیلات	تسهیلات	رشته	نوع مدرک	سربال	نسخه											
BK	GCS	PEDCO	120	ST	CN	0029	D01												

## 12.0 SEISMIC LOAD

### 12.1 HORIZONTAL SEISMIC LOAD

According to Iranian Seismic Design Code for Petroleum Facilities (Pub.038-3<sup>rd</sup> edition) the structure shall be designed for earthquake load in two orthogonal directions.

Base level is defined as the level below which the structure does not move relative to the ground during an earthquake.

Basic parameters which are used in calculation of earthquake forces are presented below.

Following formula is used for calculations according to Iranian Seismic Design Code for Petroleum Facilities (Pub.038-3<sup>rd</sup> edition)

$$V_u = \frac{S_a}{R_u/I} W$$

In which:

$V_u$ : Basic Shear

$S_a$ : Mapped Spectral Response Acceleration Parameter ( $g$ )

$I$ : Importance Factor of Structure

$R_u$ : Structural System Factor

$W$ = Effective Seismic Weight of the structure, including dead loads and other loads, calculated from base level.

 NISOC	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 Hirgan Energy
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 15 از 29

Table 6- Basic Parameters Used for Earthquake Loads

Height of the structure from the base level (m)	4.70
Importance factor, I	1.25
Structural System	Special Moment Frame at Both Direction
Soil type	II
R <sub>u</sub>	8
C <sub>t</sub> (Based on table (4-6) Pub.038)	0.047
X (Based on table (4-6) Pub.038)	0.9
T <sub>x&amp;Y (calculation)</sub> = C <sub>t</sub> · H <sup>x</sup>	0.189
Based on part (4-8-3) Pub.038 : T <sub>x&amp;Y (calculation)</sub>	= 0.189 * 1.4 = 0.265
T <sub>y</sub> (analysis) - mode 2	0.477
T <sub>x</sub> (analysis) - mode 3	0.463
T <sub>x</sub> (select for design)	0.265
T <sub>y</sub> (select for design)	0.265
Sa <sub>x</sub>	0.75
Sa <sub>y</sub>	0.75
C <sub>min</sub> = 0.044S <sub>DS</sub> I	0.04125
C <sub>x</sub> = $\frac{S_{ax}}{R_u/I}$	0.117
C <sub>y</sub> = $\frac{S_{ay}}{R_u/I}$	0.117



SD1	Sa	T0	Ts
0.41	0.750	0.1	0.5

## 12.2 VERTICAL SEISMIC LOAD

E<sub>v</sub> : Vertical seismic load applied at model according to section 2-2-3-2 (code 038)

$$E_v = \alpha S_{DS} D = 0.2 * 0.75 D = 0.15 D$$

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 16 از 29

Load Case Data

بروزه	بسته کاری	صادرکننده	تسهیلات	دشته	نوع مدرک	سربال	نسخه
BK	GCS	PEDCO	120	ST	CN	0029	D01

General

Load Case Name	EV	Design...
Load Case Type	Linear Static	Notes...
Exclude Objects in this Group	Not Applicable	
Mass Source	Mssrc	

P-Delta/Nonlinear Stiffness

<input checked="" type="radio"/> Use Preset P-Delta Settings	Iterative based on loads	Modify/Show...
<input type="radio"/> Use Nonlinear Case (Loads at End of Case NOT Included)	Nonlinear Case	

Loads Applied

Load Type	Load Name	Scale Factor
Load Pattern	Dead	0.15

Add

Delete

OK Cancel

### 13.0 REDUNDANCY FACTOR $\rho$

According to Iranian Seismic Design Code for Petroleum Facilities (Pub.038-3<sup>rd</sup> edition Paragraph 4-6) -  $\rho = 1.0$

 NISOC	<b>نگهداری و افزایش تولید میدان نفتی بینک</b> <b>سطح ارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 Hirgan Energy
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه: 17 از 29

#### 14.0 LOADING TABLE

Loading for structure and foundation for CCTV control room is defined as below table.

TABLE							
Load Pat	Design Type	Self Wt Mult	Auto Load	Not Base Pat	Not Ratio	Not Dir.	
DL	Dead	1					
Lr	Roof Live	0					
EX	Quake	0	USER COEFF				
EY	Quake	0	USER COEFF				
SL	Snow	0					
SUPERDEAD	Dead	0					
T	Temperature	0					
Ev	Quake	0	None				
NotionalX(DL)	Notional	0		DL	0.002	Global X	
NotionalY(DL)	Notional	0		DL	0.002	Global Y	
NotionalX(Lr)	Notional	0		Lr	0.002	Global X	
NotionalY(Lr)	Notional	0		Lr	0.002	Global Y	
NotionalX (SUPERDEAD)	Notional	0		SUPERDEAD	0.002	Global X	
NotionalY (SUPERDEAD)	Notional	0		SUPERDEAD	0.002	Global Y	
Soil	Other	0					

Notional loads must be added with the same coefficient in all combinations of loads that have gravity loads. Although this type is not necessary for concrete building, it has been considered.

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 18 از 29

## 15.0 LOAD COMBINATIONS

For foundations, structures and members of structures, according to structural design criteria & Iranian National Building Code Part 6, the following load combinations have been considered:

- 1) 1.4D
- 2) 1.2D + 1.6L + 0.5 (Lr or S)
- 3) 1.2D + 1.6 (Lr or S) + (L or 0.5(1.6W))
- 4) 1.2D + 1.6 W + L + 0.5 (Lr or S)
- 5) 1.2D+(Eh + Ev)+ L + 0.2S
- 6) 0.9D + 1.6W
- 7) 0.9D + (Eh – Ev)

Load listed herein shall be considered to act in the following combinations; whichever produces the most unfavourable effect considering soil reactions.

 NISOC	<b>نگهداری و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 Hirgan Energy
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه: 19 از 29

Allowable Stress Design:

Category		Load Combination
Category A	Operation Without Wind	1.0(DL+ DLempty + LLop)
		1.0(DL+ DLempty + LLop + LL + TL ± TLst ± FR)
		1.0(DL+ DLempty + LLop + TL ± TLst ± FR) + 0.75LL + 0.75S
	Operation With Wind	1.0(DL+ DLempty + LLop + TL ± FR) ± WL
		1.0(DL+ DLempty + LLop + TL ± FR) + 0.75LL ± 0.75WL
		1.0(DL+ DLempty + LLop + TL ± FR) + 0.75LL ± 0.75WL + 0.75S
Category B	Test	0.6(DL+ DLempty + LLop+TL + FR) ± WL
		1.0(DL+ DLempty + Test) ± 0.25WL
		1.0(DL+ DLempty + Test) + 0.75LL ± 0.25WL + 0.75S
Category C	Erection	0.6(DL+ DLempty + Test) ± 0.25WL
		1.0(DL+ DLempty + ER ± WL)
		1.0(DL+ DLempty + ER) + 0.75LL ± 0.75WL
Category D	Earthquake	0.6(DL+ DLempty + ER) ± WL
		1.0(DL+ DLempty + LLop + TL) ± 0.7EQ
		1.0(DL+ DLempty + LLop + TL) ± 0.525EQ + 0.75LL + 0.75S
Category E	Maintenance	0.6(DL+ DLempty + LLop+TL) ± 0.7EQ
		1.0(DL+ DLempty + ML)
		1.0(DL+ DLempty+ ML) + 0.75LL ± 0.25WL
		0.6(DL+ DLempty+ ML) ± 0.25WL

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 20 از 29

Strength Design:

Category		Load Combination						
Category A	Operation Without Wind	1.4(DL+ DLempty + LLop)						
		1.2(DL+ DLempty + LLop ± FR + TL ± TLst) + 1.6LL						
		1.2(DL+ DLempty + LLop ± FR + TL ± TLst) + 1.6LL + 0.5S						
	Operation With Wind	1.2(DL+ DLempty + LLop ± FR + TL) + 1.0LL ± 1.6WL + 0.5S						
		1.2(DL+ DLempty + LLop ± FR + TL) ± 0.8WL + 1.6S						
		0.9(DL+ DLempty + LLop ± FR + TL) ± 1.6WL						
Category B	Test	1.2(DL+ DLempty + Test) + 1.0LL ± 1.6(0.25WL) + 0.5S						
		1.2(DL+ DLempty + Test) + 1.6LL + 0.5S						
		0.9(DL+ DLempty + Test) ± 1.6(0.25WL)						
Category C	Erection	1.2(DL+ DLempty + ER) + 1.6LL						
		1.2(DL+ DLempty + ER) + 1.0LL ± 0.8WL						
		0.9(DL+ DLempty + ER) ± 1.6WL						
Category D	Earthquake	1.2(DL+ DLempty + LLop + TL) + 1.0LL ± 1.0EQ + 0.2S						
		0.9(DL+ DLempty + LLop + TL) ± 1.0EQ						
Category E	Maintenance	1.2(DL+ DLempty + ML) + 1.0LL ± 1.6(0.25WL)						
		1.2(DL+ DLempty + ML) + 1.6(LL)						
		0.9(DL+ DLempty + ML) ± 1.6(0.25WL)						

## 16.0 STRUCTURE ANALYSIS AND DESIGN

The steel structure is checked in accordance with LRFD method. Frame analysis and structural checks are based on the 3D model that covers all the Load Combinations.

 <b>NISOC</b>	<b>نگهداری و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 21 از 29

[... 127 سری ...]

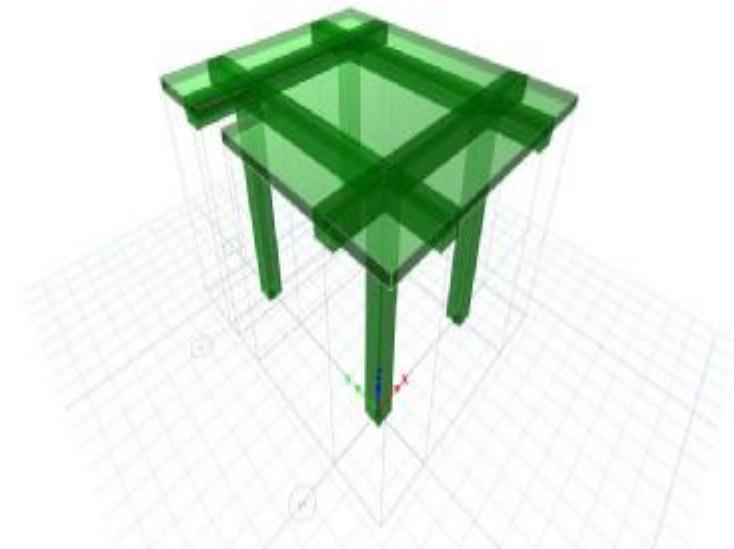


Figure 9: 3D model of ETABS


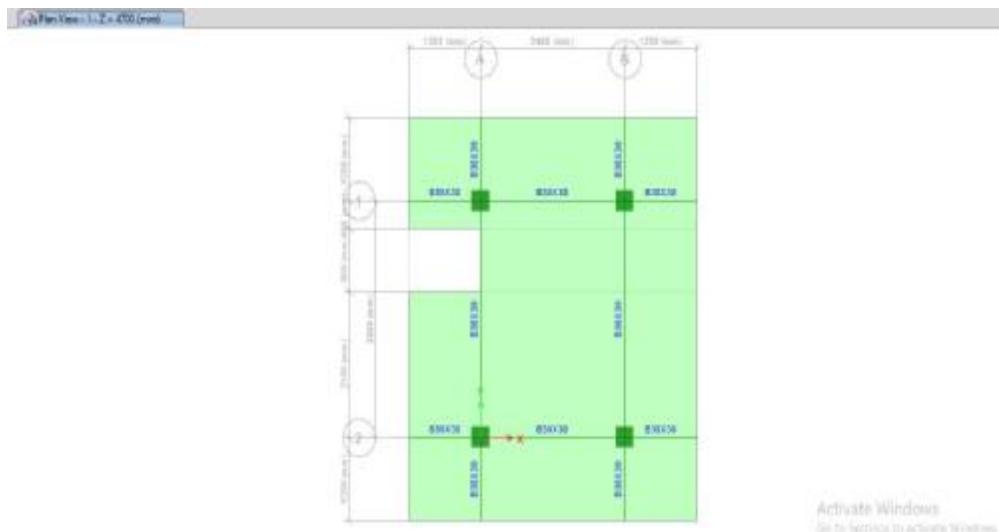


Figure 10 : Plan View

## 17.0 STRUCTURAL DESIGN RESULTS



The design of these elements is done by software facilities according to Code ACI-318-14. Summary of the results for columns and beams design is shown in the following figures.

 NISOC	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 Shiraz Gas Company HIRGAN ENERGY TE																
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b> <table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th>پروژه</th><th>بسته کاری</th><th>صادر کننده</th><th>تسهیلات</th><th>دشته</th><th>نوع مدرک</th><th>سربال</th><th>نسخه</th></tr> </thead> <tbody> <tr> <td>BK</td><td>GCS</td><td>PEDCO</td><td>120</td><td>ST</td><td>CN</td><td>0029</td><td>D01</td></tr> </tbody> </table>	پروژه	بسته کاری	صادر کننده	تسهیلات	دشته	نوع مدرک	سربال	نسخه	BK	GCS	PEDCO	120	ST	CN	0029	D01	شماره صفحه : 22 از 29
پروژه	بسته کاری	صادر کننده	تسهیلات	دشته	نوع مدرک	سربال	نسخه											
BK	GCS	PEDCO	120	ST	CN	0029	D01											

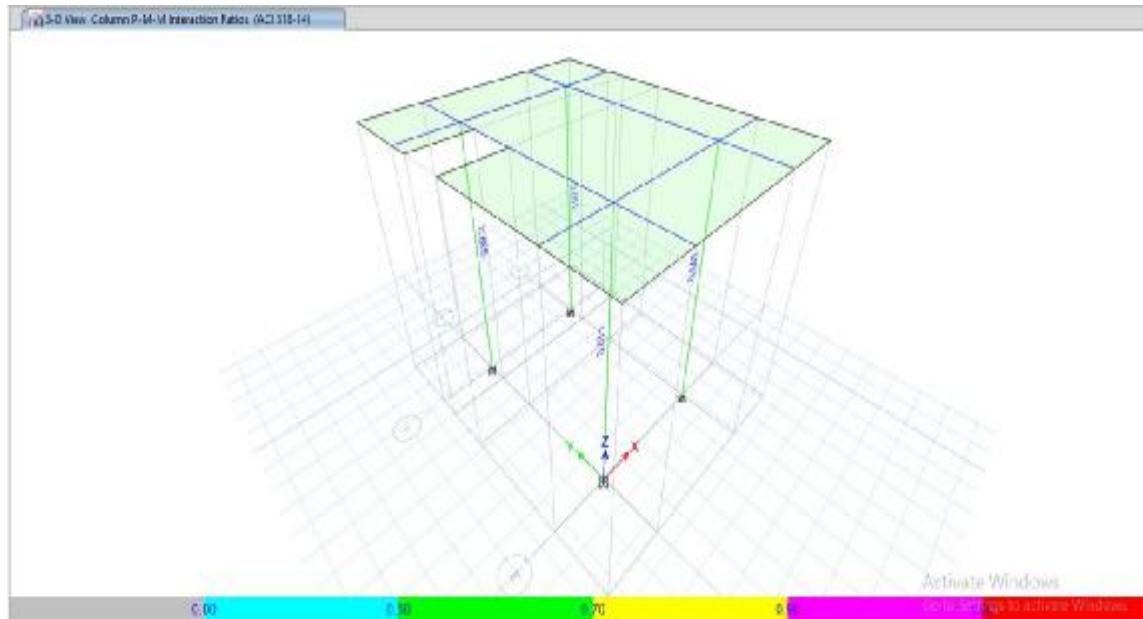


Figure 11: Ratio Check

For all elements D/C ratio shall be  $\leq 1$ , according to above output all elements are ok.

## 18.0 DRIFT CONTROL



According to "Iranian Seismic Design Code for Petroleum Facilities (Pub.038-3<sup>rd</sup> edition)" Table 4-8, drift shall not exceed 0.02.

گروه کاربری و خطرزاوی			انواع سازه‌ها
IV	III	II و I	
+,-15	+,-2+	+,-25	سازه‌های چهار طبقه و کمتر با تیندی‌بندی‌ها، سقف‌های دیوارهای داخلی و سیستم دیوارهای جانبی پیرامونی بدون دیوار برش بنایی که در برابر جایگاه‌ها نسبت طبقه طراحی شده‌اند.
+,-1+	+,-6+	+,-6+	سازه‌های با دیوار برش بنای طرهای
+,-0.7	+,-0.7	+,-0.7	دیگر سازه‌های با دیوار برش بنای
+,-1+	+,-15	+,-2+	دیگر سازه‌ها

The deflection at level X ( $\delta_x$ ) (in. or mm) used to compute the design story drift,  $\Delta$ , shall be determined in accordance with the following equation:

 NISOC	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 Shiraz Gas Company HIRGAN ENERGY																
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b> <table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th>بروزه</th><th>بسته کاری</th><th>صادرکننده</th><th>تسهیلات</th><th>دشته</th><th>نوع مدرک</th><th>سربال</th><th>نسخه</th></tr> <tr> <th>BK</th><th>GCS</th><th>PEDCO</th><th>120</th><th>ST</th><th>CN</th><th>0029</th><th>D01</th></tr> </thead> </table>	بروزه	بسته کاری	صادرکننده	تسهیلات	دشته	نوع مدرک	سربال	نسخه	BK	GCS	PEDCO	120	ST	CN	0029	D01	شماره صفحه : 23 از 29
بروزه	بسته کاری	صادرکننده	تسهیلات	دشته	نوع مدرک	سربال	نسخه											
BK	GCS	PEDCO	120	ST	CN	0029	D01											

Equation 4-22 (Pub.038-3<sup>rd</sup> edition, part 4-14-1):

$\delta_{xe}$  = Maximum displacement in x direction due to earthquake: 6.298 mm

$$\delta_x = \frac{C_d \delta_{xe}}{I} = \frac{5.5 \times 12.987}{1.25} = 5.714 \text{ cm} \rightarrow \Delta x = \frac{5.714}{470} = 0.0121 < 0.02 \text{ ok}$$

Also

$\delta_{ye}$  = Maximum displacement in y direction due to earthquake: 6.682 mm


$$\delta_y = \frac{C_d \delta_{ye}}{I} = \frac{5.5 \times 13.38}{1.25} = 5.887 \text{ cm}, \quad \Delta y = \frac{5.887}{470} = 0.0125 < 0.02 \text{ ok}$$

## 19.0 JOIST SHEAR CAPACITY RATIO CONTROL



According to ACI 318-14 part 18-8-4, shear strength of connection has been controlled and for all columns have been shown below.

Direction :		
<b>Location:</b>	<b>At the intersection of all Axes</b>	
$f_y$ =	4000.00	$\text{kg}/\text{cm}^2$
$f'_c$ =	300.00	$\text{kg}/\text{cm}^2$
$h$ =	30.00	cm
$B$ =	30.00	cm
$A_s$ =	6.032	$\text{cm}^2$
$A_s$ =	6.032	$\text{cm}^2$
$A_s$ =	$A_s + A_s$	$\text{cm}^2$
$A_s$ =	12.06	$\text{cm}^2$
$b$ =	30.00	cm
$x$ =	0.00	cm
$\emptyset$ =	0.75	
$A_j$ =	$h(\min(b+h), (b+2x))$	$\text{cm}^2$
$A_j$ =	900	$\text{cm}^2$
$V_n =$	$5.3\emptyset A_j (f'_c)^{0.5}$	
$V_n =$	62.0	ton
$V_u =$	$1.25 f_y A_s$	
$V_u =$	60.3	ton
$\text{Ratio}=$	$V_u / V_n$	
$\text{Ratio}=$	0.97	OK

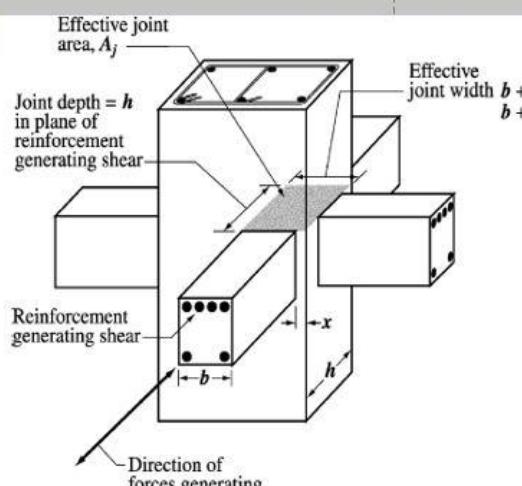

The diagram illustrates a concrete column joint at the intersection of all axes. It shows a cross-section of the joint with dimensions  $b$  and  $h$ . The effective joint area is labeled  $A_j$ . The joint depth is indicated as  $h$  in the plane of reinforcement generating shear. The reinforcement generating shear is shown as a force acting on the reinforcement bars. The direction of forces generating shear is also indicated.

## 20.0 STRONG COLUMN-WEAK BEAM REQUIREMENTS IN SPECIAL CONCRETE MOMENT FRAME

According to INBC Part 9 (section: 9-20-60-4), the flexural strength of columns shall satisfy:

$$\Sigma M_{nc} \geq 1.2 \Sigma M_{nb}$$

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه: 24 از 29

Based on Etabs report, maximum force due to seismic load combination is equal to 11.0 ton which is smaller than  $0.1A_g f_c$ , so according to section 9-20-6-4-5 could be ignored above equation for one story building.

## 21.0 FOUNDATION DESIGN AND RESULTS

### 21.1 FOUNDATION MODEL

Foundation model, analyse and design has been done by SAFE2016 software.

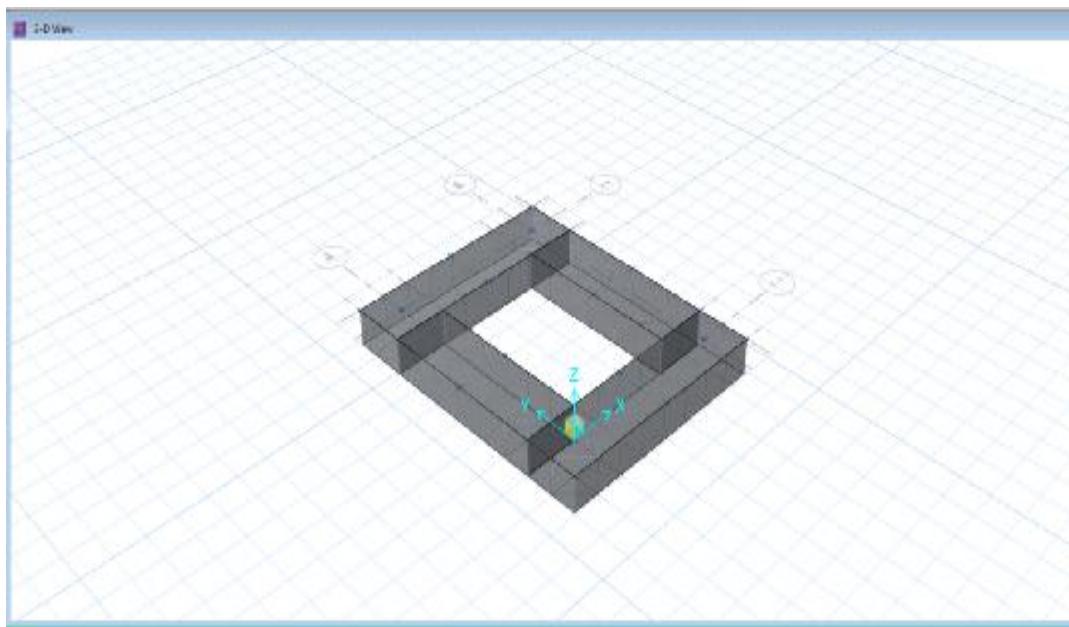


Figure 12: Foundation 3D plan in SAFE

### 21.2 SOIL CHARACTERISTIC

Based on Geotechnical Report (Attachment 4, 5):

$q_{allowable} = 1.75 \text{ kg/cm}^2$  (Allowable Soil Bearing Capacity)

$\delta_{allowable} = 1.6 \text{ cm}$  (Allowable Settlement)

$K_s = 1.6 \text{ kg/cm}^3$  (Subgrade Modulus)



نگهداری و افزایش تولید میدان نفتی بینک  
سطح ارض

### احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک



شماره پیمان:  
053 - 073 - 9184



#### Calculation Note For CCTV Rack Room- Binak PU

شماره صفحه : 25 از 29

جدول 6-1. مدول عکس العمل بستر بی مربعی، مستطیلی و نواری برای عمق یک متر

$B(m)$	مدول عکس العمل بستر بی سطحی ( $kg/cm^3$ )			
	$L/B=1$	$L/B=2$	$L/B=5$	$L/B=10$
1.0	1.69	1.33	1.14	1.09
2.0	1.00	0.85	0.78	0.77
3.0	0.78	0.69	0.65	0.64
4.0	0.68	0.60	0.57	0.57
5.0	0.61	0.55	0.53	0.53

#### Shallow Foundation - GCS

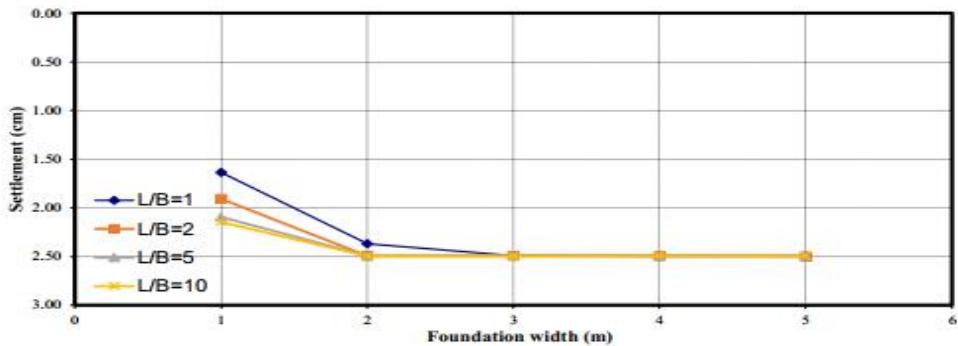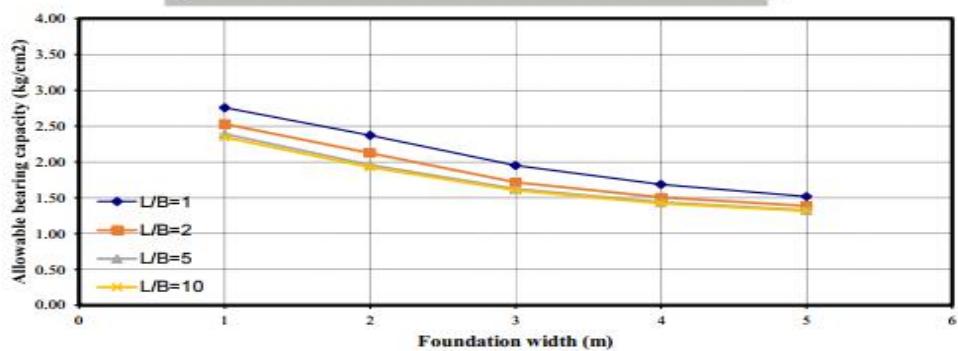


$$D = 1m$$

$$D_f = 1m$$

Notes:

$D$  : Depth of footing with respect to ground surface

$D_f$  : Depth of footing embedment

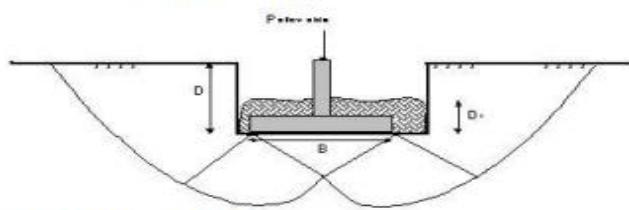

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 26 از 29

### 21.3 LOADS

The loads have been imported from ETABS analysis.

Reinforced concrete unit weight equals  $2500 \text{ kg/m}^3$  and defined for SAFE, so the program calculated the foundation weight automatically.

Soil unit weight equals to  $1900 \text{ kg/m}^3$ . The soil height above foundation is 1.0 m, so distributed soil weight:

$$W_s = 1.0 \times 1900 = 1900 \text{ kg/m}^2$$

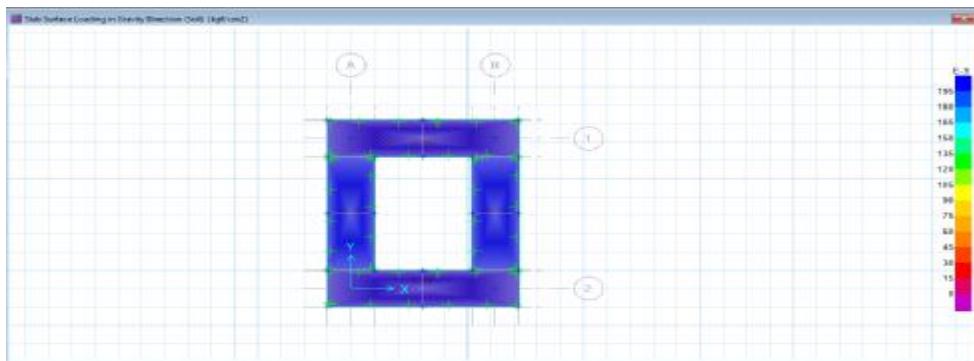


Figure 13 : soil weight on foundation



### 21.4 SETTLEMENT CONTROL

Settlement in different service load combinations should be checked by allowable value.

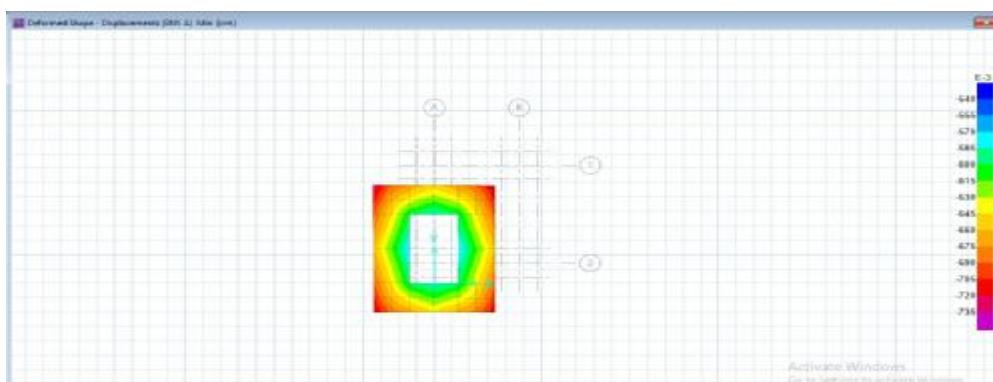


Figure 14 : Foundation Settlement

Maximum settlement of foundation equals to 0.72 cm, which is less than allowable 1.6 cm.

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 27 از 29

## 21.5 SOIL PRESSURE CONTROL



Soil pressures in different service load combinations should be checked by allowable value.


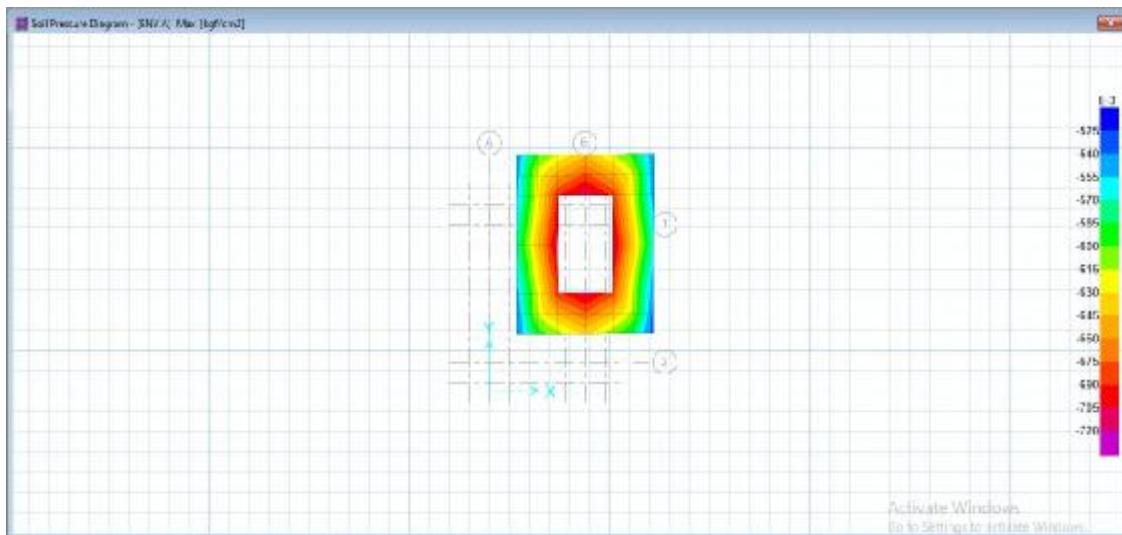


Figure 15 : Soil Pressure under Foundation

Maximum soil pressure under foundation equals to  $1.165 \text{ kg/cm}^2$ , which is less than  $1.75 \text{ kg/cm}^2$ .

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 28 از 29

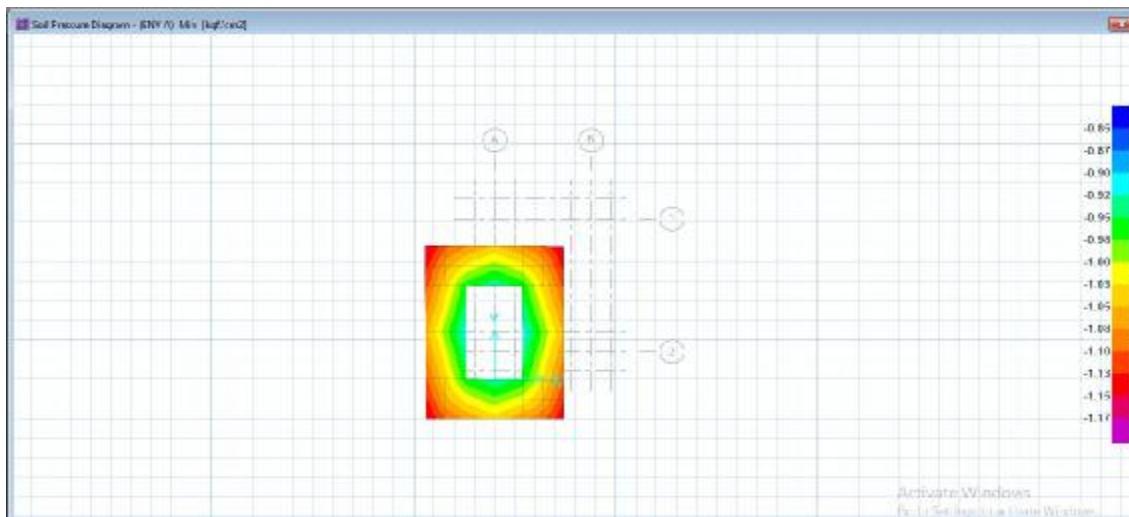

## 21.6 PUNCHING SHEAR CONTROL

The punching shear control ratio of foundation is shown below. As seen the punching shear ratio in all columns base which is calculated by software is less than allowable range (1.0), so the footing thickness is acceptable.

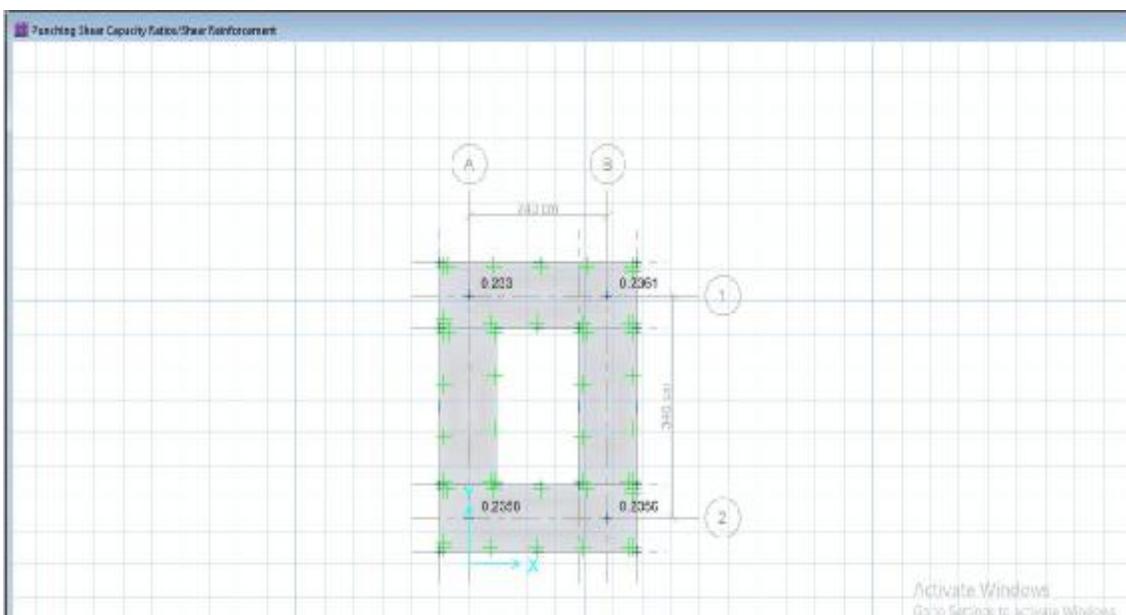


Figure 16 : Punching Shear Capacity Ratios

## 21.7 FOUNDATION DESIGN

Foundation reinforcement is calculated by software and add bars in X, Y direction are shown at below figure. Uniform  $\Phi 16 @ 150$  pattern is assigned for top and bottom of foundation in both directions and needed additional bars at some part that is presented in below pictures.

 <b>NISOC</b>	<b>نگهداشت و افزایش تولید میدان نفتی بینک</b> <b>سطح الارض</b> <b>احداث ردیف تراکم گاز در ایستگاه جمع آوری بینک</b>	 <b>HIRGAN ENERGY</b>
شماره پیمان: 053 - 073 - 9184	<b>Calculation Note For CCTV Rack Room- Binak PU</b>	شماره صفحه : 29 از 29

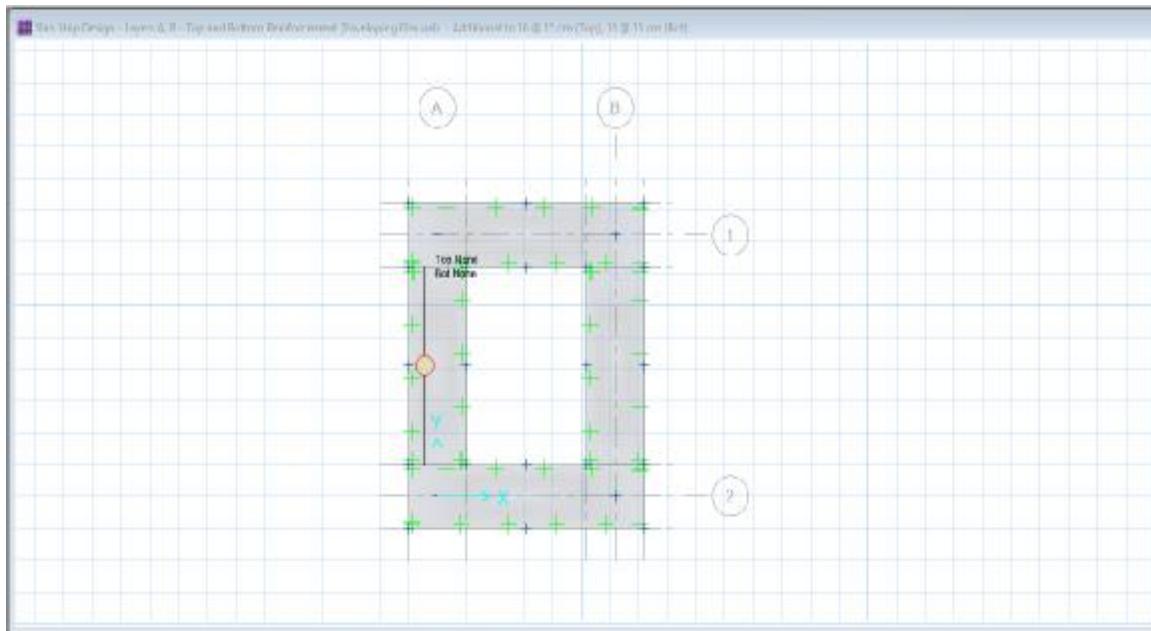


Figure 17: Reinforcement in X, Y Direction

In Both Directions:

Top Bar USE  $\Phi 16 @ 150$  mm

Bottom Bar USE  $\Phi 16 @ 150$  mm

Minimum rebar for strip foundation:

$$A_{s\min} = 0.0018 \times b \times h = 0.0018 \times 100 \times 60 = 10.8 \text{ cm}^2/\text{m}$$

$$A_{s\text{ used}} = \emptyset 16 @ 150 = 12.06 \text{ cm}^2$$