














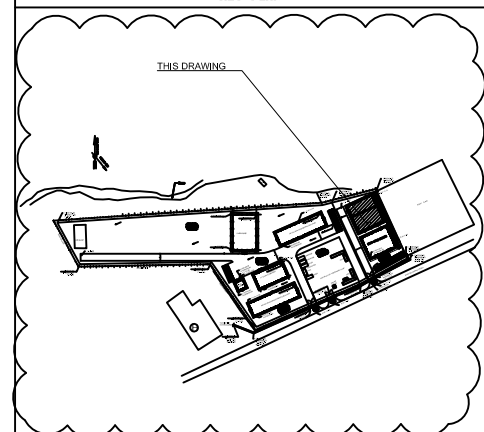
D02

NOTES	
1.	ALL DIMENSIONS ARE IN CENTIMETER & ALL ELEVATIONS ARE IN METER.
2.	PORTABLE FIRE EXTINGUISHER SHALL HAVE MAXIMUM TRAVEL DISTANCE OF 15M.
3.	WHEELED FIRE EXTINGUISHER SHALL HAVE MAXIMUM TRAVEL DISTANCE OF 30M.
4.	PORTABLE FIRE EXTINGUISHERS MUST BE INSTALLED SO THAT TOP OF THE EXTINGUISHER IS NOT MORE THAN 1.53 ABOVE THE FLOOR AND THE BOTTOM OF IT NOT LESS THAN 4 INCH ABOVE THE FLOOR.
5.	FIRE EXTINGUISHERS MUST BE MAINTAINED IN FULLY CHARGED AND OPERABLE CONDITION AND KEPT IN THEIR DESIGNATED PLACES AT ALL TIMES WHEN THEY ARE NOT BEING USED.
6.	FIRE EXTINGUISHERS MUST NOT BE UNSTRICTED OR OBSCURED FROM VIEW.

LEGEND			
SYMBOL	QTY.	DESCRIPTION	TAG NO.
	9	SMOKE DETECTOR	SD-1901-09
	8	HEAT DETECTOR	HD-1901-1908
	1	LOCAL FIRE ALARM PANEL	LFAP-1901
	4	MANUAL ALARM CALL POINT	MACP-1901-4
	4	FLASHING BEACON	FB-1901-4
	4	ALARM BELL	AB-1901-4
	5	FIREFIGHTING EQUIPMENT FIRE EXTINGUISHER	FEF-1901-05
	5	CO2 EXTINGUISHER (FIREFIGHTING)	FCF-1901-05
	-	WHEATLEY FIRE EXTINGUISHER FIRE EXTINGUISHER	WFE-1101
	-	WIND SOCK	WS-1101
	3	FIRST AID KIT	FAK-1901-03

REFERENCE DRAWING	DRG. No.
OVERALL LAYOUT FOR CAMP AREA	HK-GNRM-PEDCO-220-CY-PY-0001
ARCHITECTURAL DRAWING FOR NISOC OFFICE BUILDING	HK-GNRM-PEDCO-220-AR-DW-0001
ARCHITECTURAL DRAWING FOR NISOC RESIDENTIAL BUILDING	HK-GNRM-PEDCO-220-AR-DW-0002
ARCHITECTURAL DRAWING FOR PETRO INR OFFICE BUILDING	HK-GNRM-PEDCO-220-AR-DW-0003
ARCHITECTURAL DRAWING FOR PETRO INR/CONTRACTORS RESIDENTIAL	HK-GNRM-PEDCO-220-AR-DW-0004
ARCHITECTURAL DRAWING FOR WAREHOUSE OF RETS MOBILIZATION	HK-GNRM-PEDCO-220-AR-DW-0004A
ARCHITECTURAL DRAWING FOR DRIVERS REST ROOM	HK-GNRM-PEDCO-220-AR-DW-0004A
ARCHITECTURAL DRAWING FOR PETRO INR RESIDENTIAL BUILDING	HK-GNRM-PEDCO-220-AR-DW-0007

KEY PLAN

[illegible]