

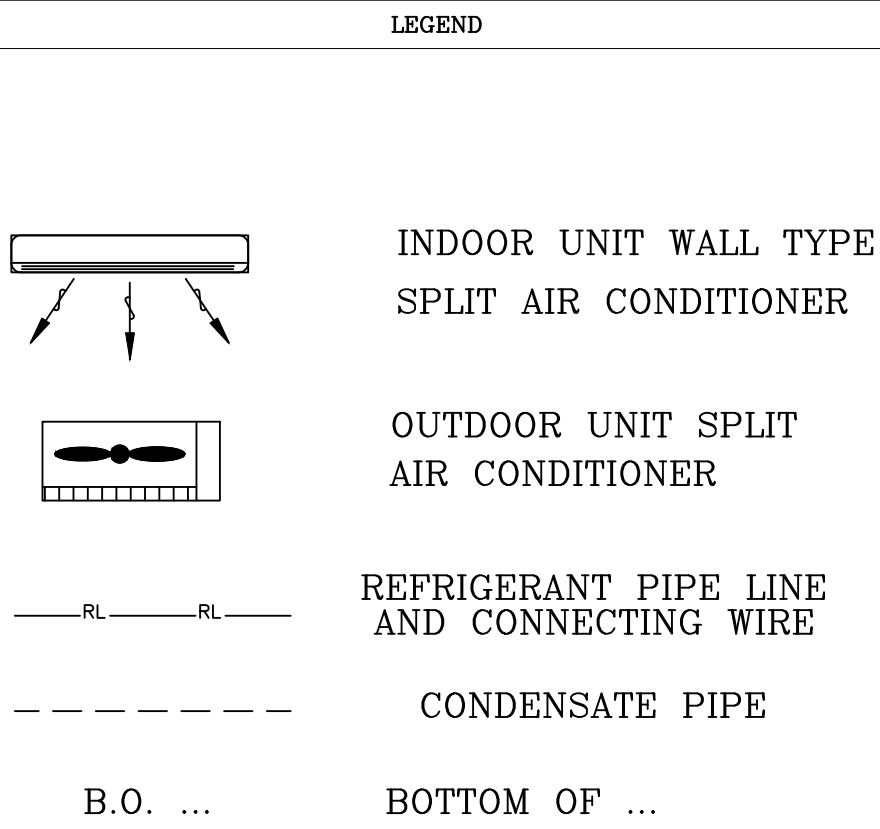
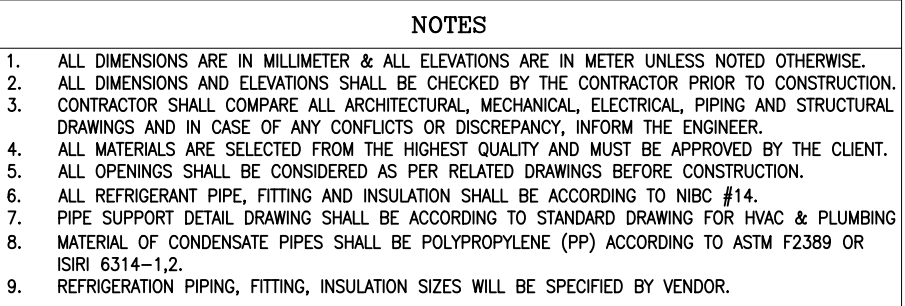


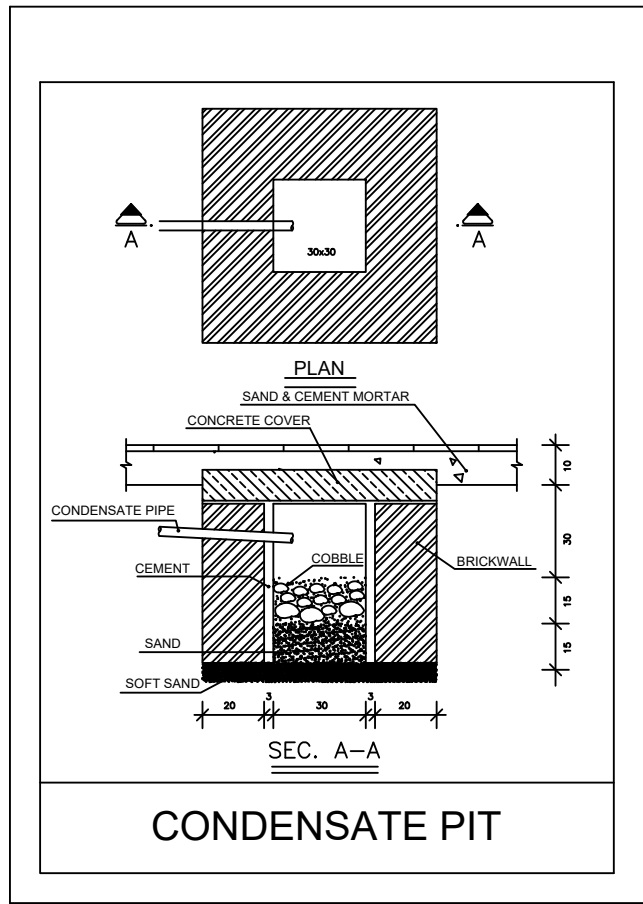

| REFERENCE DRAWING                                     | DRG. No.                     |
|-------------------------------------------------------|------------------------------|
| HVAC & PLUMBING DESIGN CRITERIA                       | BK-GNRL-PEDCO-000-HV-DC-0001 |
| SPECIFICATION FOR HVAC EQUIPMENT                      | BK-GNRL-PEDCO-000-HV-SP-0001 |
| SPECIFICATION FOR DUCT WORK & PIPE WORK               | BK-GNRL-PEDCO-000-HV-SP-0002 |
| STANDARD DRAWING FOR HVAC & PLUMBING                  | BK-GNRL-PEDCO-000-HV-DW-0001 |
| SYMBOL & LEGEND FOR HVAC & PLUMBING                   | BK-GNRL-PEDCO-000-HV-DW-0002 |
| ARCHITECTURAL DRAWING FOR CTV<br>RACK ROOM - BINAK PU | BK-GCS-PEDCO-120-AR-PY-0001  |
| UNIT PLAN PLAN DRAWING                                | BK-GCS-PEDCO-120-PI-PY-0010  |

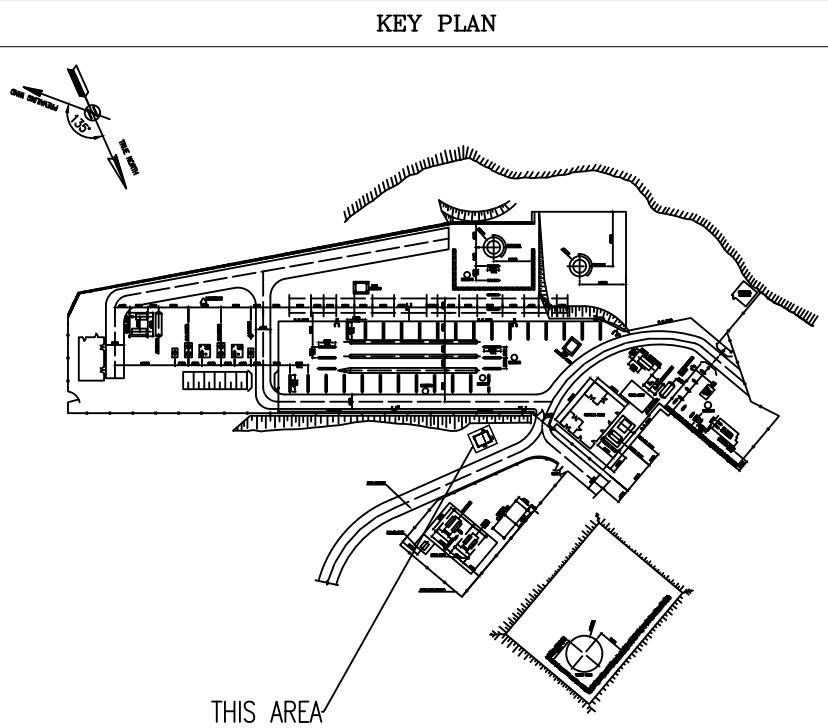

|     |             |
|-----|-------------|
| 100 | GUARD HOUSE |
| 101 | RACK ROOM   |

| EQUIPMENT NO.                        | QTY. | TYPE            | REQUIRED COOLING CAP. SENSIBLE/LATENT (BTU/HR) | REQUIRED HEATING CAP. (BTU/HR) | ACTUAL/NOMINAL CAP. SENSIBLE/LATENT (BTU/HR) | ELECTRIC POWER SUPPLY (V/PH/Hz) | POWER CONSUMPTION (KW) | SERVICE AREA | REMARK                                                                                             |
|--------------------------------------|------|-----------------|------------------------------------------------|--------------------------------|----------------------------------------------|---------------------------------|------------------------|--------------|----------------------------------------------------------------------------------------------------|
| 1202-SUI-PUCR-01<br>1202-SUO-PUCR-01 | 1    | WALL MOUNTED T3 | 5248/1814                                      | 2652                           | BY VENDOR                                    | 230/1/50                        | BY VENDOR              | GUARD HOUSE  | INDOOR AND OUTDOOR UNIT WITH THERMOSTAT AND ALL STANDARD ACCESSORY COOLING AND HEATING (HEAT PUMP) |
| 1202-SUI-PUCR-02<br>1202-SUO-PUCR-02 | 1    | WALL MOUNTED T3 | 4779/0                                         | 312                            | BY VENDOR                                    | 230/1/50                        | BY VENDOR              | RACK ROOM    | INDOOR AND OUTDOOR UNIT WITH THERMOSTAT AND ALL STANDARD ACCESSORY COOLING ONLY                    |

[illegible]