


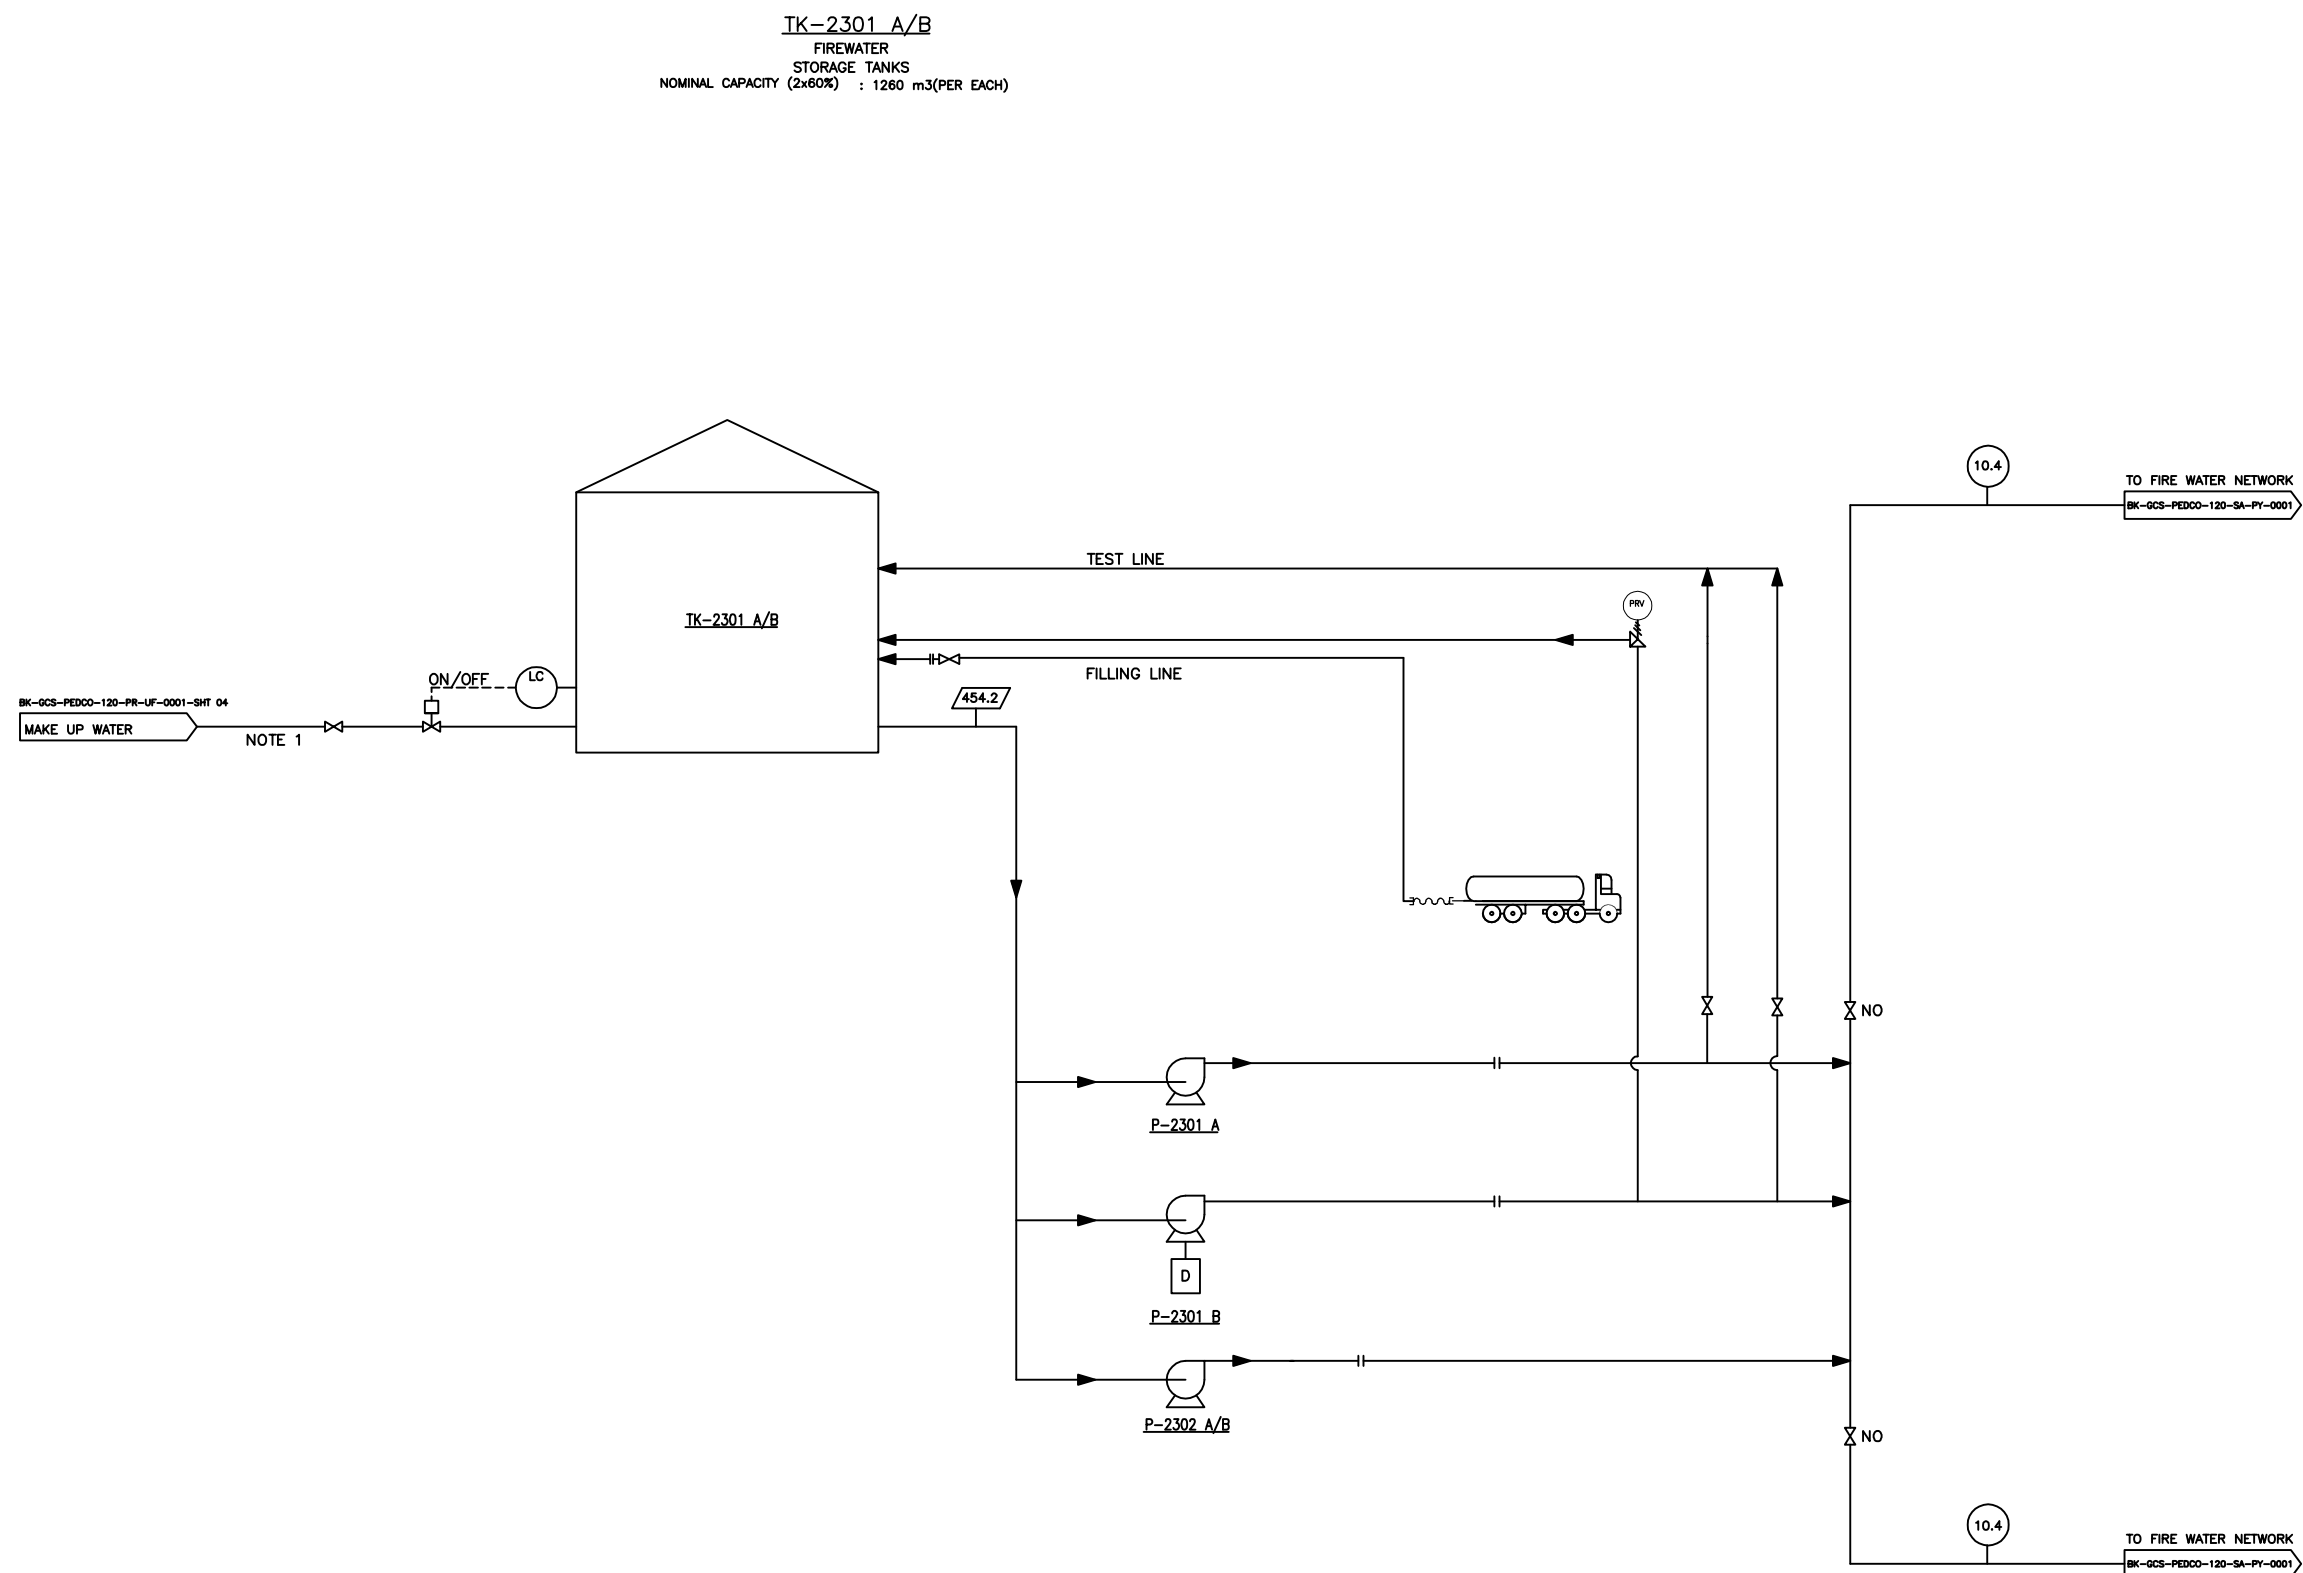

NOTES	
1-	THE INDICATED STREAM CORRESPONDS TO THE FILLING RATE OF FIREWATER STORAGE TANK, ESTIMATED FILLING RATE FOR FILLING OF STORAGE TANKS IN 5 DAYS IS 20 m3/hr.

REFERENCE DRAWING	DRG. No.
CALCULATION NOTE FOR FIRE WATER DEMAND	BK-GCS-PEDCO-120-SA-CN-0002

LEGEND

 FLOW RATE (m³/h)
 OPERATING PRESSURE (bar.a)

[illegible]